


AIR CONDITIONING UNIT HANGING SUPPORT DETAIL  
 (NOT TO SCALE)


LOW VELOCITY DUCTWORK FLOWS  
 (NO SCALE)

TYPICAL SINGLE LINE DUCT EQUIVALENTS  
 (NOT TO SCALE)


NOT TO SCALE


Property of ONLY ENGINEERS

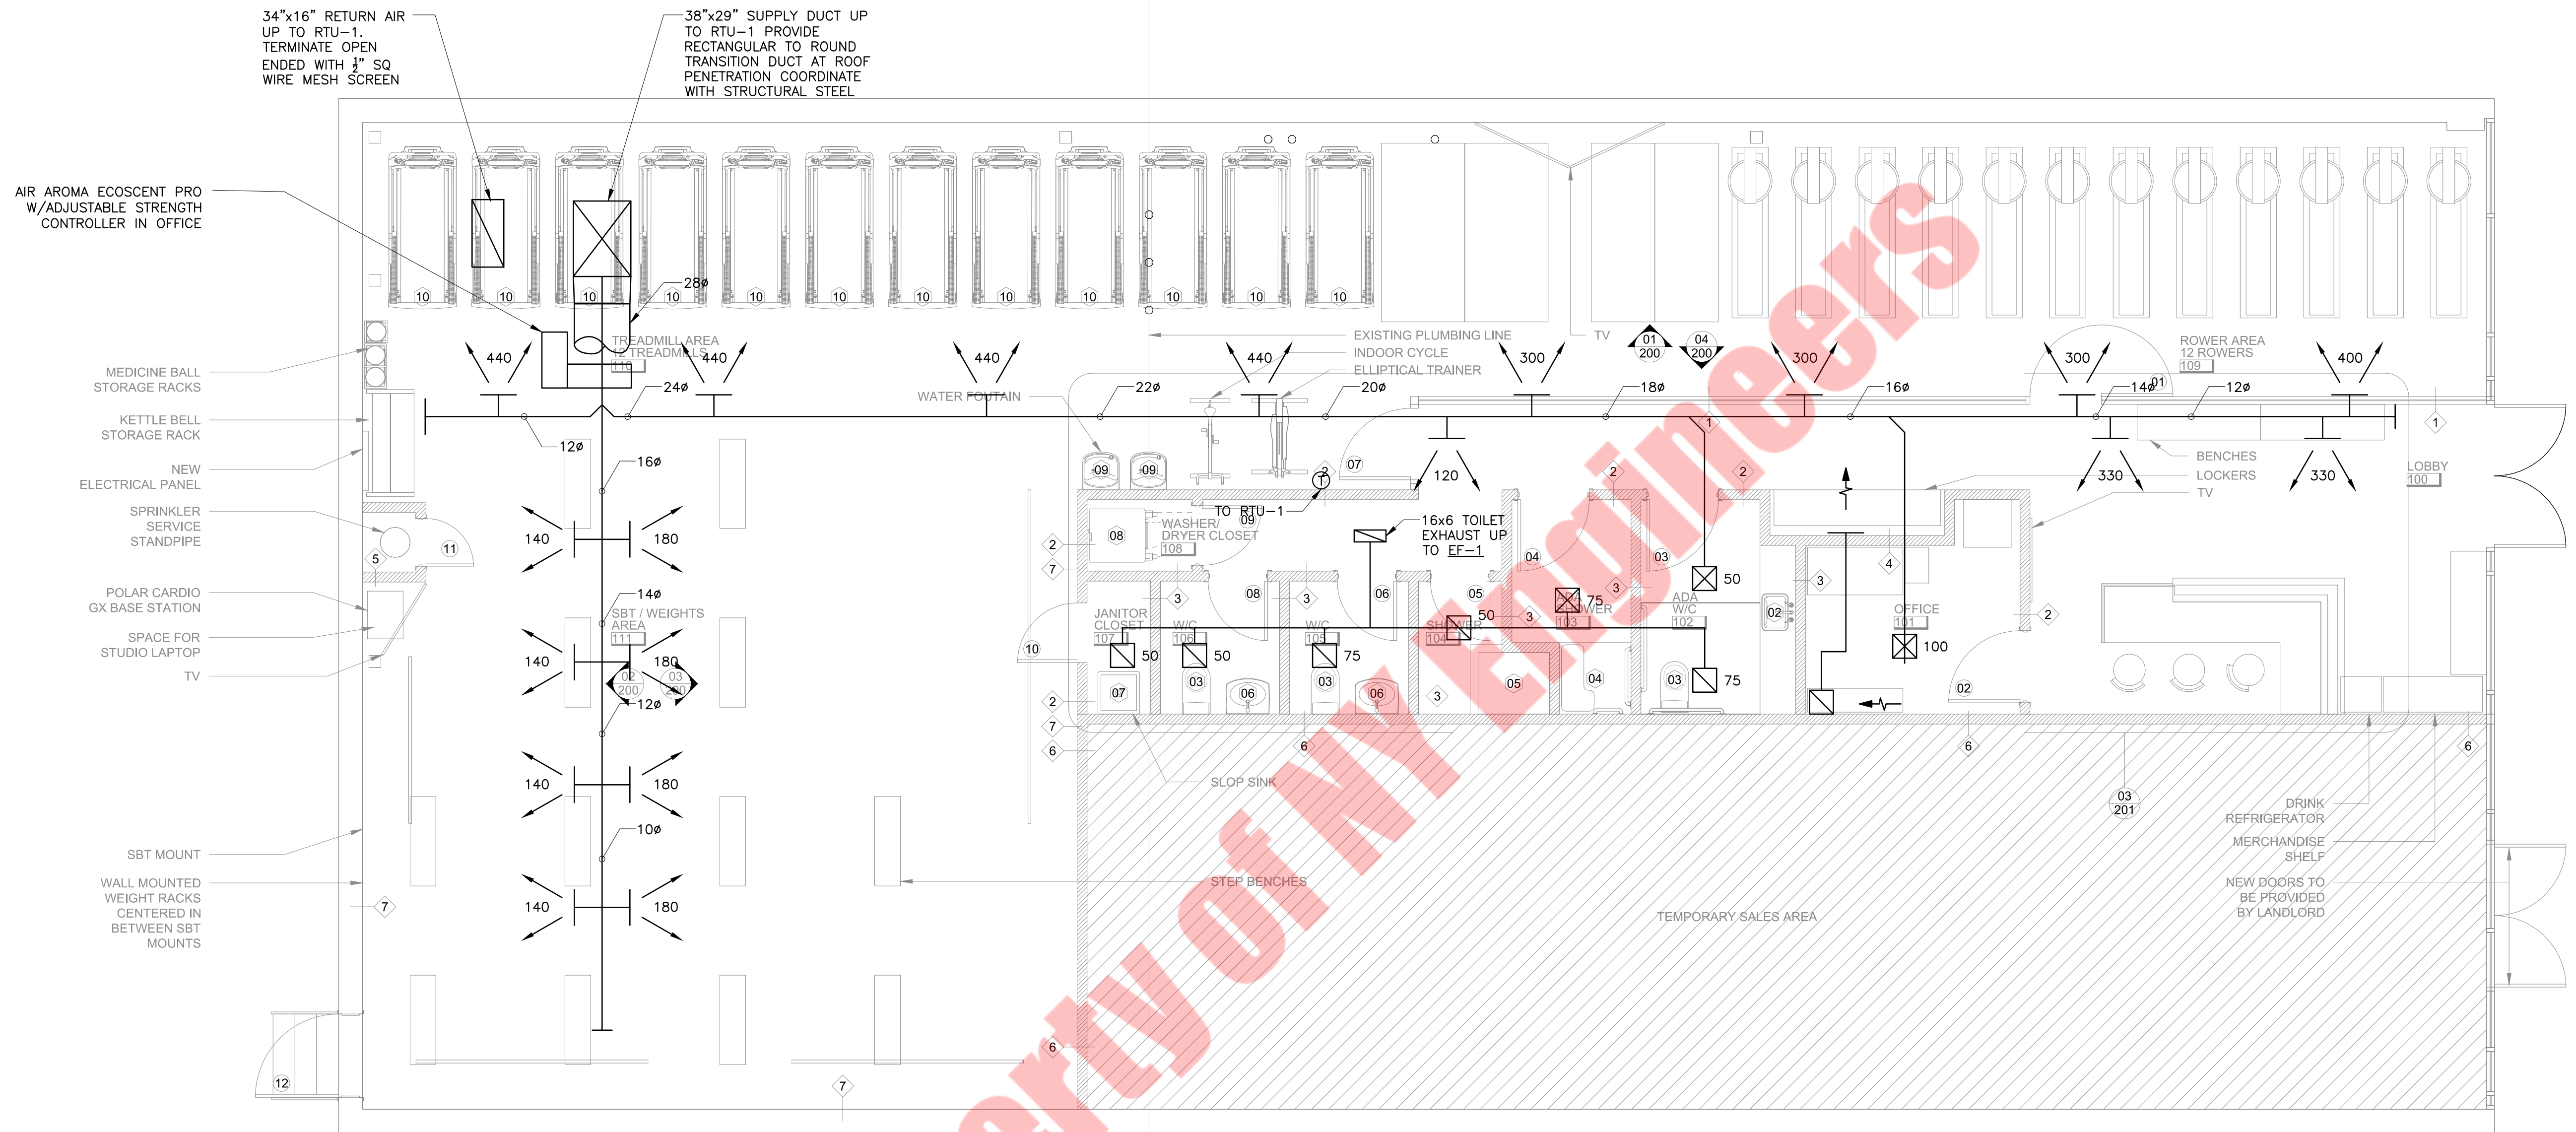

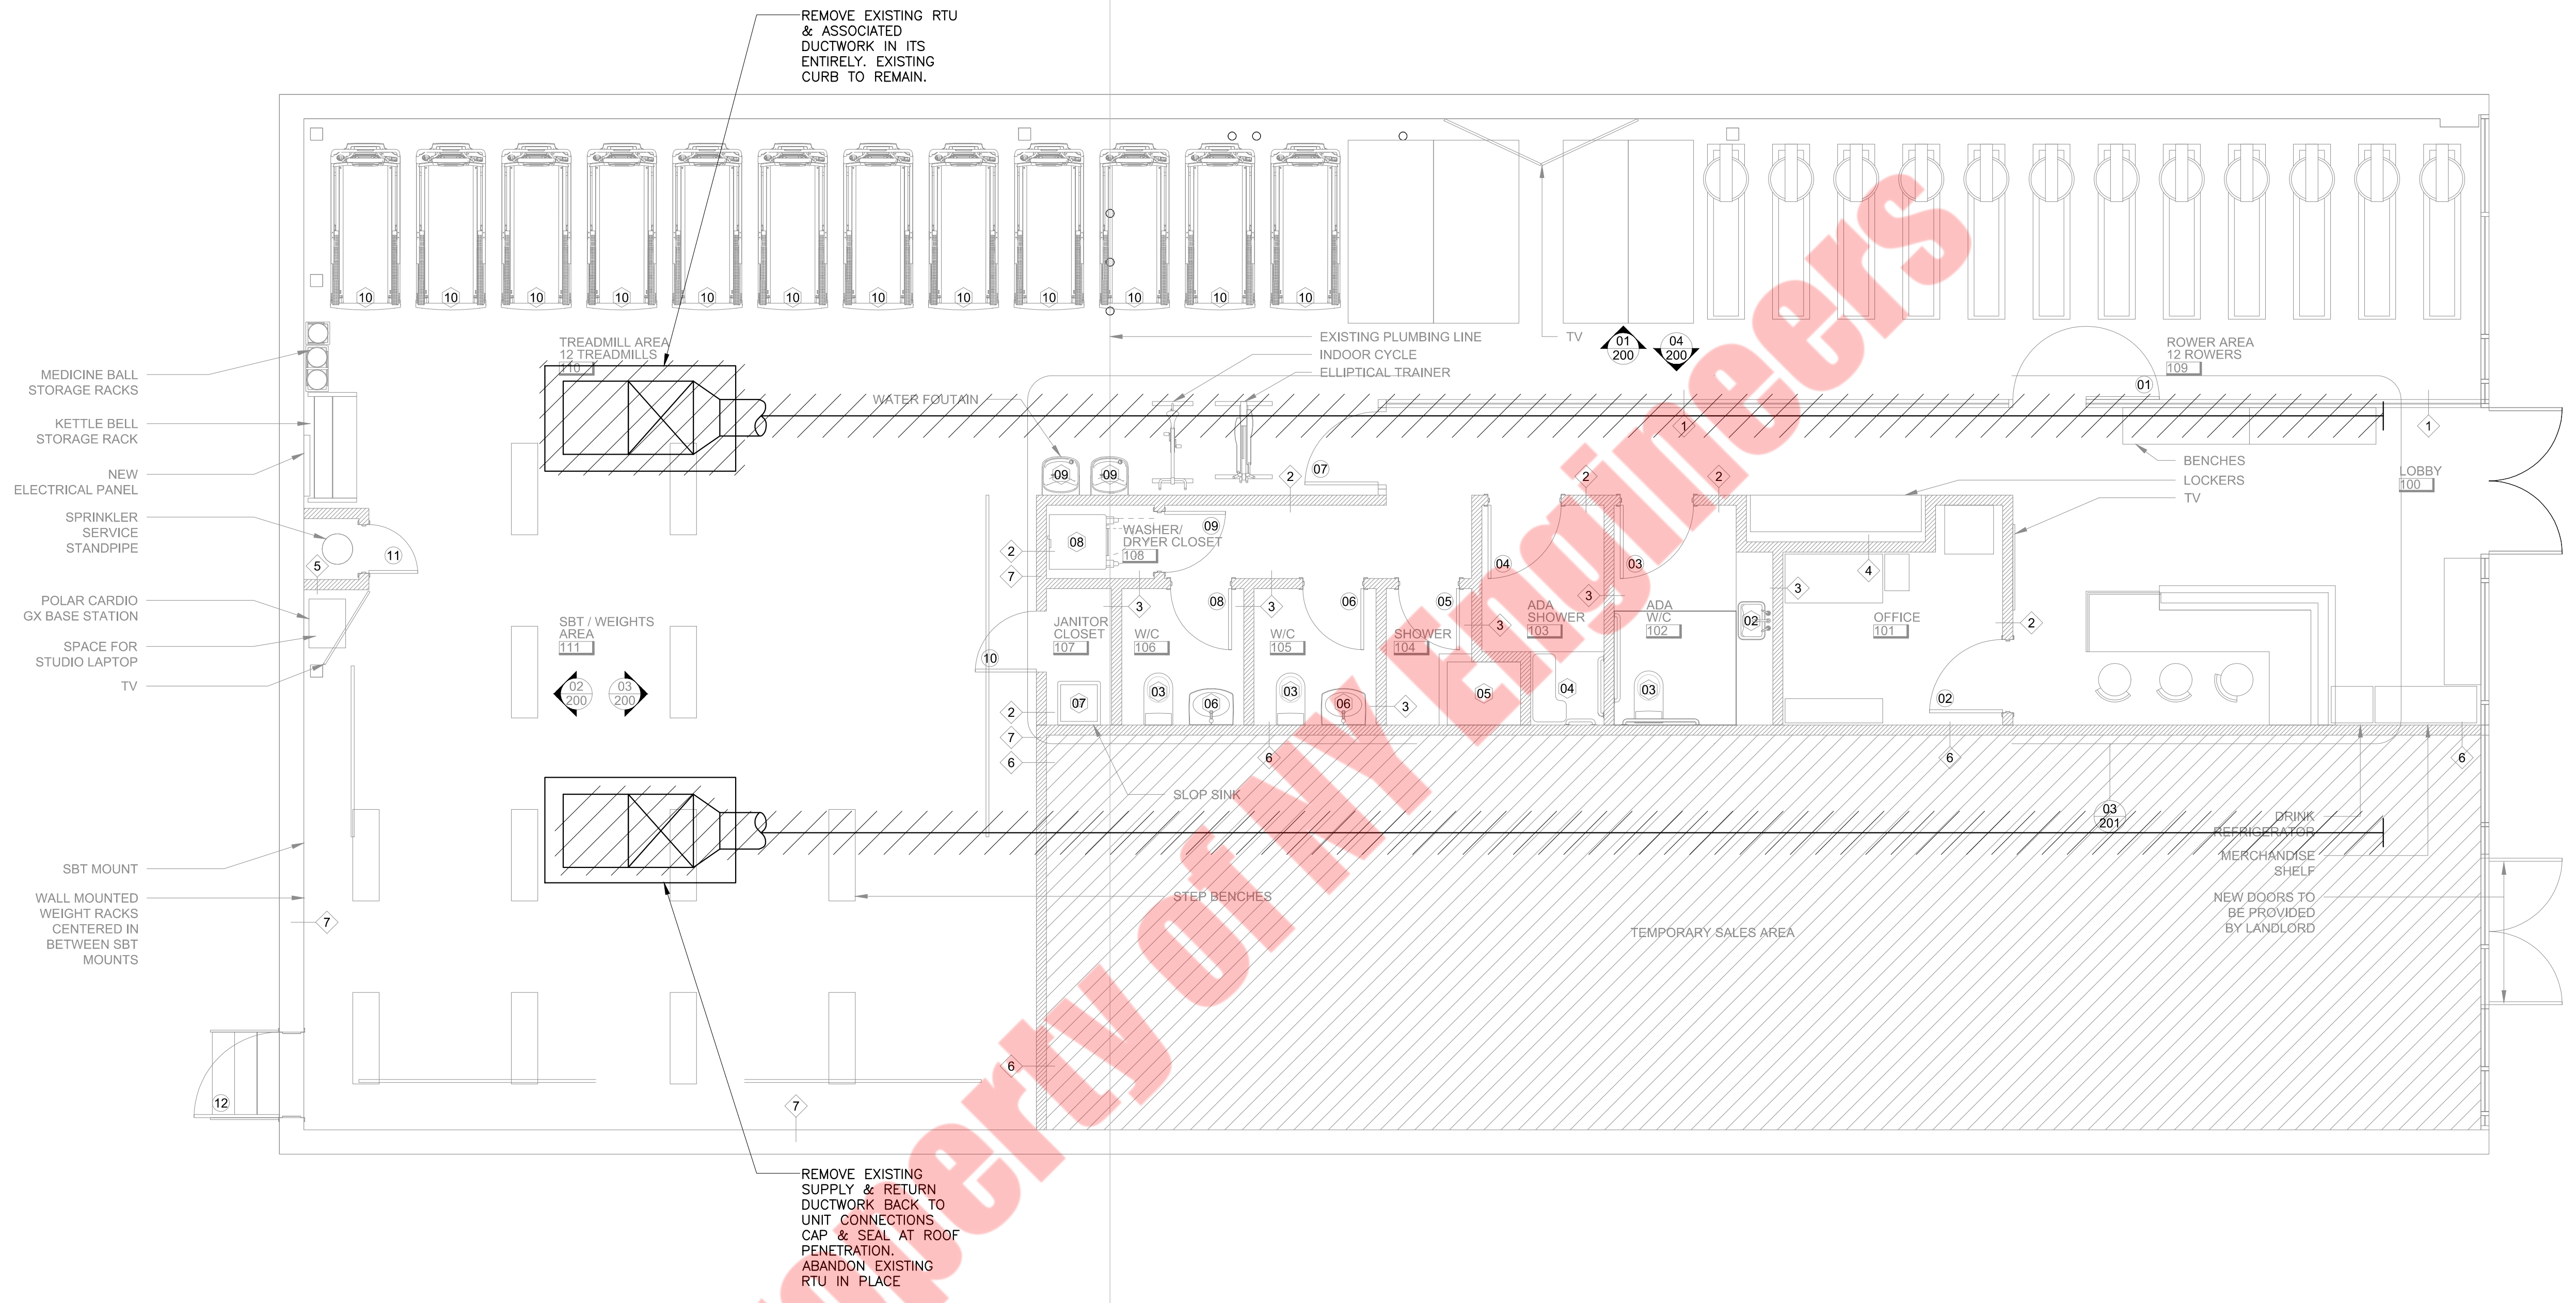




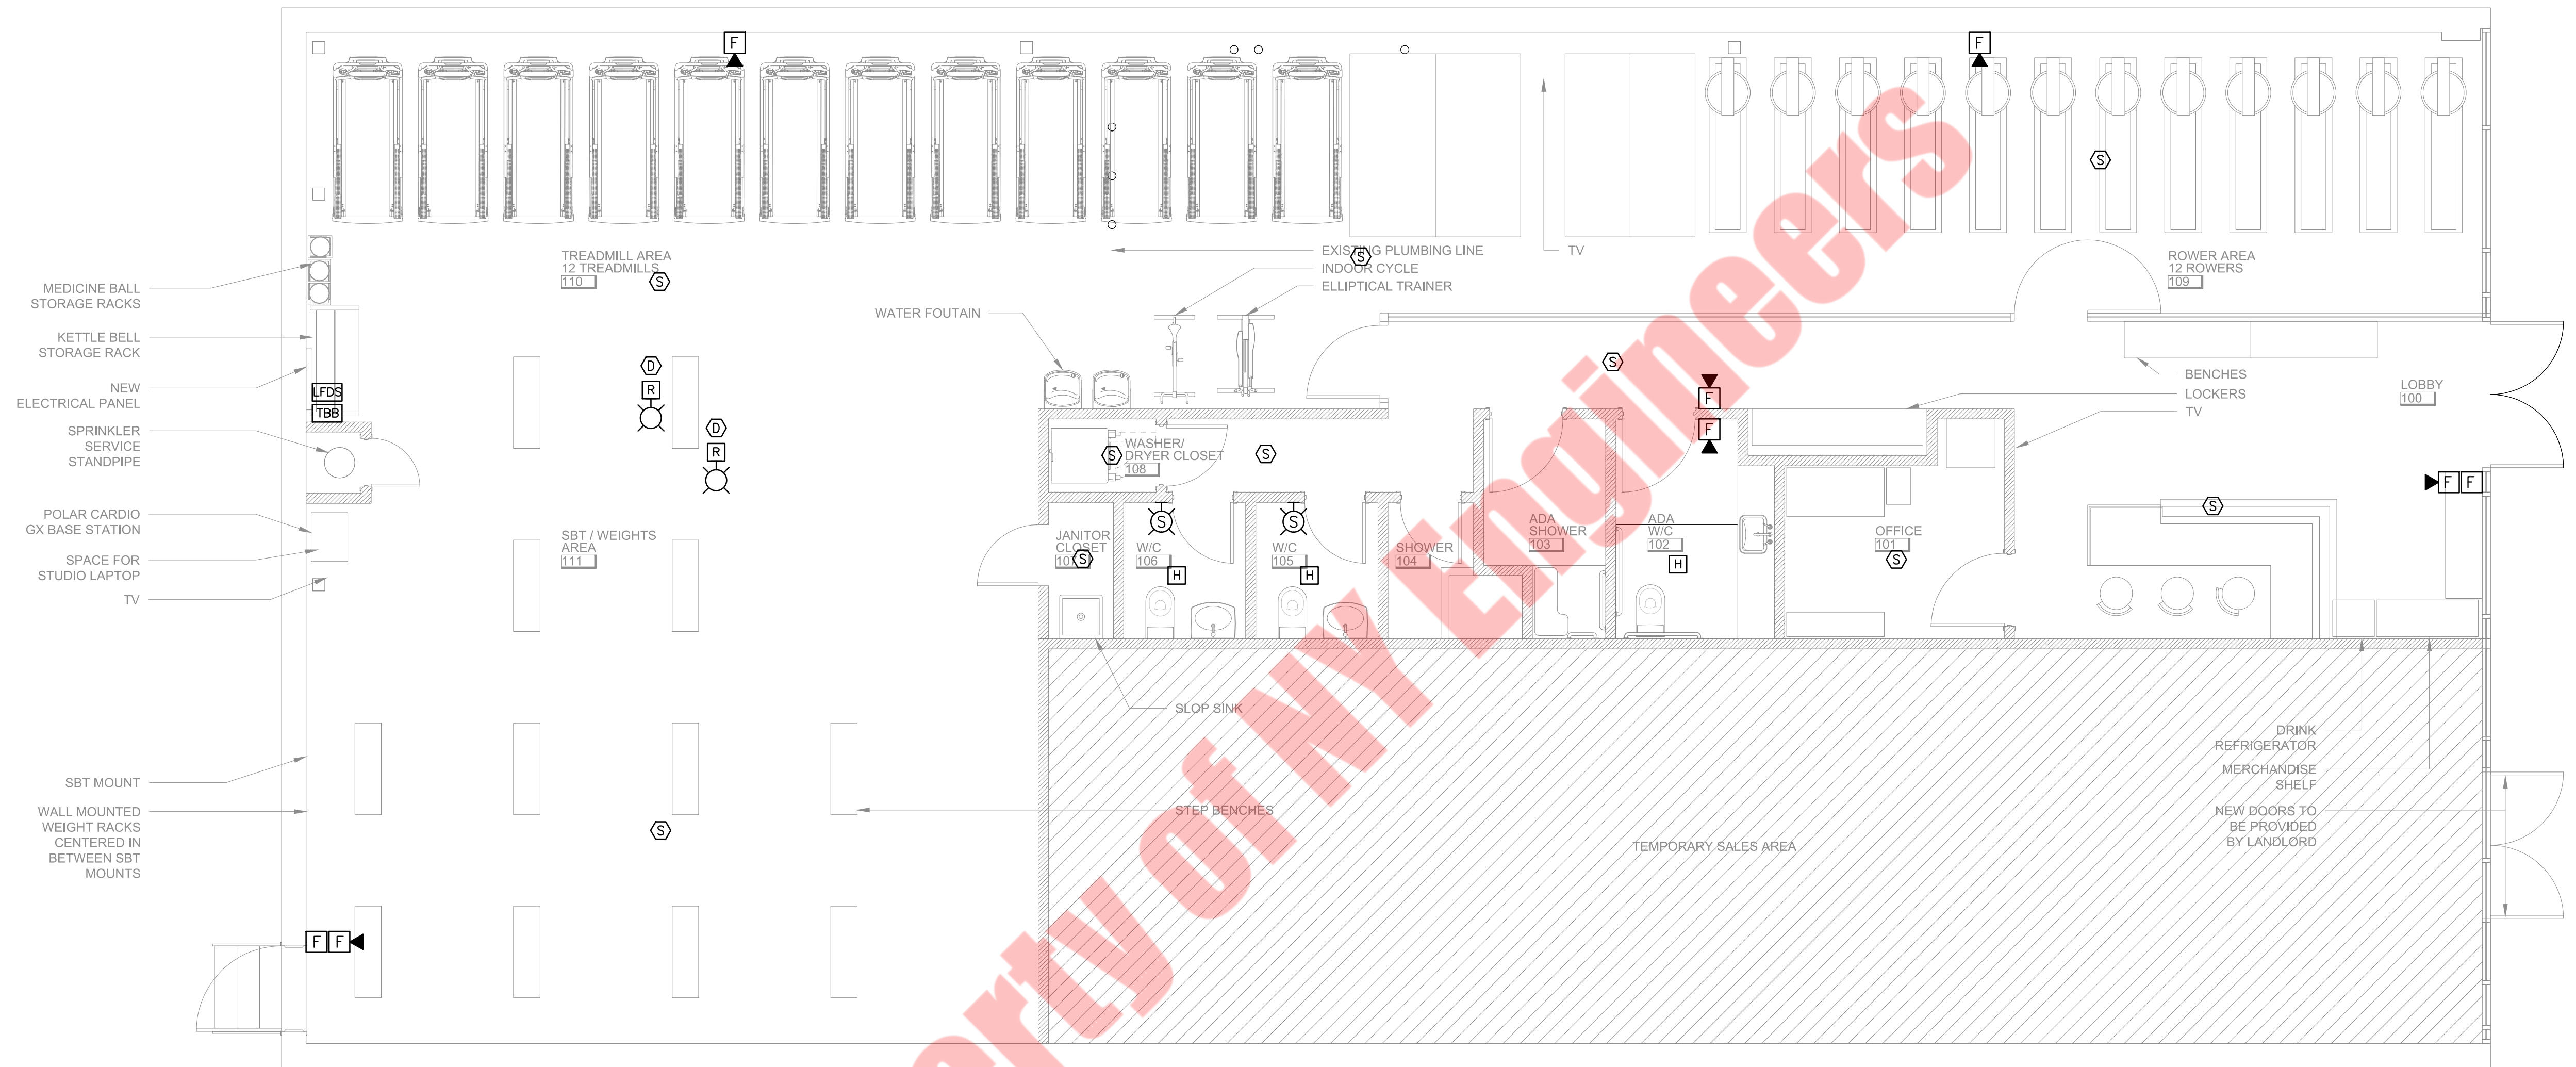

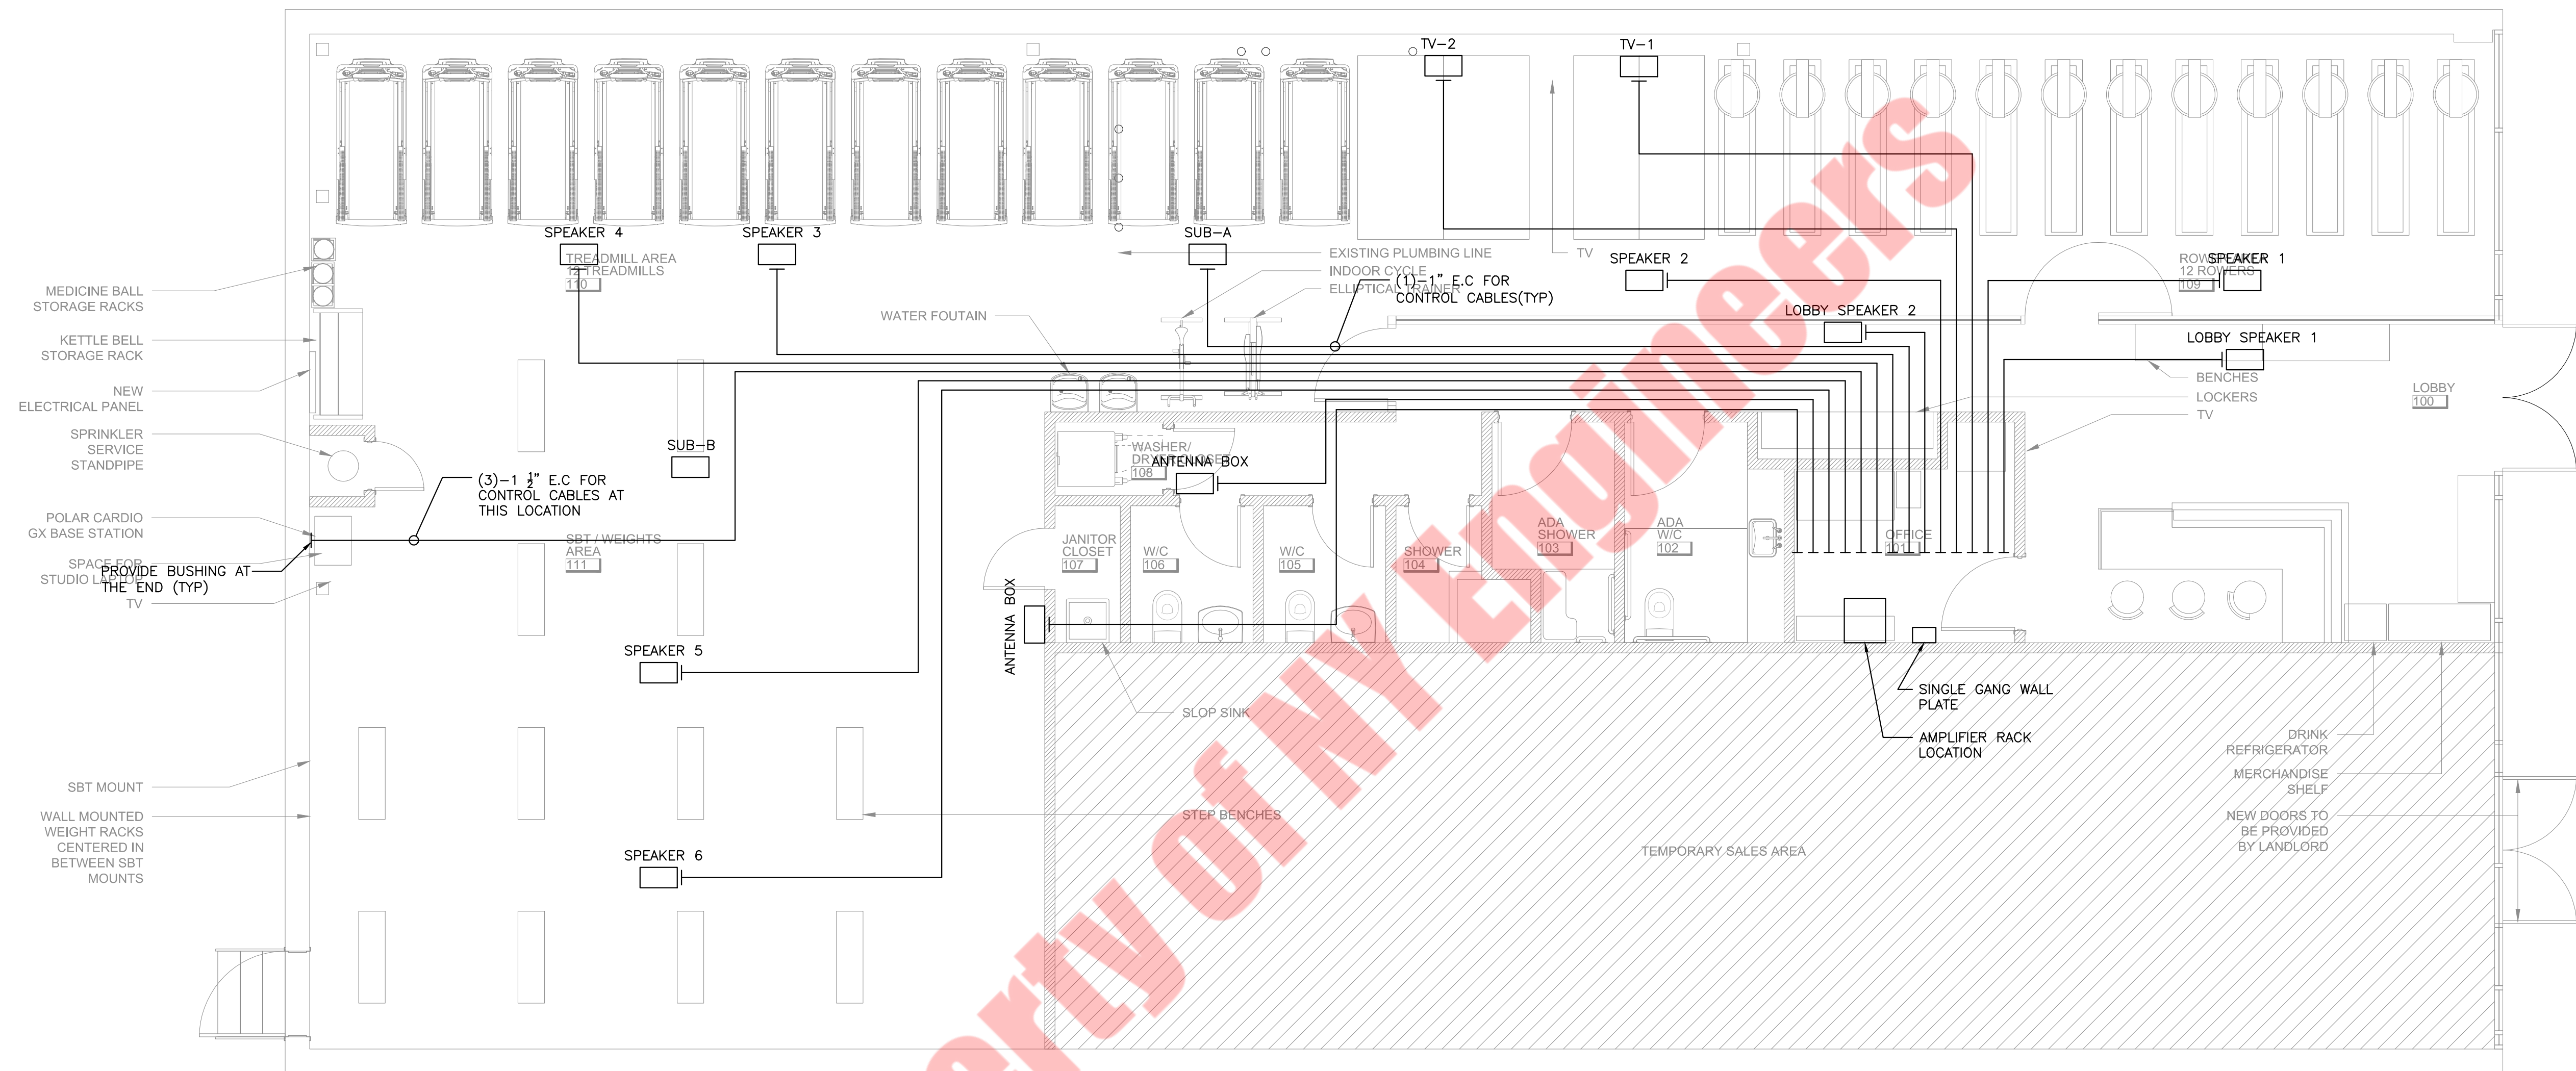


- MEDICINE BALL STORAGE RACKS
- KETTLE BELL STORAGE RACK
- NEW ELECTRICAL PANEL
- SPRINKLER SERVICE STANDPIPE
- POLAR CARDIO GX BASE STATION
- SPACE FOR STUDIO LIGHTS
- PROVIDE BUSHING AT THE END (TYP)
- SBT MOUNT
- WALL MOUNTED WEIGHT RACKS CENTERED IN BETWEEN SBT MOUNTS


**GENERAL NOTE:**  
 ALL EMPTY CONDUIT WORK SHOWN ON THIS PLAN IS FOR REFERENCE ONLY. REFER TO MUSIC ARTS ENTERPRISES DRAWINGS AND SPECIFICATIONS FOR EXACT SIZES, QUANTITIES AND ROUTING OF ALL EMPTY CONDUIT WORK. REQUIRED FOR AUDIO & TV SYSTEM.

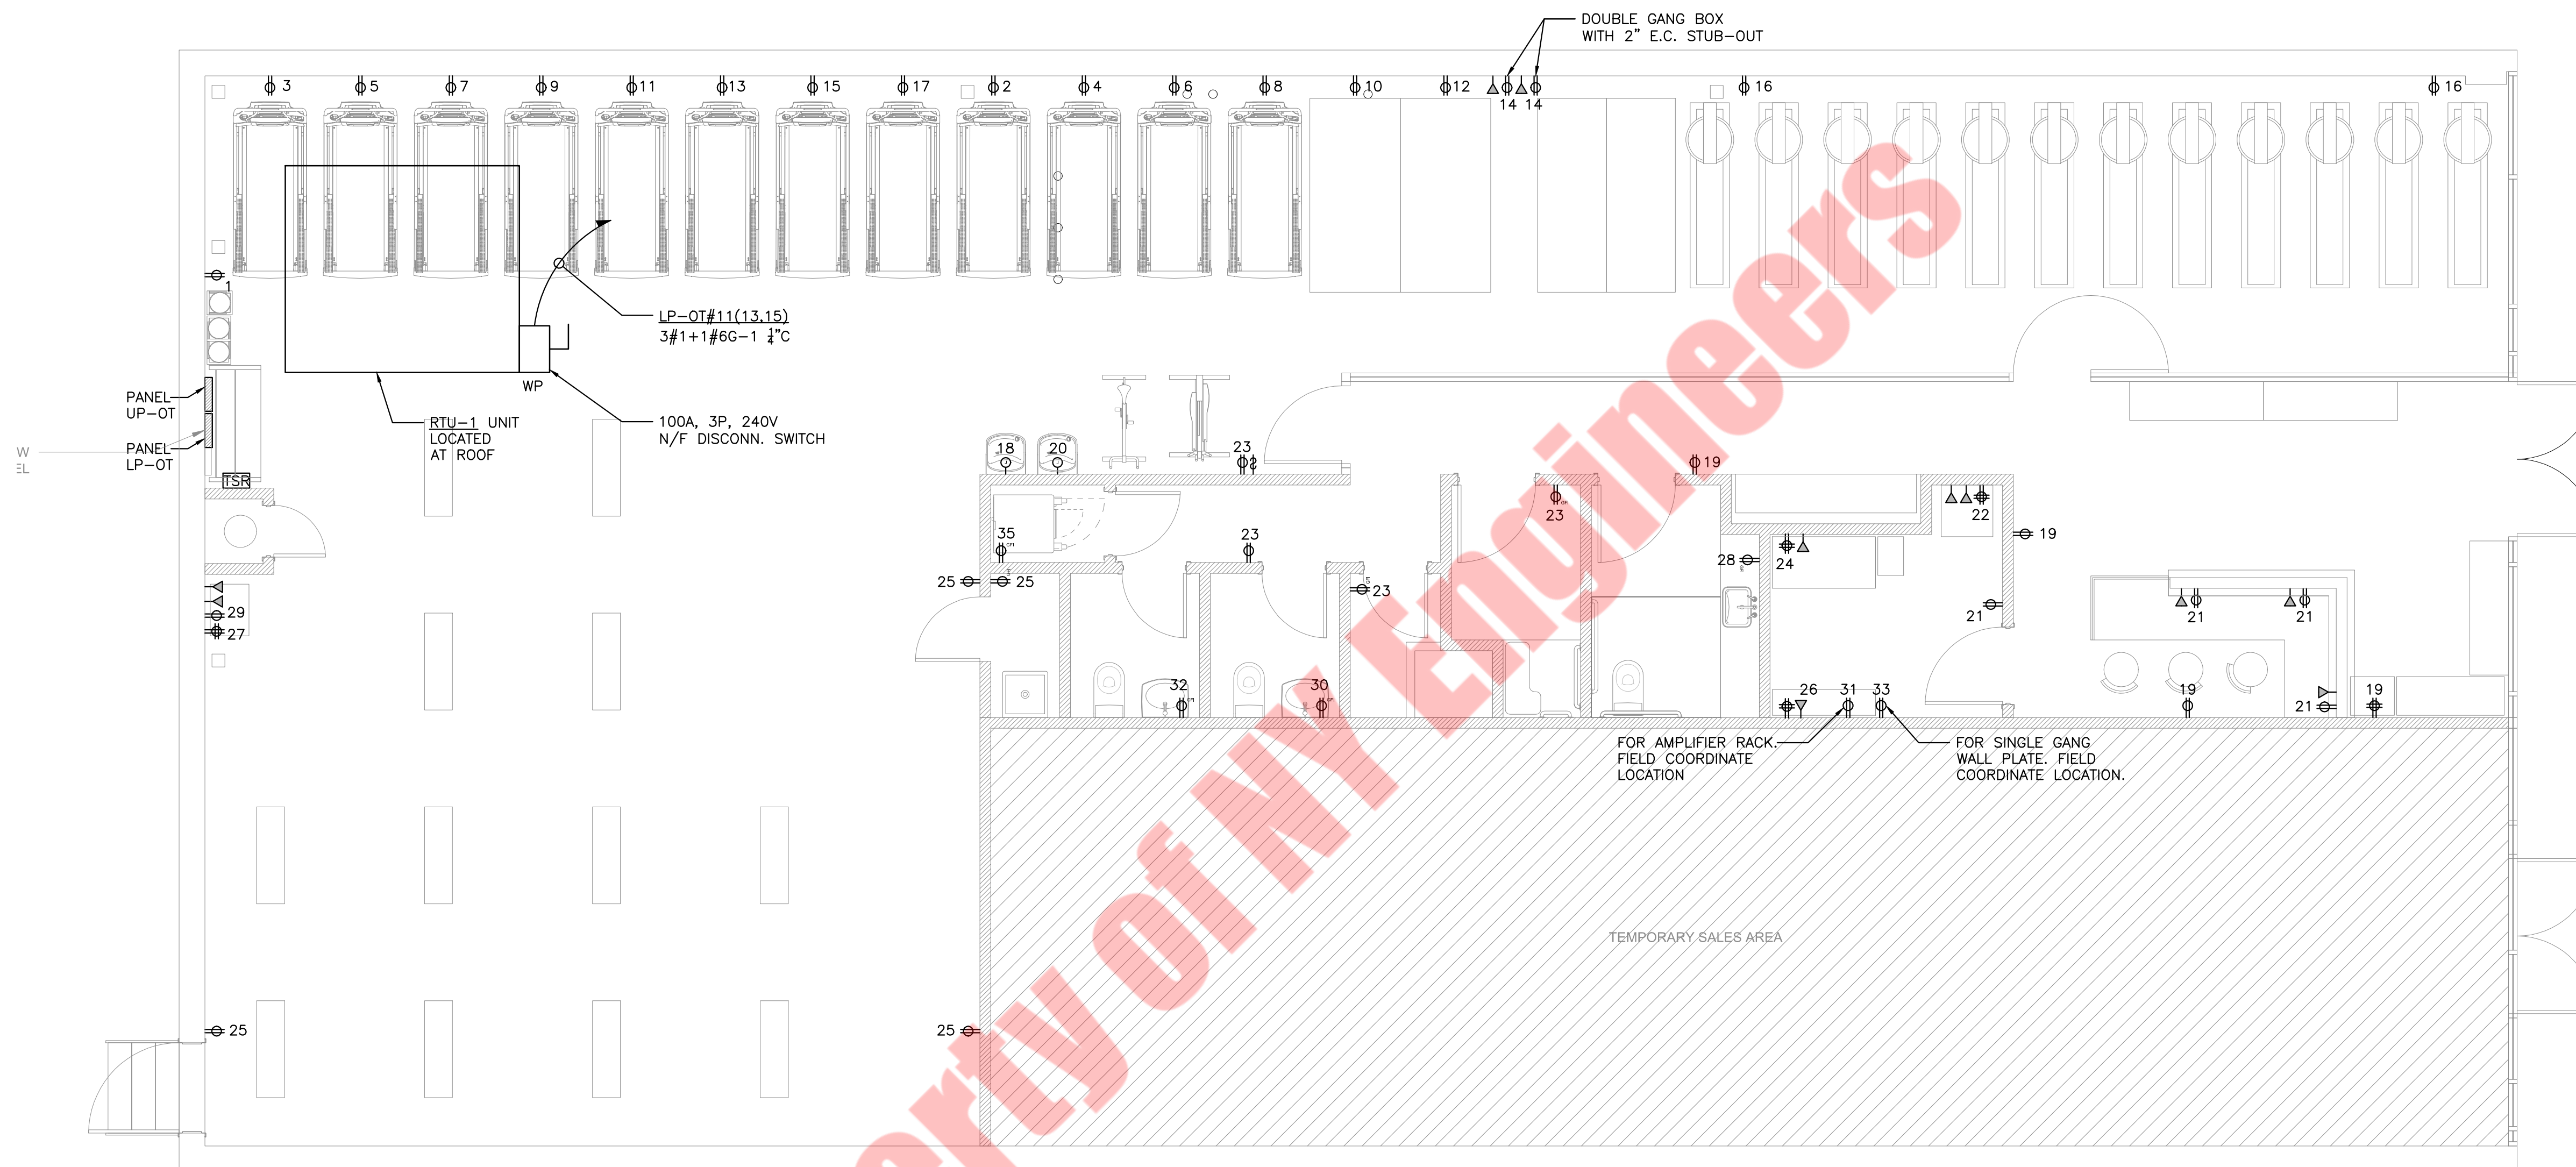


GENERAL NOTE:  
 ALL POWER RECEPTACLES SHOWN ON THIS PLAN SHALL  
 ORIGINATE FROM PANEL UP-OT, U.O.N.

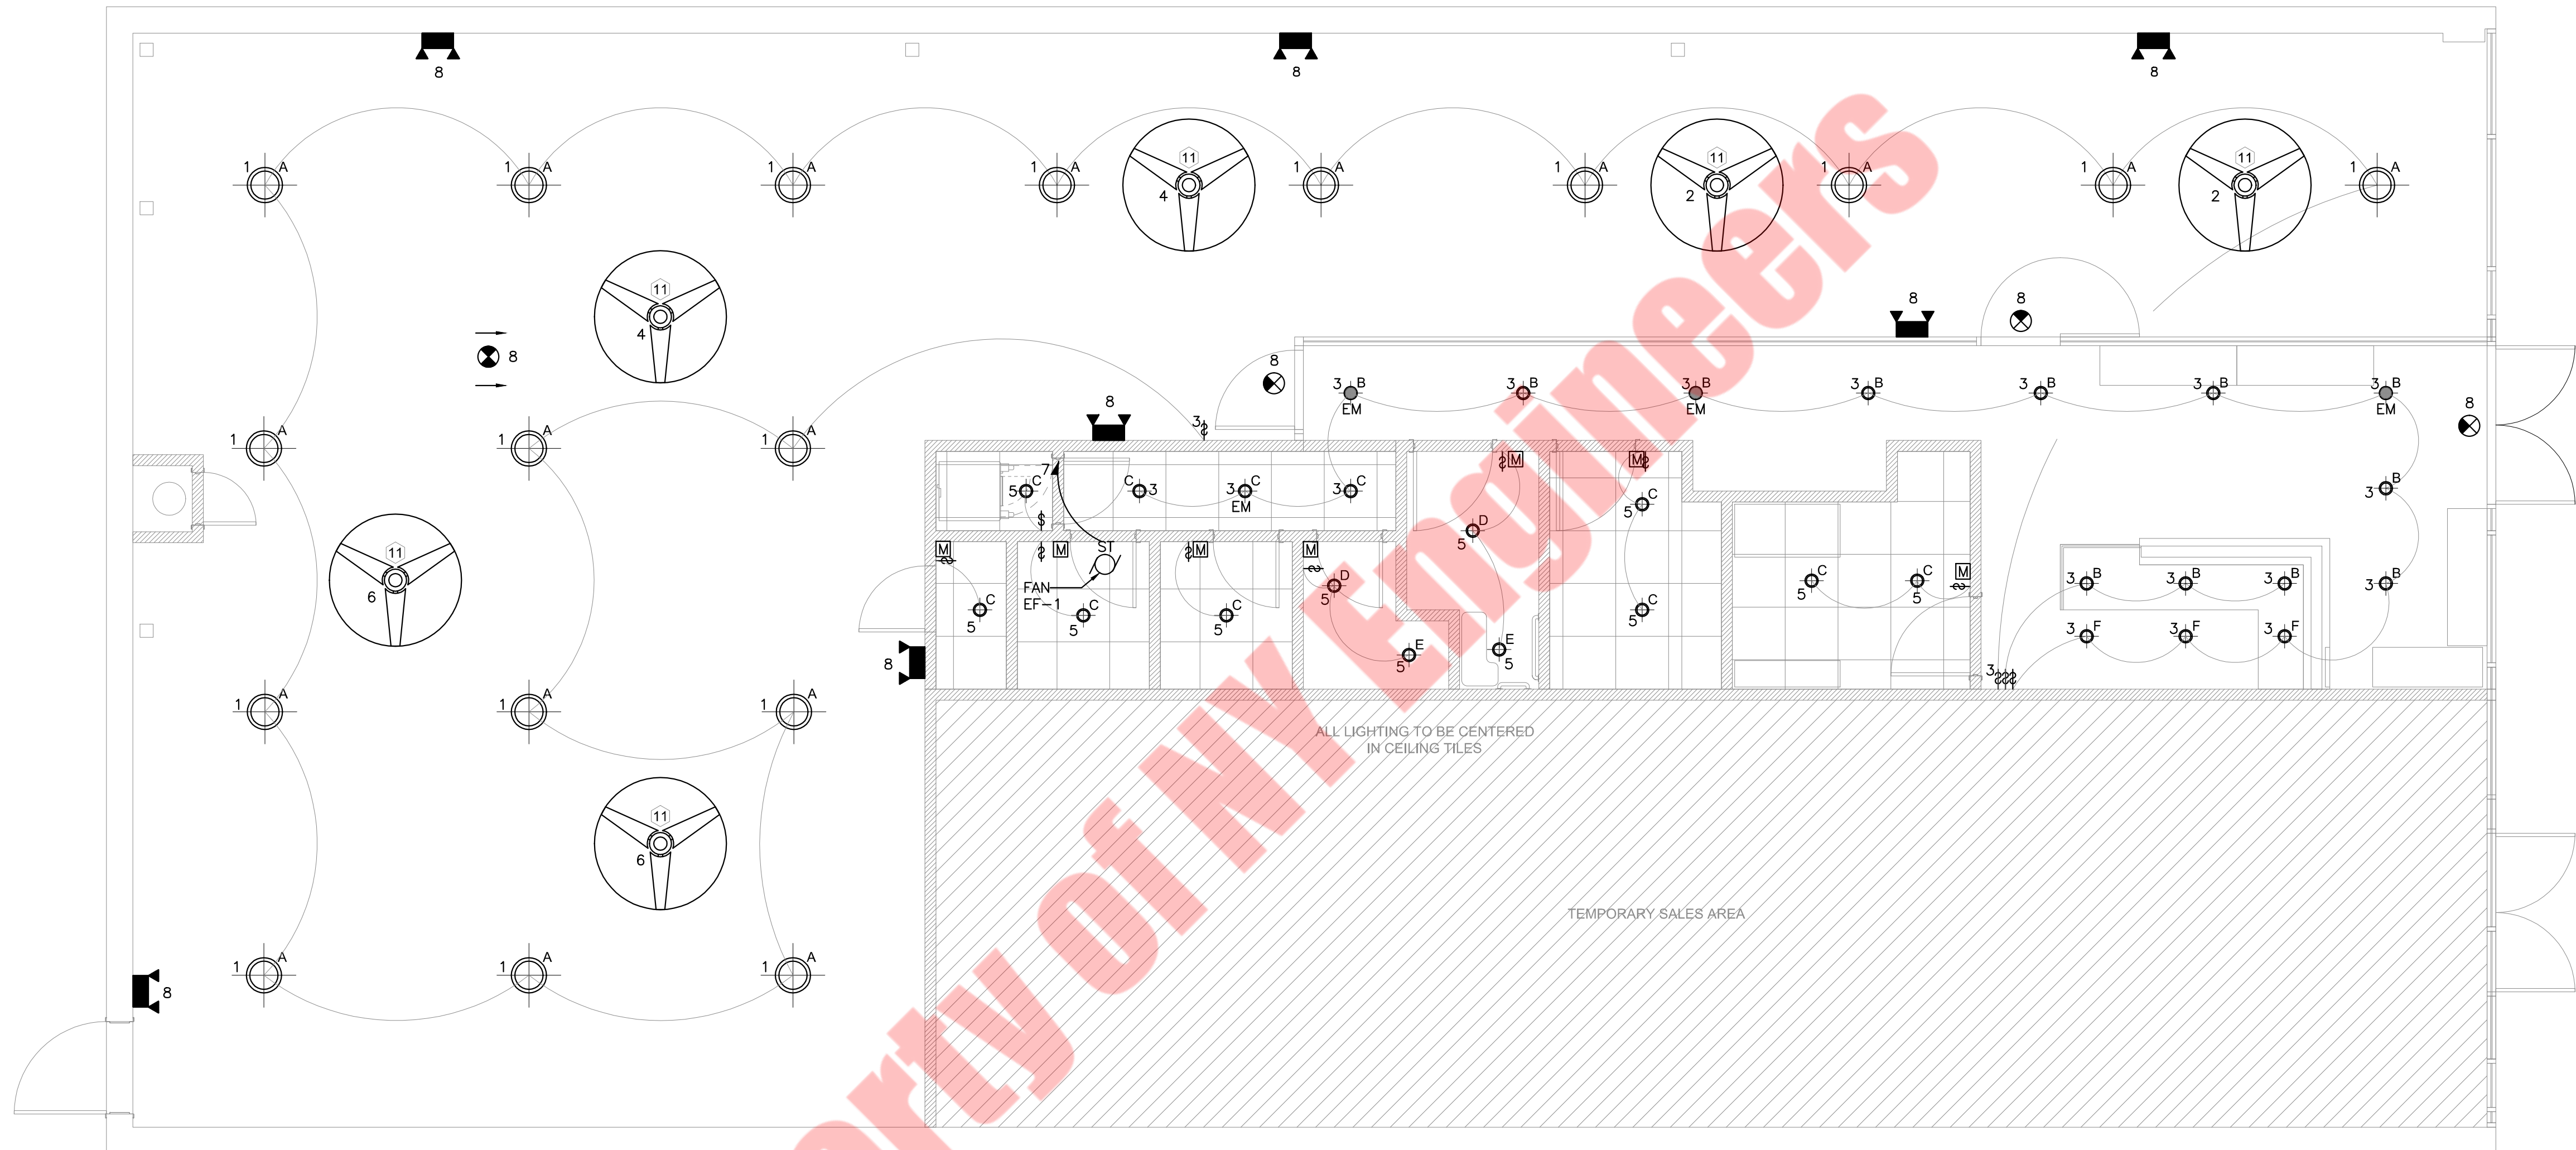

GENERAL NOTE:  
 ALL LIGHTING SHOWN ON THIS PLAN SHALL ORIGINATE FROM  
 PANEL LP-0T, U.O.N.

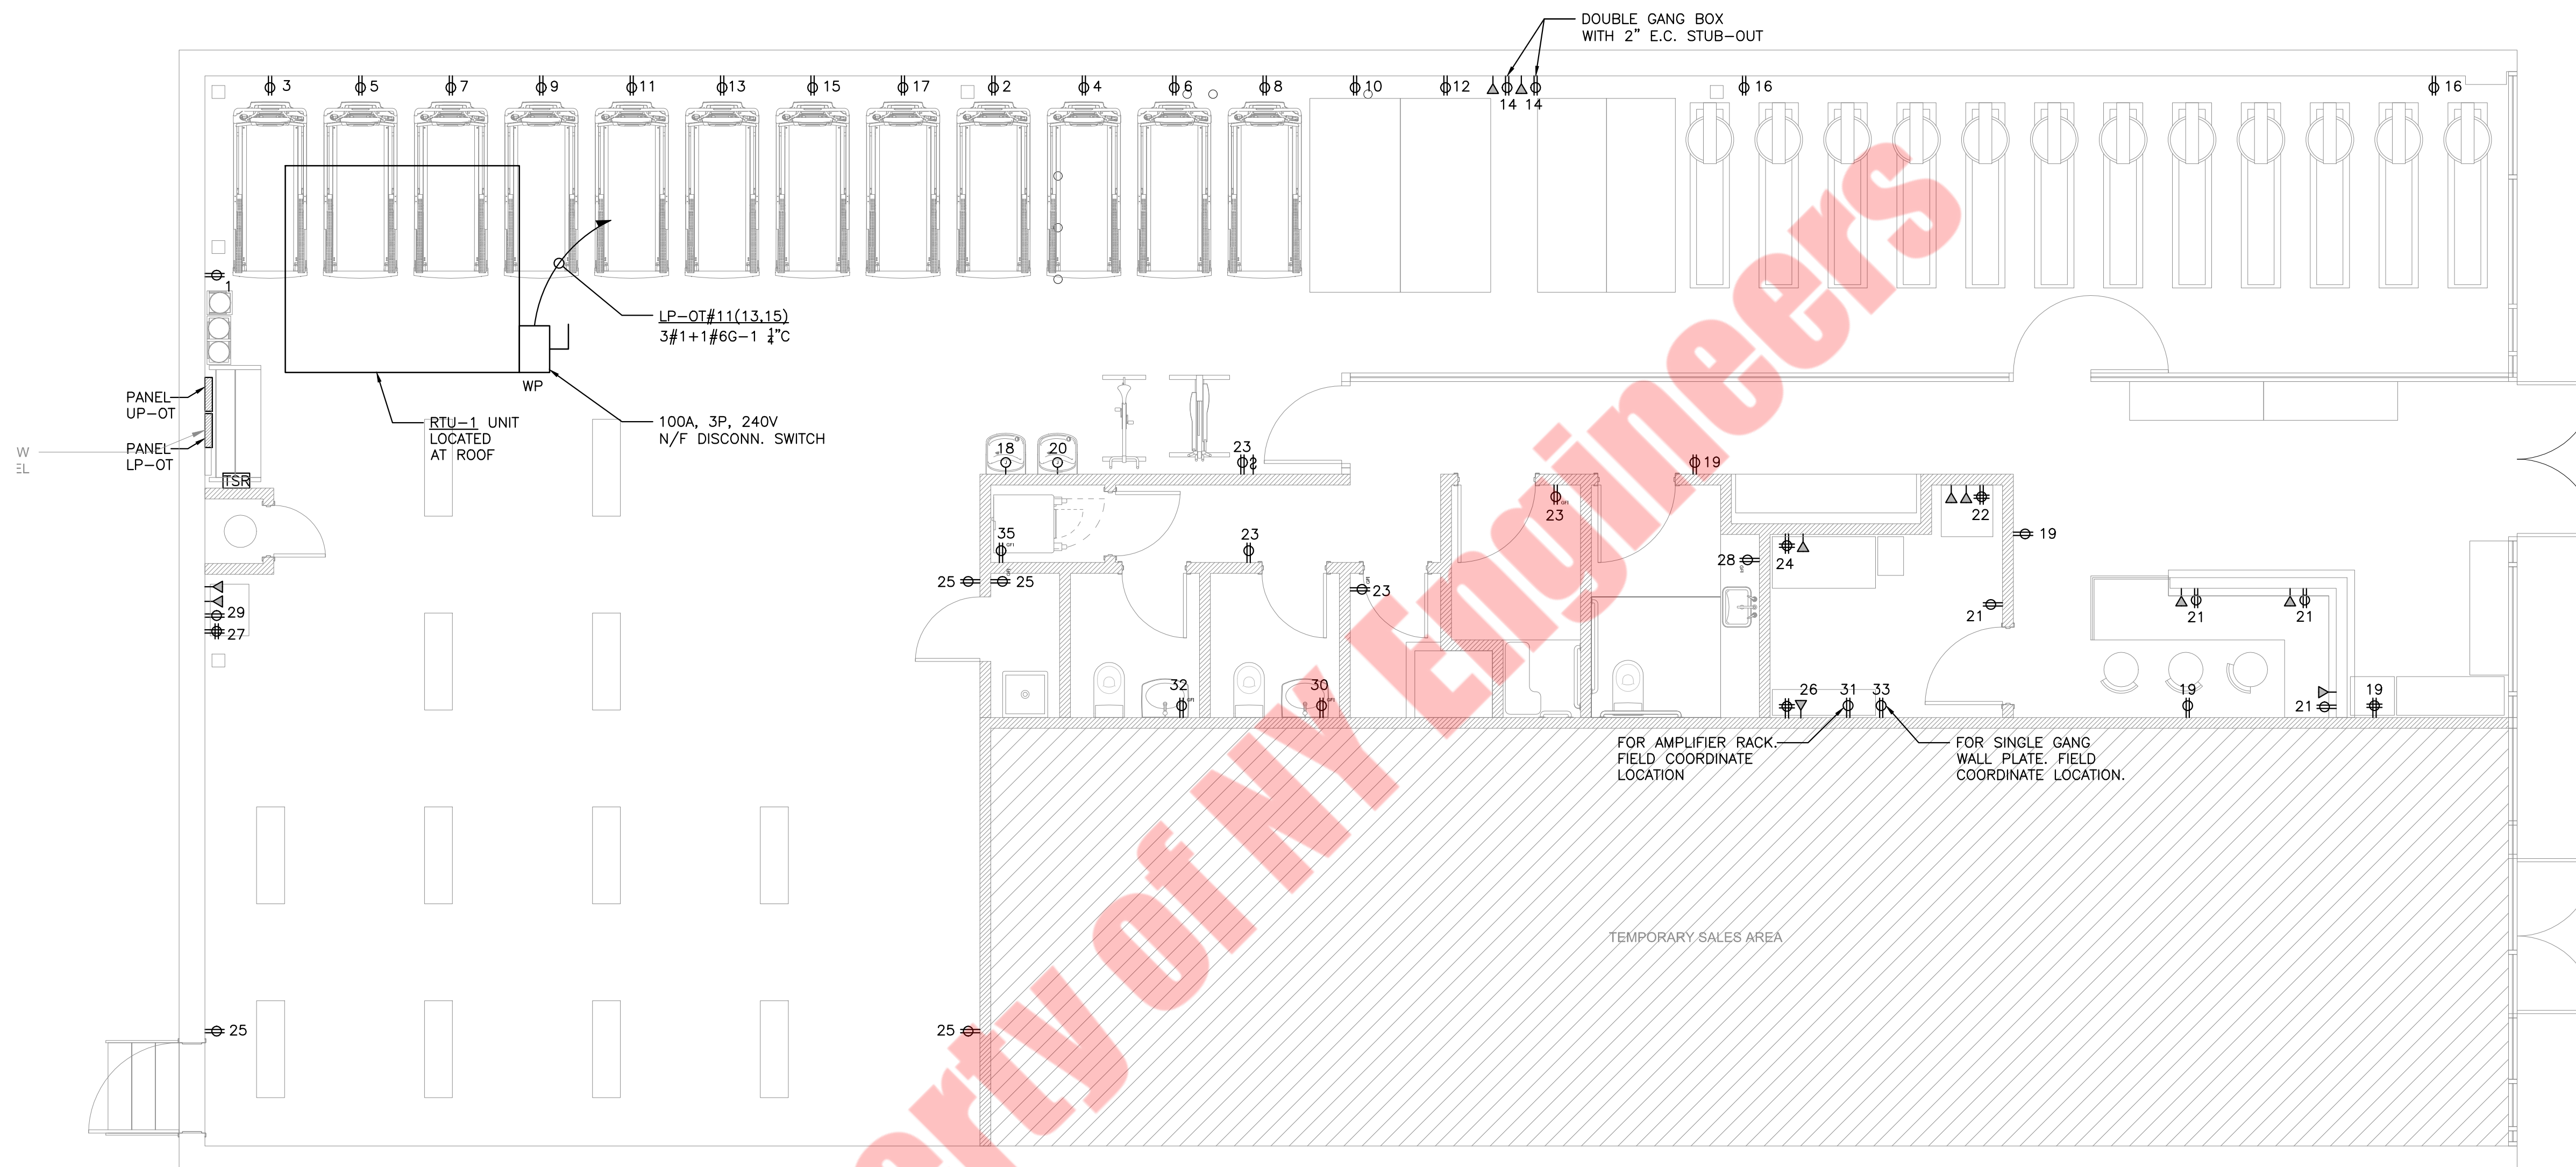

GENERAL NOTE:  
ALL POWER RECEPTACLES SHOWN ON THIS PLAN SHALL  
ORIGINATE FROM PANEL UP-OT, U.O.N.

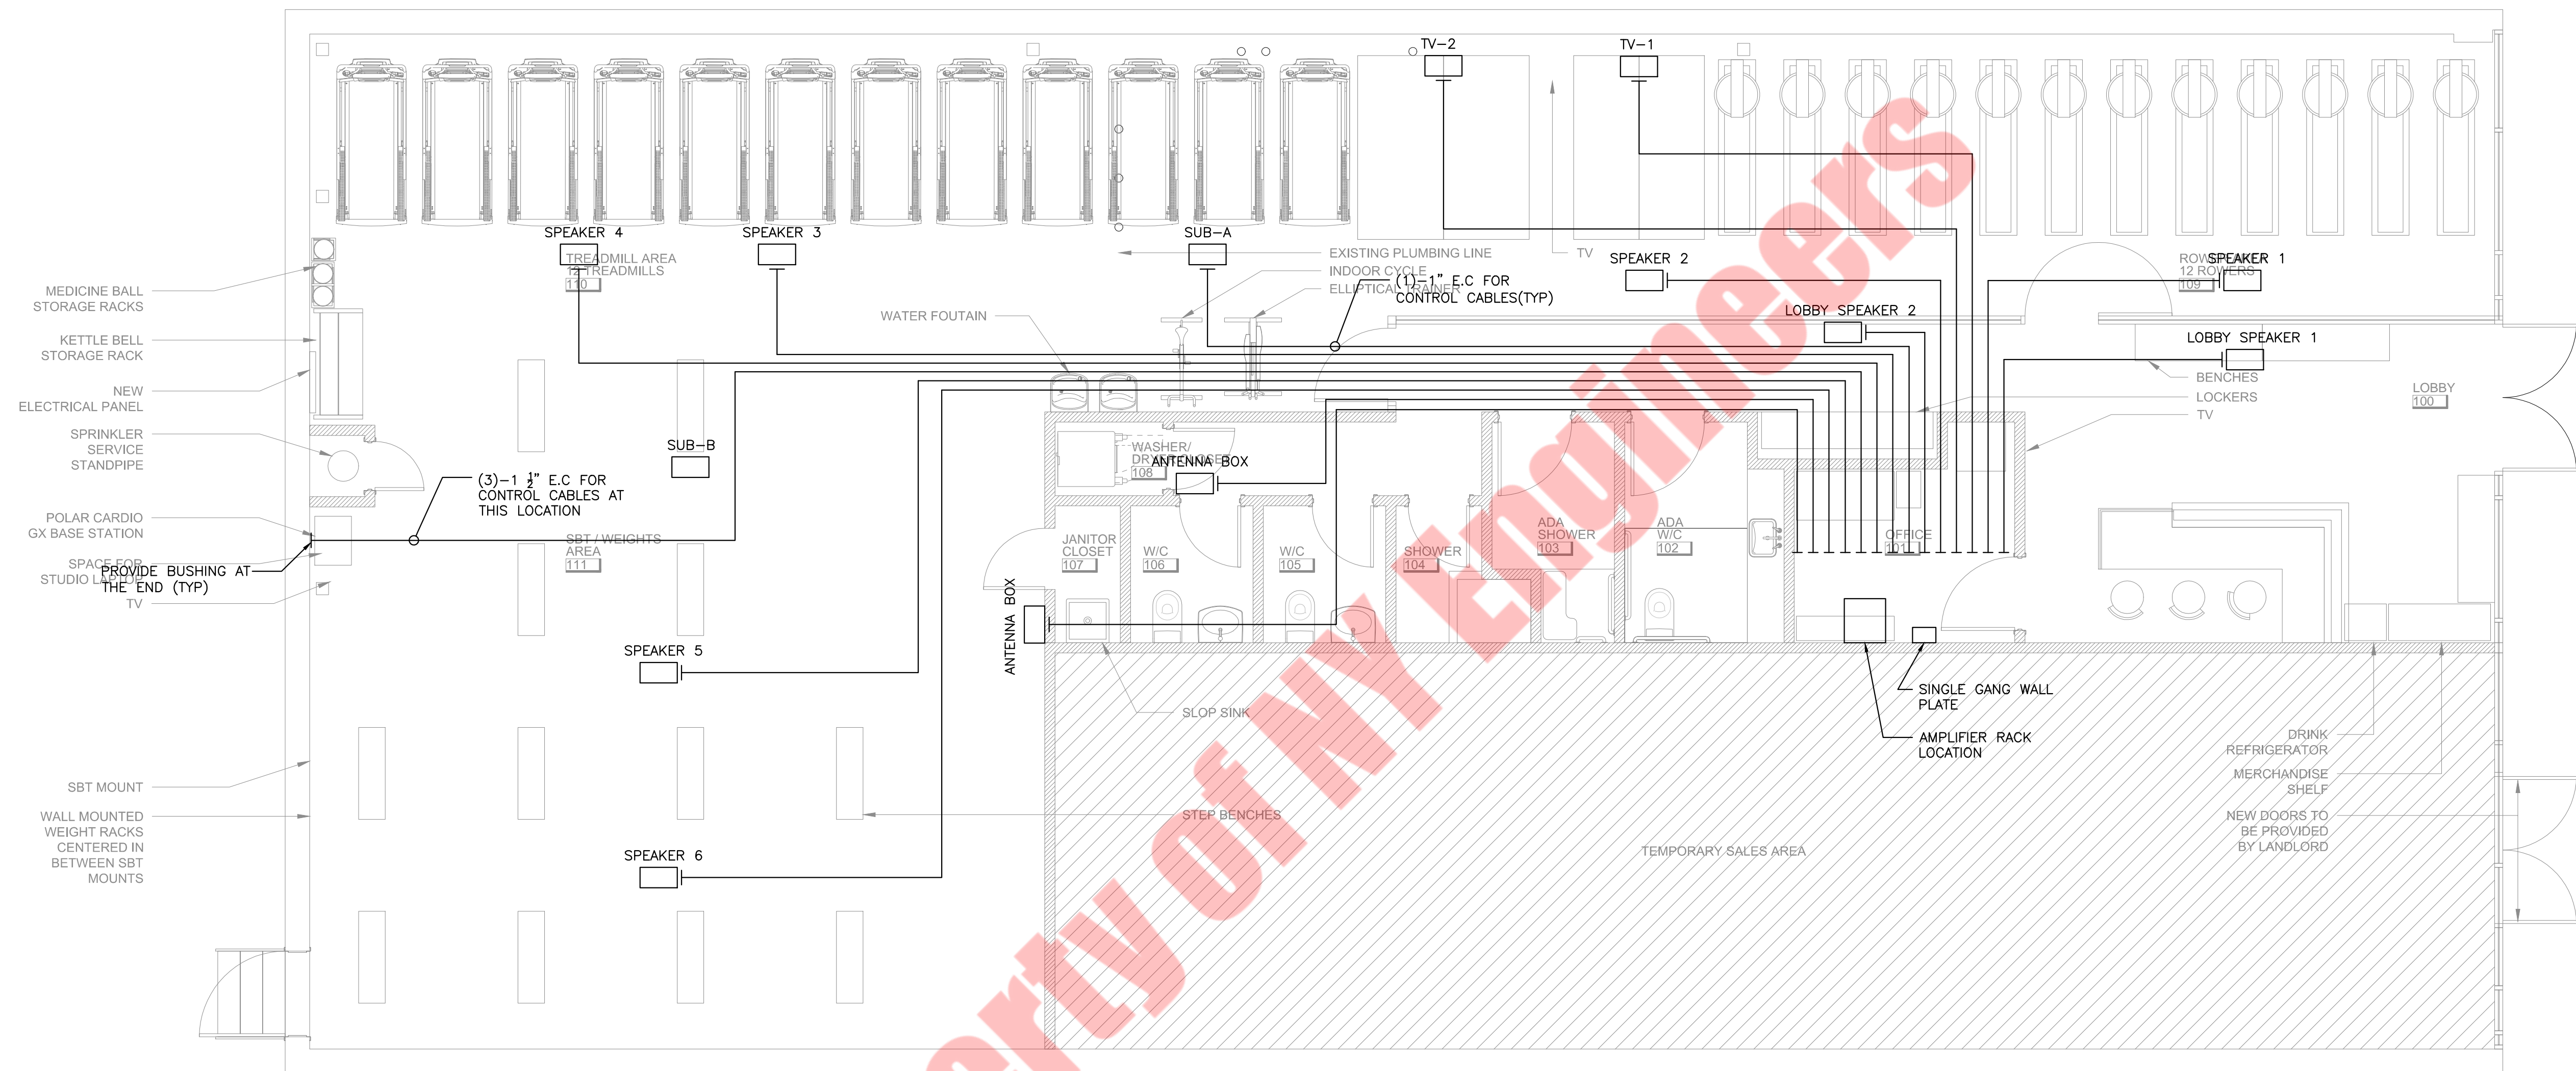

**GENERAL NOTE:**  
 ALL EMPTY CONDUIT WORK SHOWN ON THIS PLAN IS FOR REFERENCE ONLY. REFER TO MUSIC ARTS ENTERPRISES DRAWINGS AND SPECIFICATIONS FOR EXACT SIZES, QUANTITIES AND ROUTING OF ALL EMPTY CONDUIT WORK. REQUIRED FOR AUDIO & TV SYSTEM.

