



1 CELLAR FIRE ALARM PLAN

SCALE: 1/8" = 1'-0"

DRAWING NOTES:

- REFER TO DWG. FA-001.00 FOR FIRE ALARM SYMBOL LIST, ABBREVIATIONS. FA-002.00 FOR FIRE ALARM NOTES AND FA-004.00 FIRE ALARM RISER DIAGRAM.
- FINAL CONDUIT/CABLE ROUTING SHALL BE DETERMINED IN-FIELD, AND PRIOR TO THE COMMENCEMENT OF WORK, COORDINATED WITH OTHER TRADE CONTRACTORS AND THE OWNER.
- ELECTRICAL CONTRACTOR TO COORDINATE LOCATION OF FACP WITH THE ARCHITECT/OWNER.



1 GROUND FLOOR FIRE ALARM PLAN
SCALE: 1/8" = 1'-0"

DRAWING NOTES:

1. REFER TO DWG. FA-001.00 FOR FIRE ALARM SYMBOL LIST, ABBREVIATIONS, FA-002.00 FOR FIRE ALARM NOTES AND FA-004.00 FIRE ALARM RISER DIAGRAM.
2. FINAL CONDUIT/CABLE ROUTING SHALL BE DETERMINED IN-FIELD, AND PRIOR TO THE COMMENCEMENT OF WORK, COORDINATED WITH OTHER TRADE CONTRACTORS AND THE OWNER.
3. ELECTRICAL CONTRACTOR TO COORDINATE LOCATION OF FACP WITH THE ARCHITECT/OWNER.



1 2ND FLOOR FIRE ALARM PLAN
SCALE: 1/8" = 1'-0"


DRAWING NOTES:

1. REFER TO DWG. FA-001.00 FOR FIRE ALARM SYMBOL LIST, ABBREVIATIONS, FA-002.00 FOR FIRE ALARM NOTES AND FA-004.00 FIRE ALARM RISER DIAGRAM.
2. FINAL CONDUIT/CABLE ROUTING SHALL BE DETERMINED IN-FIELD, AND PRIOR TO THE COMMENCEMENT OF WORK, COORDINATED WITH OTHER TRADE CONTRACTORS AND THE OWNER.
3. ELECTRICAL CONTRACTOR TO COORDINATE LOCATION OF FACP WITH THE ARCHITECT/OWNER.



1 3RD FLOOR FIRE ALARM PLAN
SCALE: 1/8" = 1'-0"

- DRAWING NOTES:**
1. REFER TO DWG. FA-001.00 FOR FIRE ALARM SYMBOL LIST, ABBREVIATIONS, FA-002.00 FOR FIRE ALARM NOTES AND FA-004.00 FIRE ALARM RISER DIAGRAM.
 2. FINAL CONDUIT/CABLE ROUTING SHALL BE DETERMINED IN-FIELD, AND PRIOR TO THE COMMENCEMENT OF WORK, COORDINATED WITH OTHER TRADE CONTRACTORS AND THE OWNER.
 3. ELECTRICAL CONTRACTOR TO COORDINATE LOCATION OF FACP WITH THE ARCHITECT/OWNER.

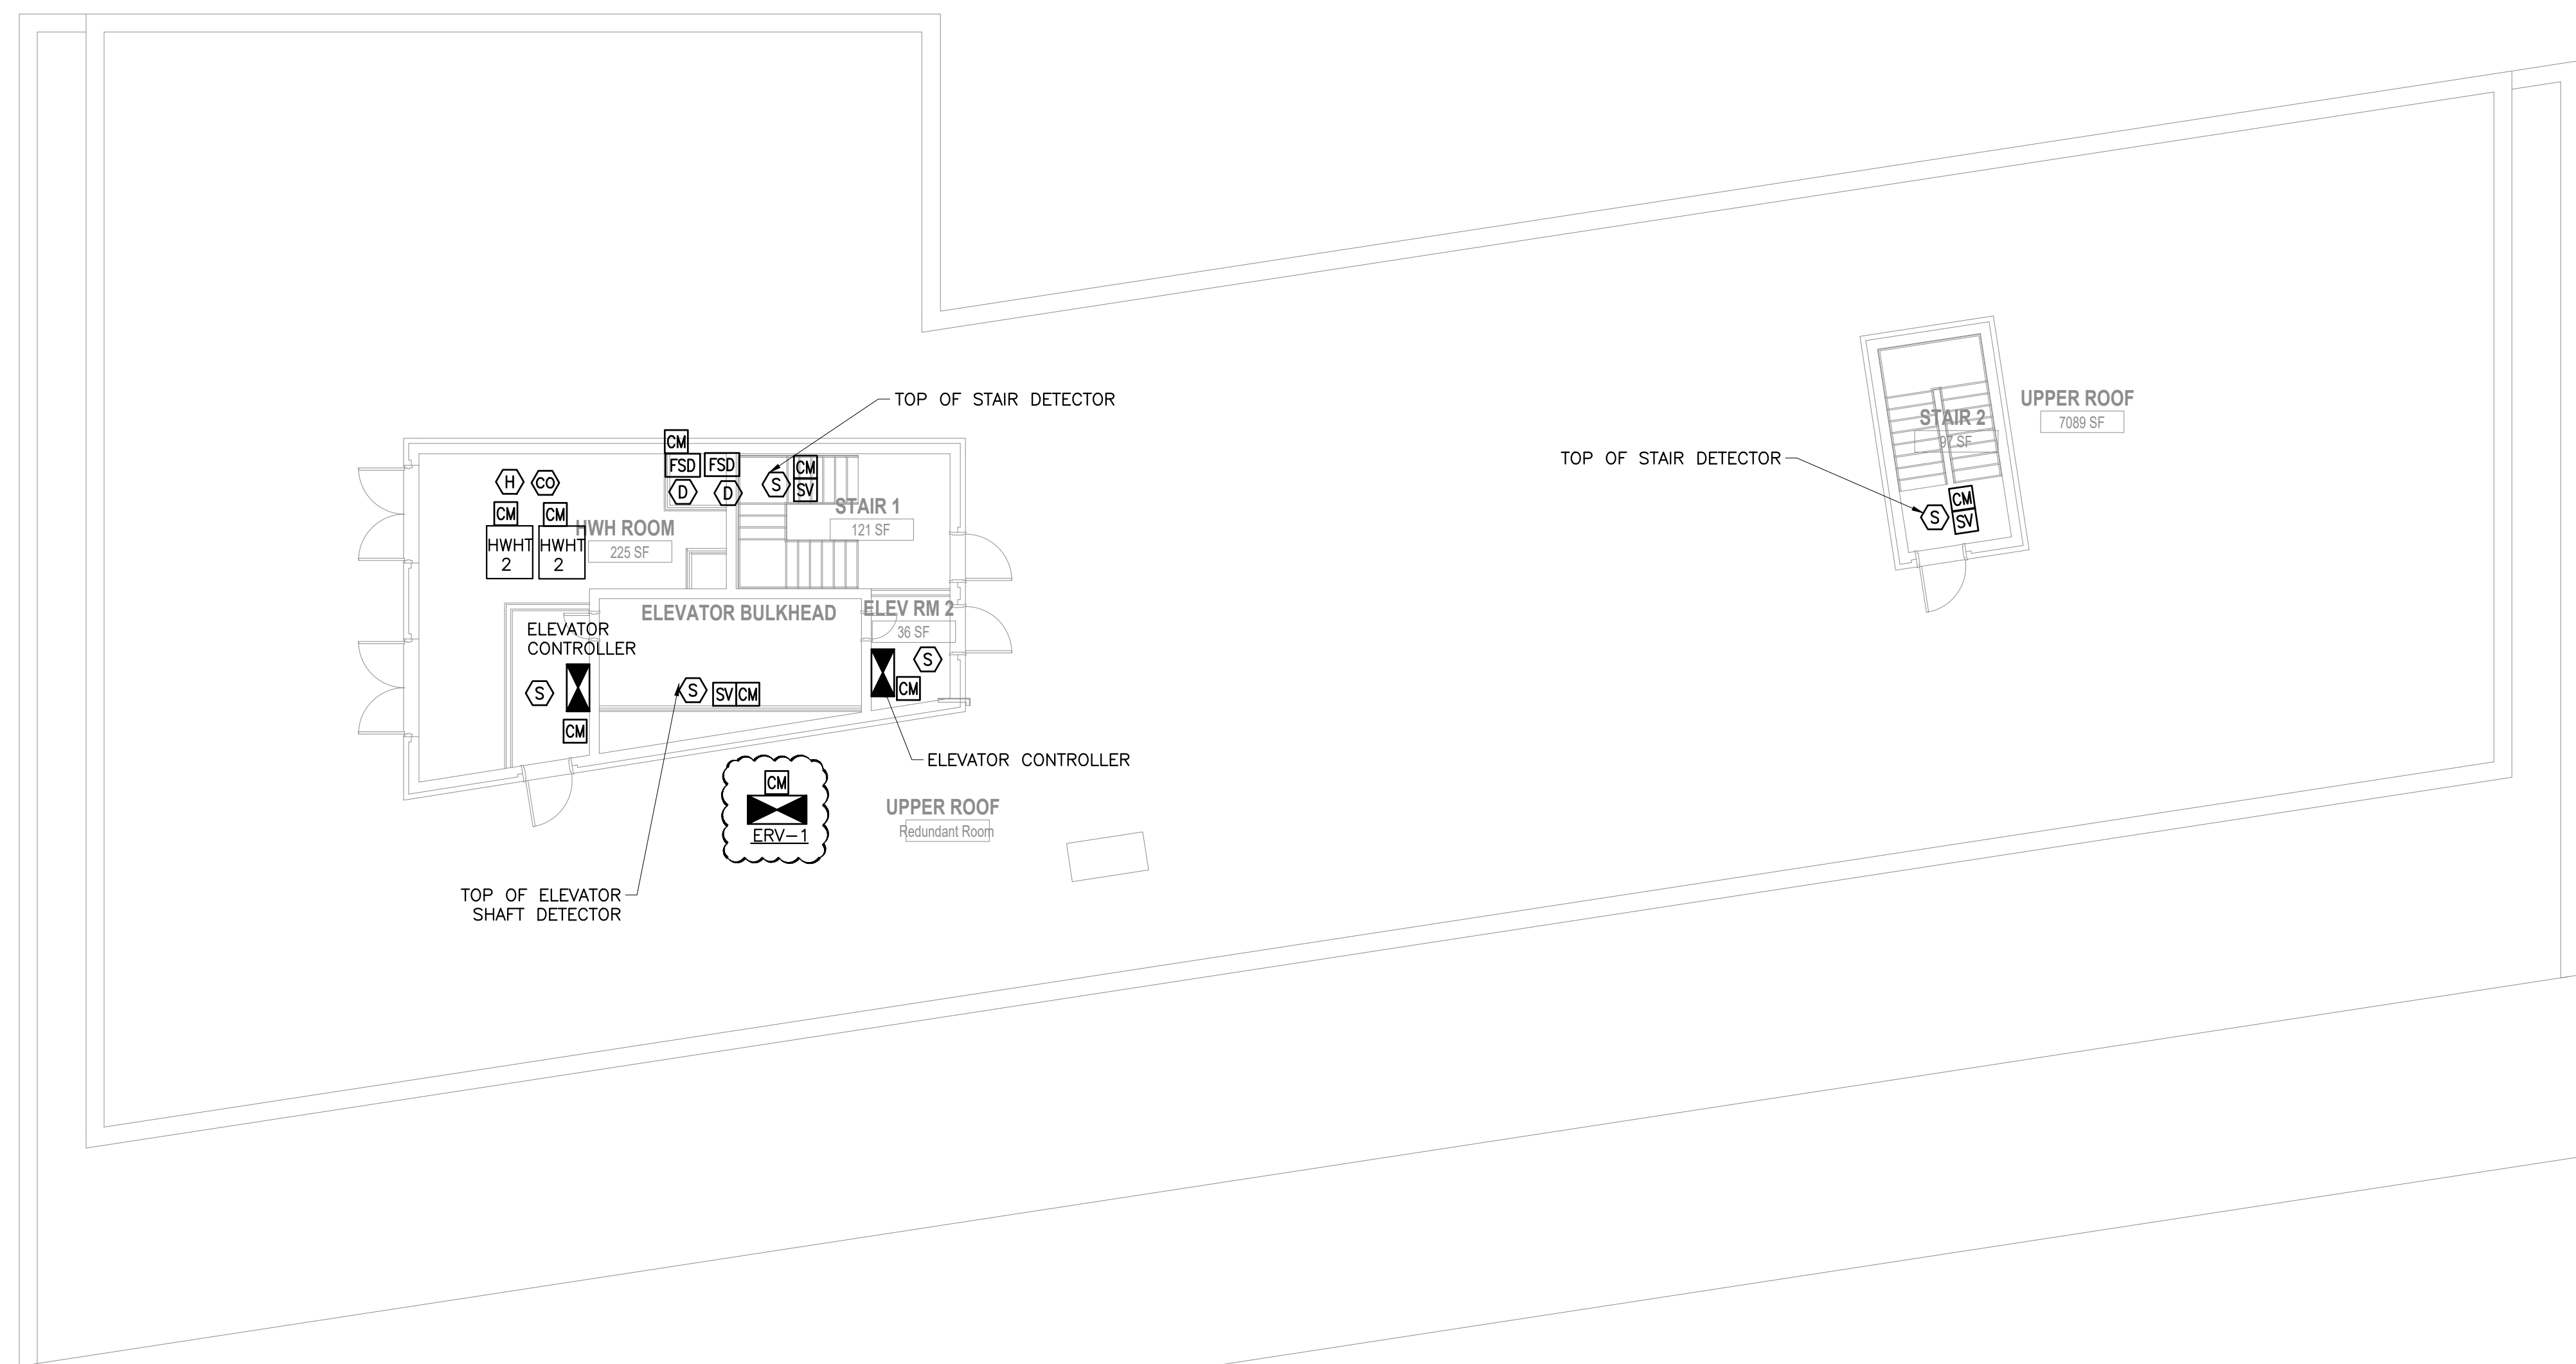

1 ROOF FIRE ALARM PLAN
SCALE: 1/8" = 1'-0"

DRAWING NOTES:

1. REFER TO DWG. FA-001.00 FOR FIRE ALARM SYMBOL LIST, ABBREVIATIONS, FA-002.00 FOR FIRE ALARM NOTES AND FA-004.00 FIRE ALARM RISER DIAGRAM.
2. FINAL CONDUIT/CABLE ROUTING SHALL BE DETERMINED IN-FIELD, AND PRIOR TO THE COMMENCEMENT OF WORK, COORDINATED WITH OTHER TRADE CONTRACTORS AND THE OWNER.
3. ELECTRICAL CONTRACTOR TO COORDINATE LOCATION OF FACP WITH THE ARCHITECT/OWNER.