




2 CELLAR FLOOR CORRIDOR
3/8" = 1'-0"

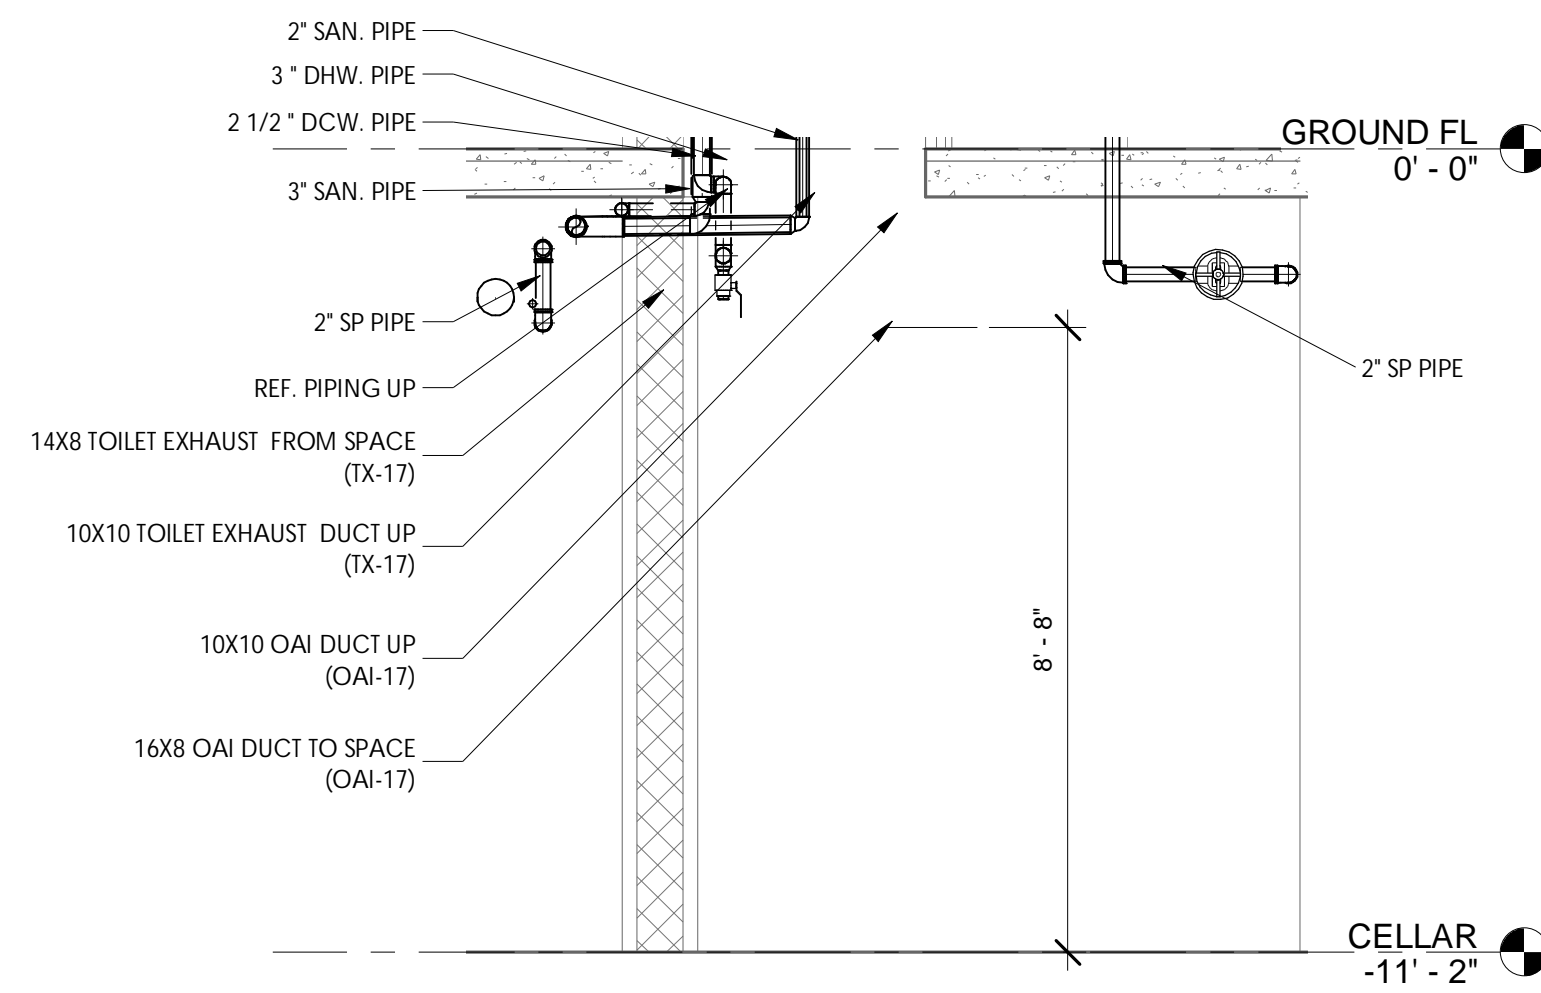

3 CELLAR FLOOR TRASH ROOM
3/8" = 1'-0"

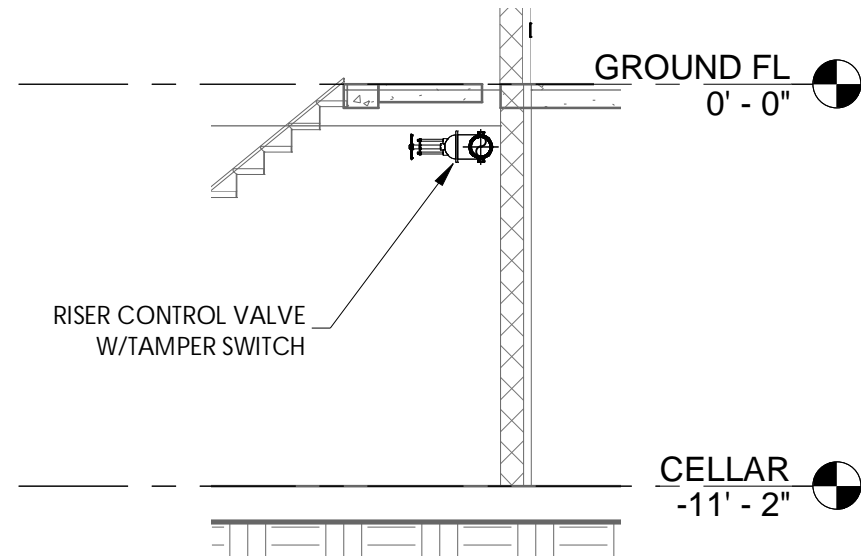

4 SECTION-RISER CONTROL VALVE
3/16" = 1'-0"

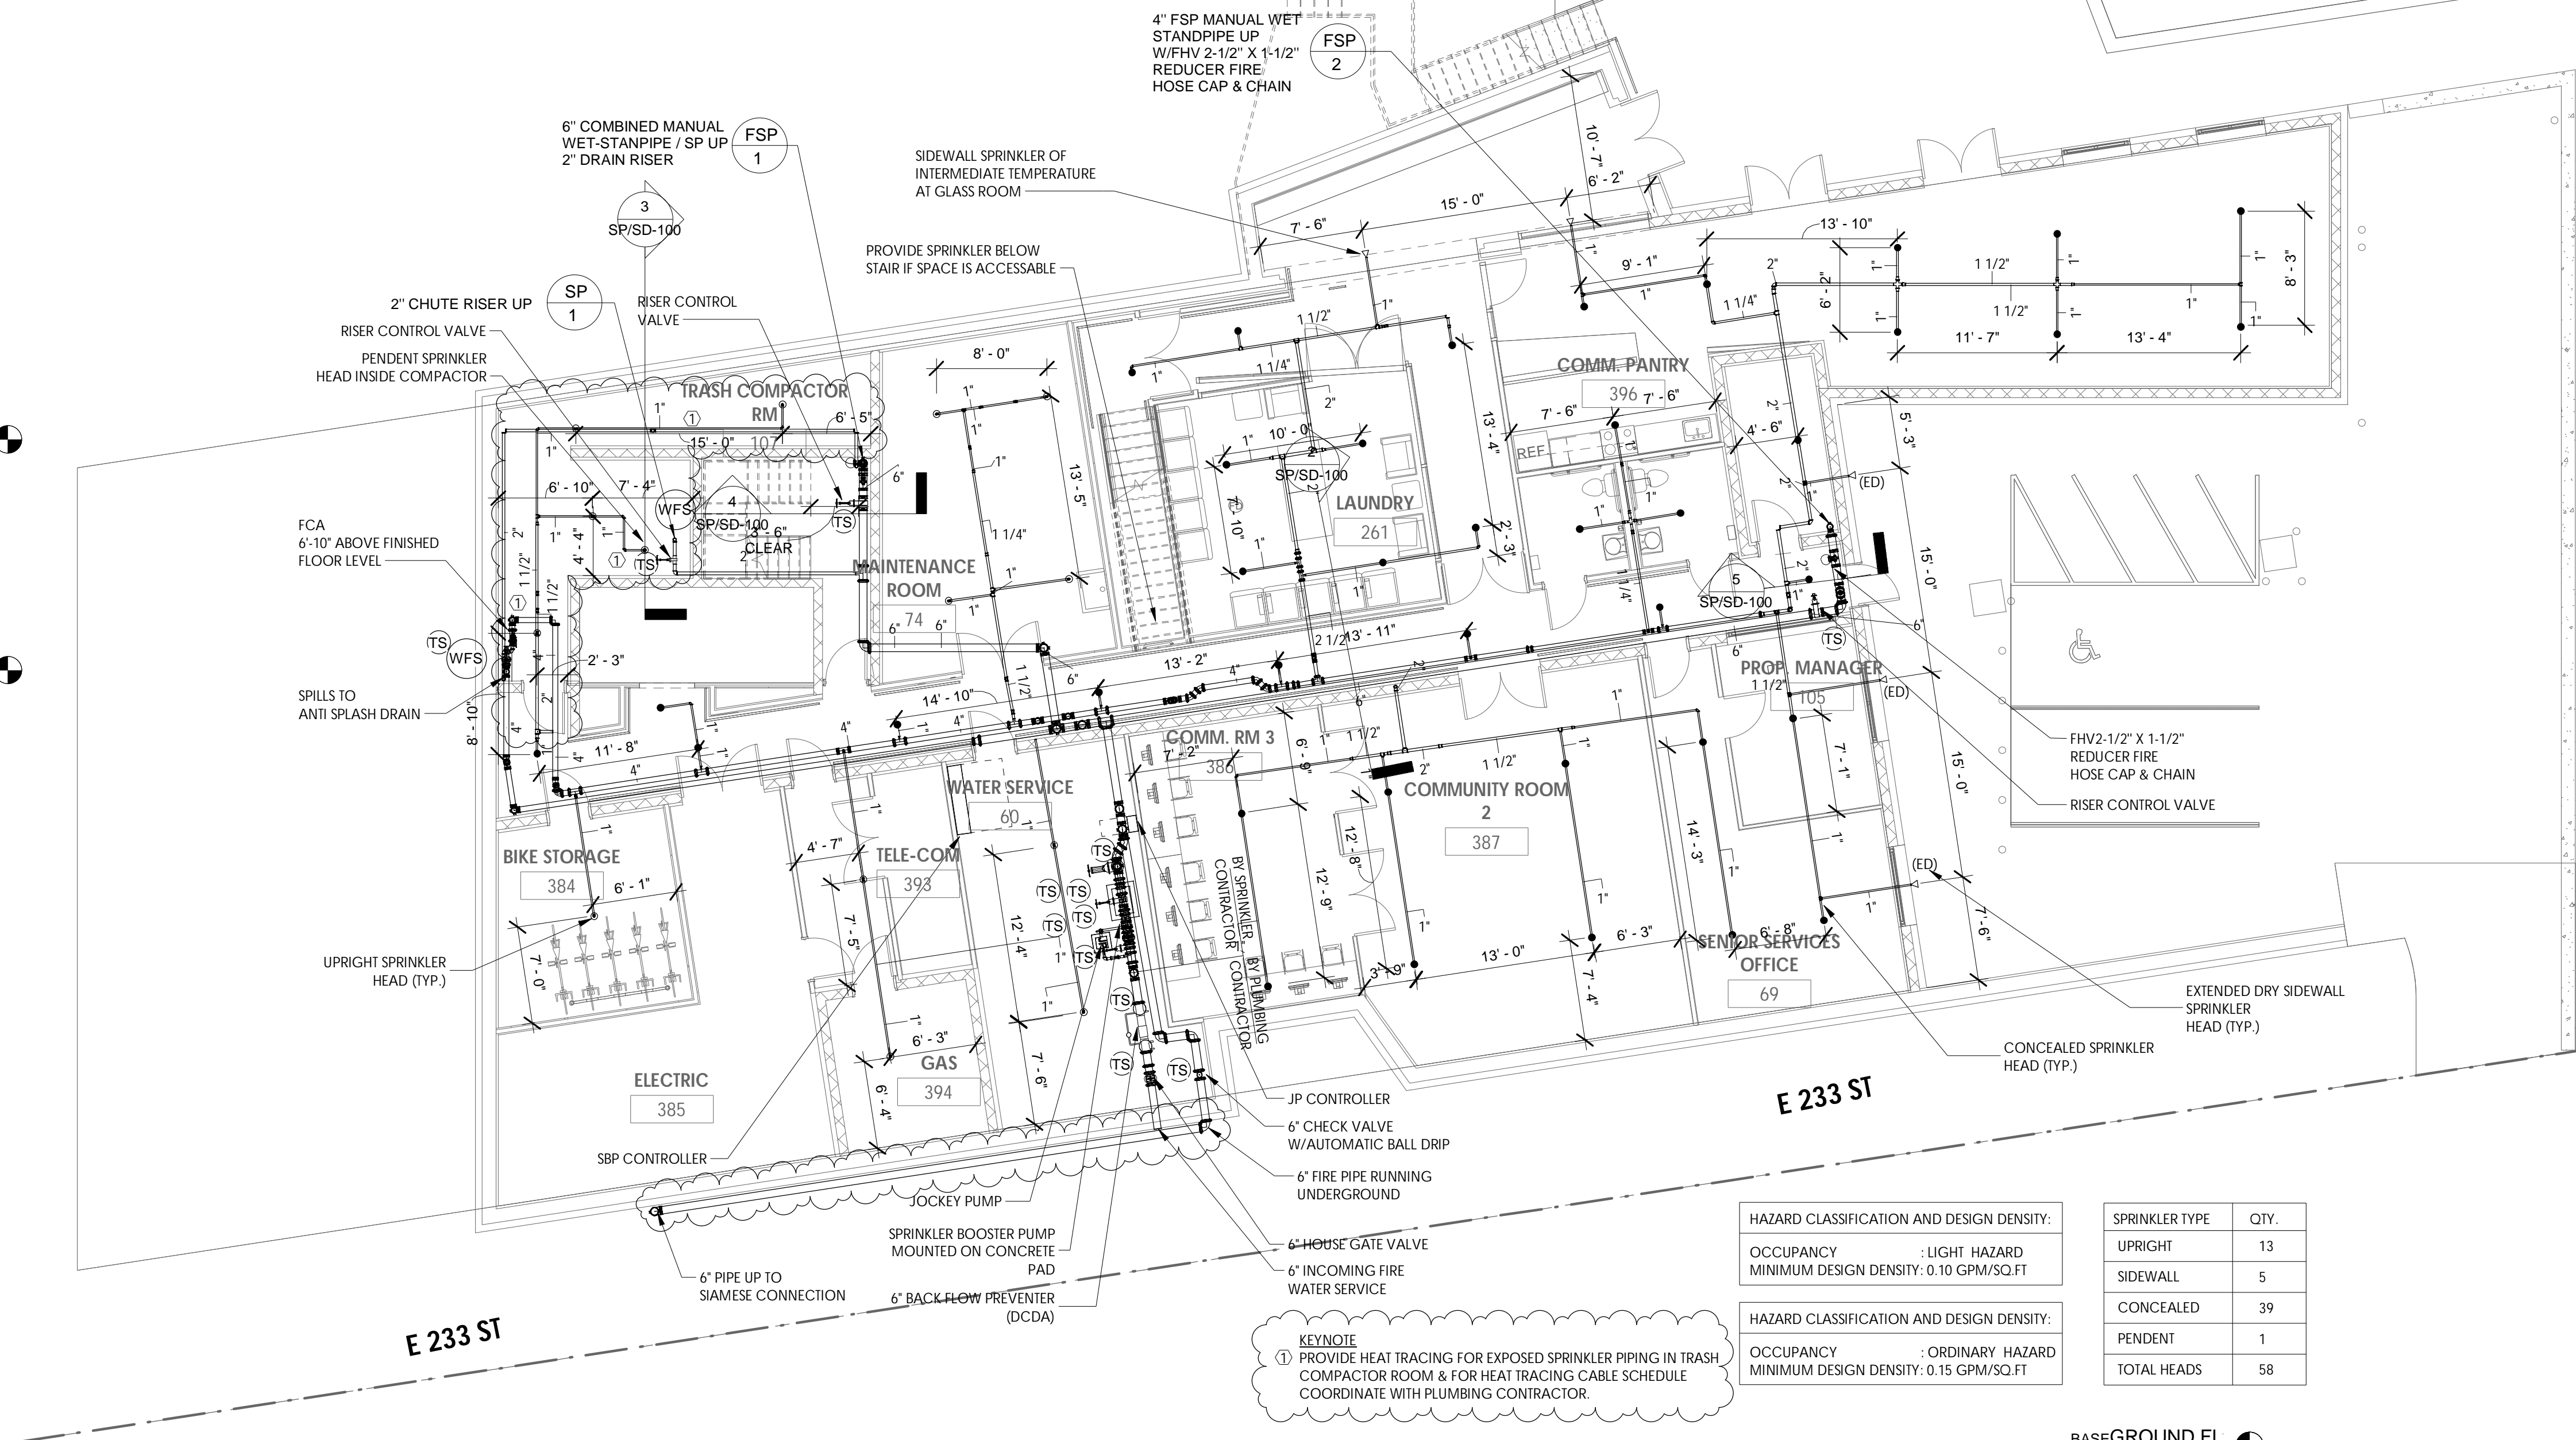

1 CELLAR SPRINKLER PLAN
1/8" = 1'-0"


KEYNOTE
1 PROVIDE HEAT TRACING FOR EXPOSED SPRINKLER PIPING IN TRASH COMPACTOR ROOM & FOR HEAT TRACING CABLE SCHEDULE COORDINATE WITH PLUMBING CONTRACTOR.

GENERAL NOTE:
1. ALL SPRINKLER HEADS MEET DESIGN CRITERIA PER COVERAGE.
2. FOR SPRINKLER AND STANDPIPE WORK ONLY.
3. TRADE CONTRACTORS TO PROVIDE ALL LOCATIONS OF REQUIRED ACCESS TO GENERAL CONTRACTOR. GENERAL CONTRACTOR TO COORDINATE WITH ARCHITECT ON ACCESS DOOR LOCATIONS AND INSTALL ACCESS DOORS.
4. ALL EXPOSED SPRINKLER PIPING IN UNITS TO BE PAINTED WHITE.


HAZARD CLASSIFICATION AND DESIGN DENSITY:	
OCCUPANCY	: LIGHT HAZARD
MINIMUM DESIGN DENSITY:	0.10 GPM/SQ.FT


SPRINKLER TYPE	QTY.
UPRIGHT	13
SIDEWALL	5
CONCEALED	39
PENDENT	1
TOTAL HEADS	58

HAZARD CLASSIFICATION AND DESIGN DENSITY:	
OCCUPANCY	: ORDINARY HAZARD
MINIMUM DESIGN DENSITY:	0.15 GPM/SQ.FT

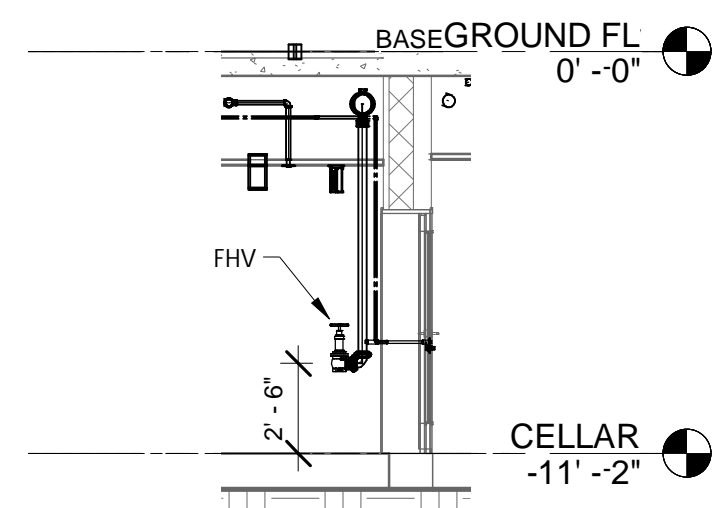

5 SECTION-FIRE HOSE VALVE
3/16" = 1'-0"

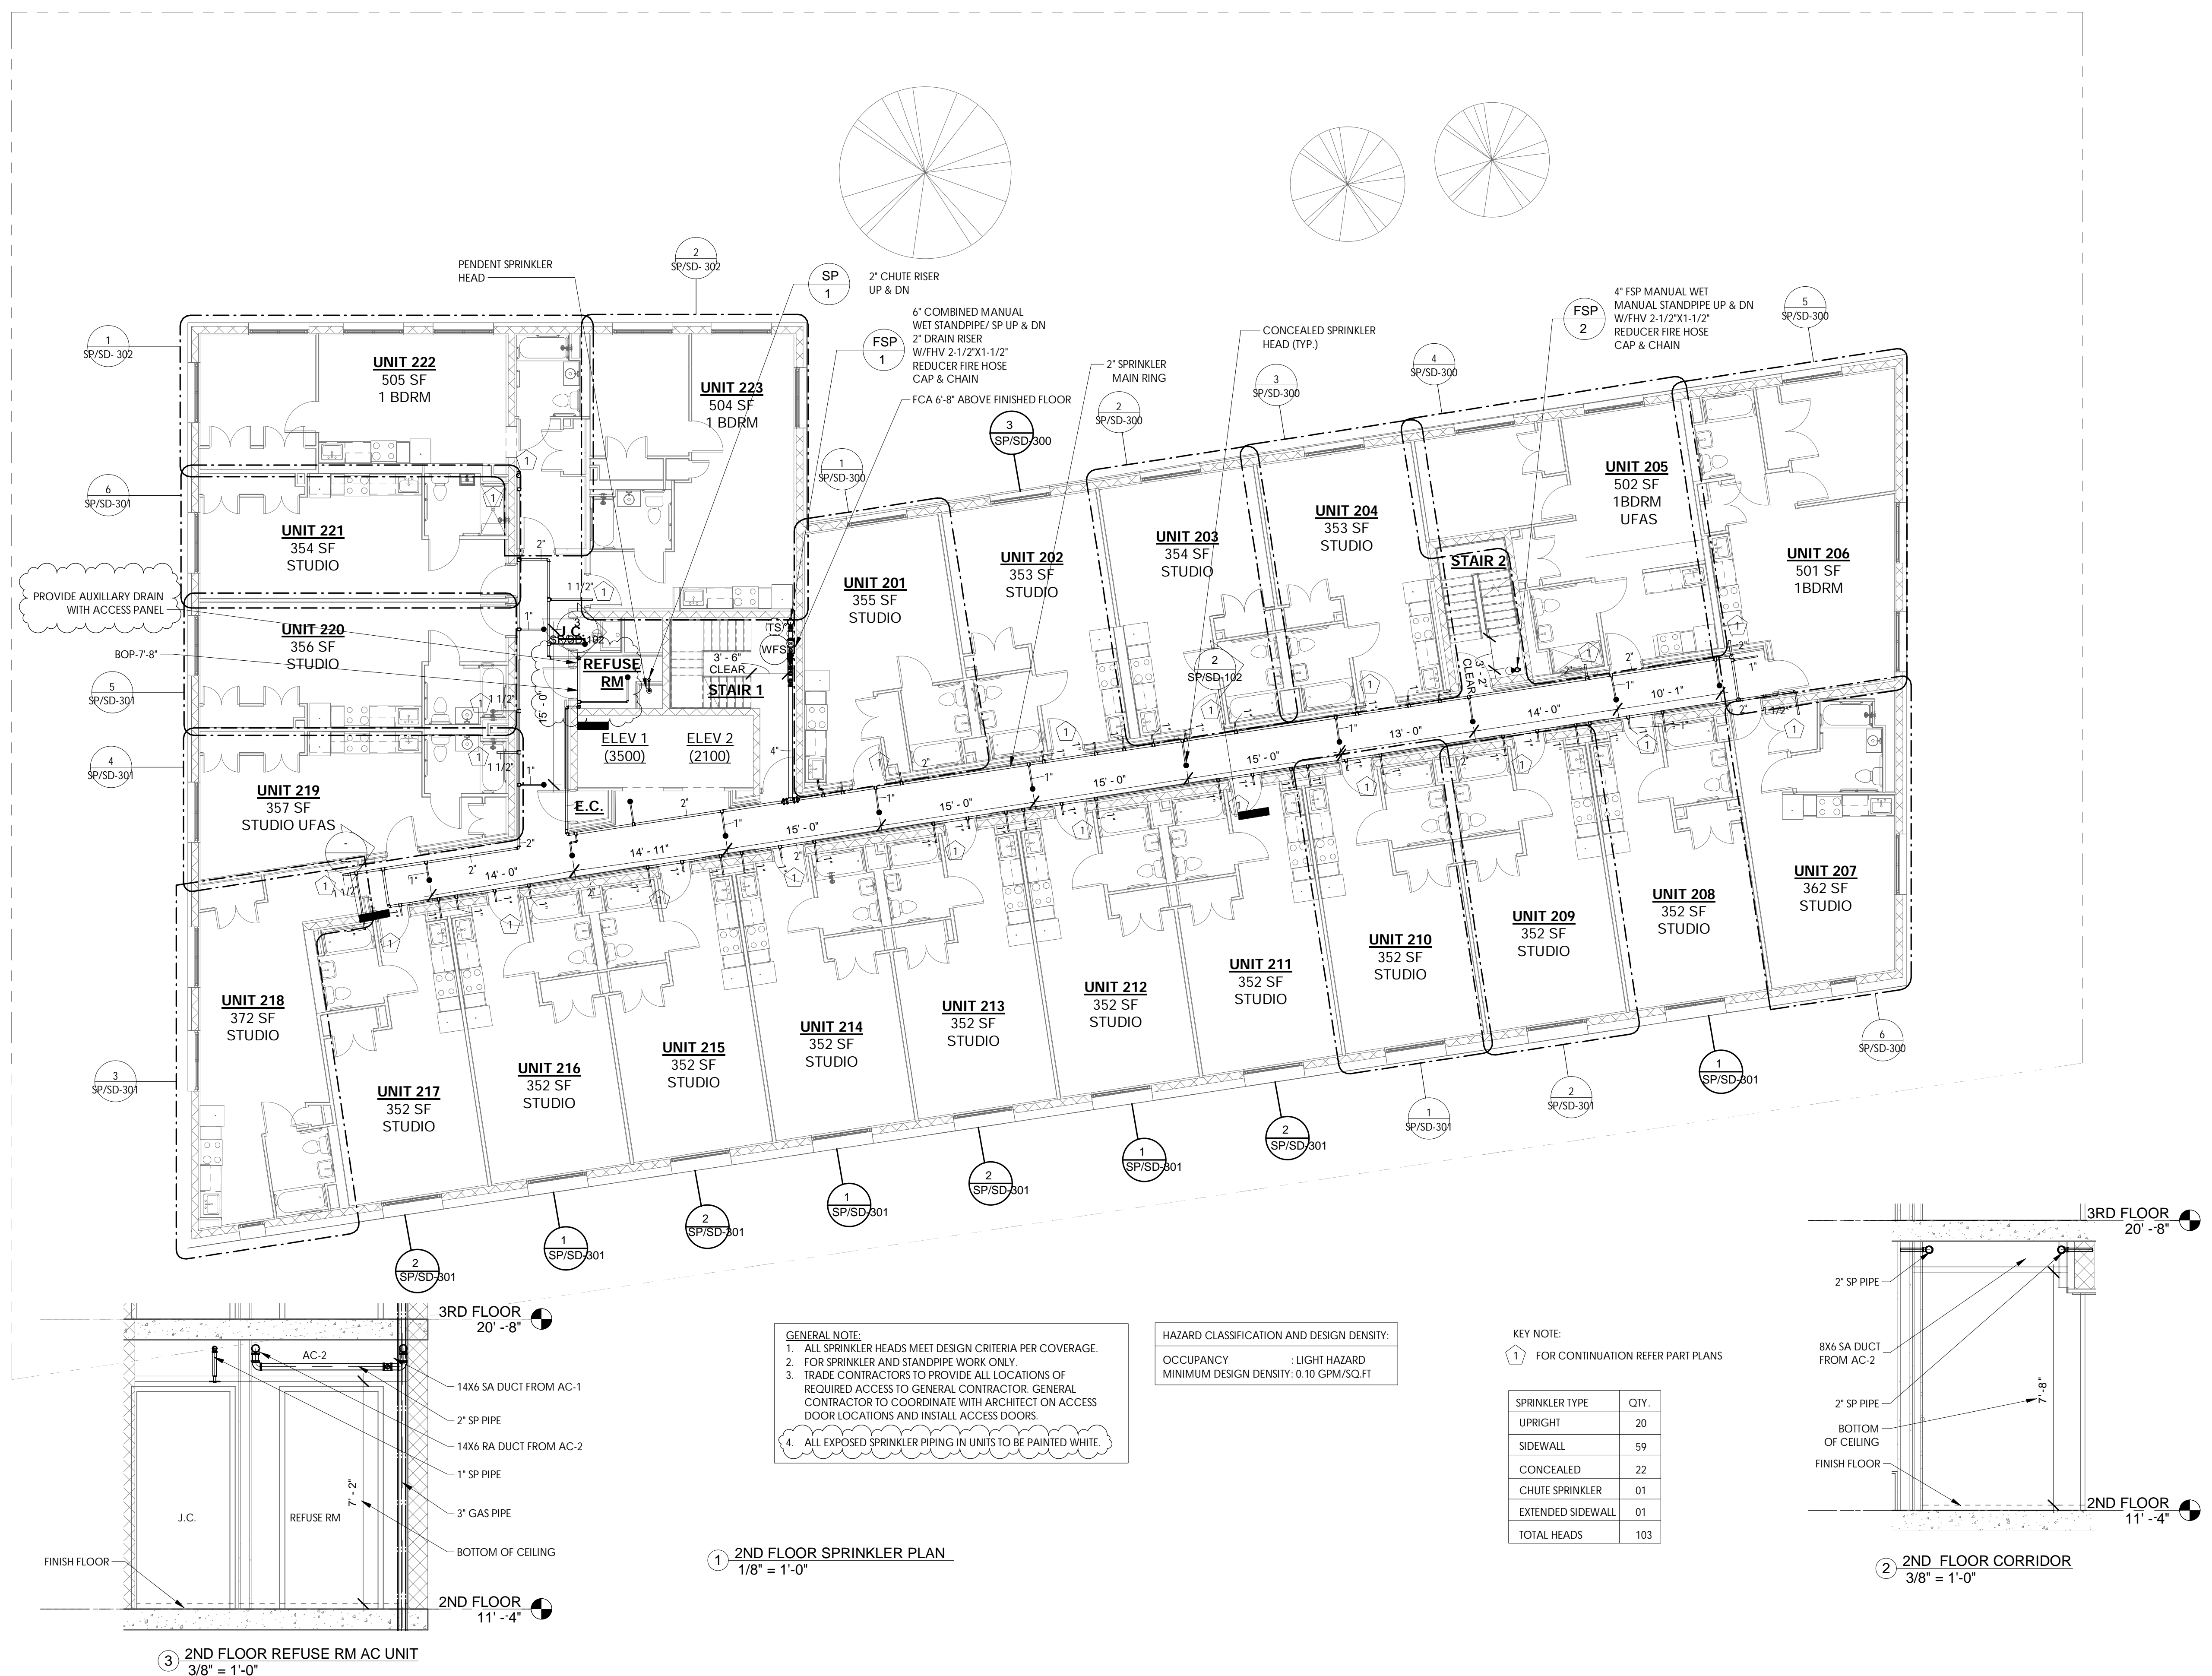

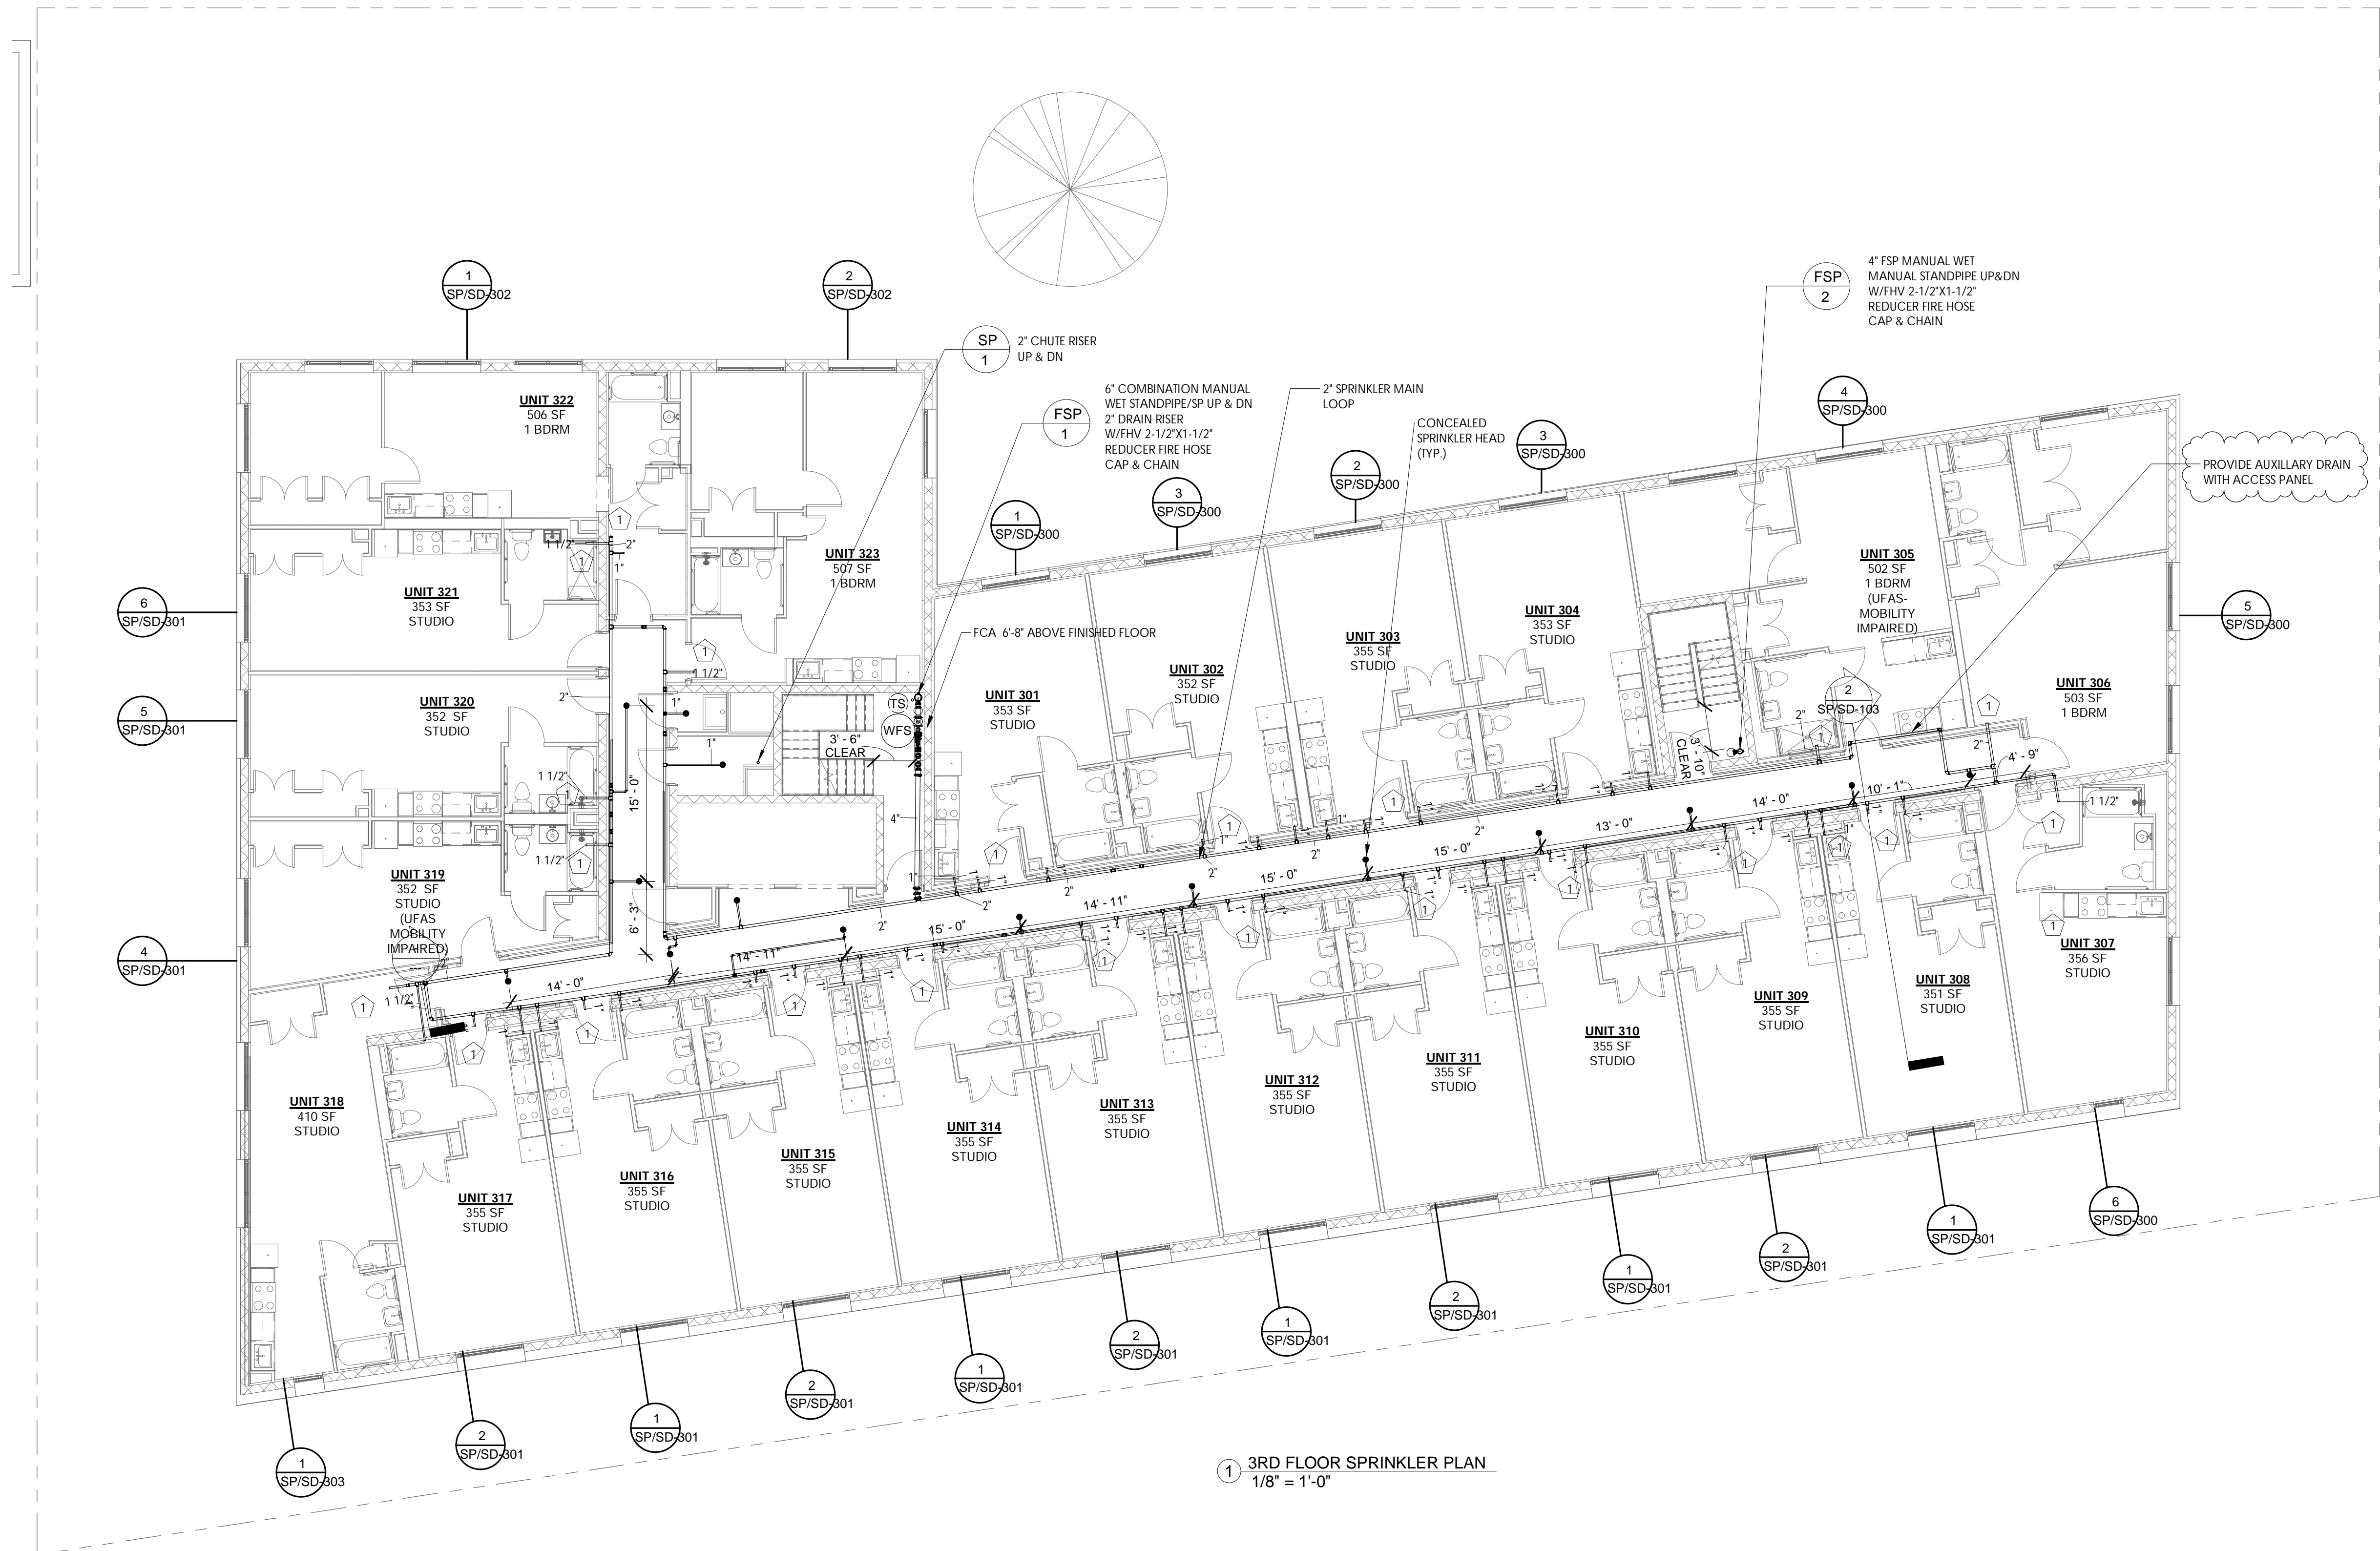

1 3RD FLOOR SPRINKLER PLAN
1/8" = 1'-0"

GENERAL NOTE:

1. ALL SPRINKLER HEADS MEET DESIGN CRITERIA PER COVERAGE.
2. FOR SPRINKLER AND STANDPIPE WORK ONLY.
3. TRADE CONTRACTORS TO PROVIDE ALL LOCATIONS OF REQUIRED ACCESS TO GENERAL CONTRACTOR. GENERAL CONTRACTOR TO COORDINATE WITH ARCHITECT ON ACCESS DOOR LOCATIONS AND INSTALL ACCESS DOORS.
4. ALL EXPOSED SPRINKLER PIPING IN UNITS TO BE PAINTED WHITE.


HAZARD CLASSIFICATION AND DESIGN DENSITY:

OCCUPANCY : LIGHT HAZARD
MINIMUM DESIGN DENSITY: 0.10 GPM/SQ.FT


KEY NOTE:

1 FOR CONTINUATION REFER PART PLANS

SPRINKLER TYPE	QTY.
UPRIGHT	20
SIDEWALL	59
CONCEALED	24
EXTENDED SIDEWALL	01
TOTAL HEADS	104

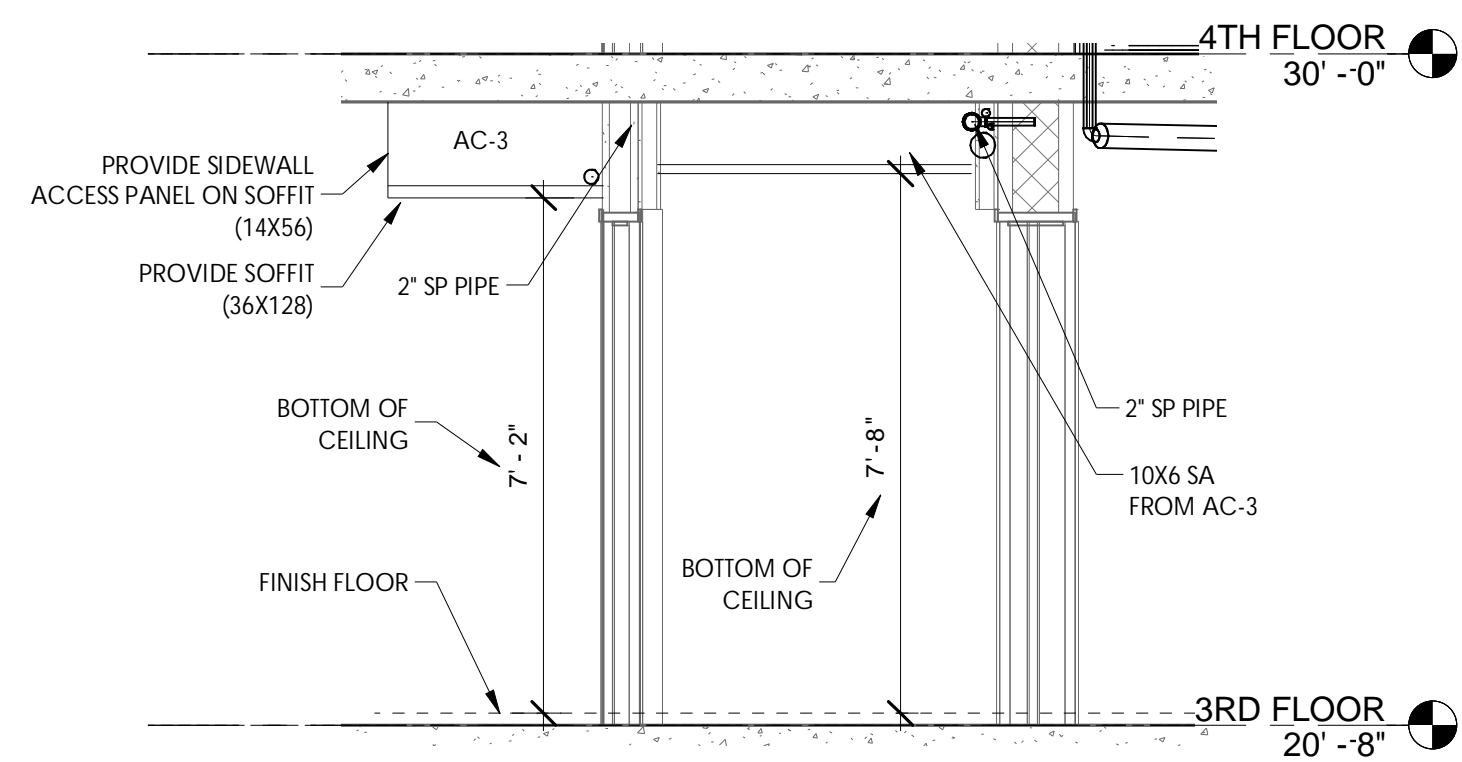

2 3RD FLOOR CORRIDOR
3/8" = 1'-0"

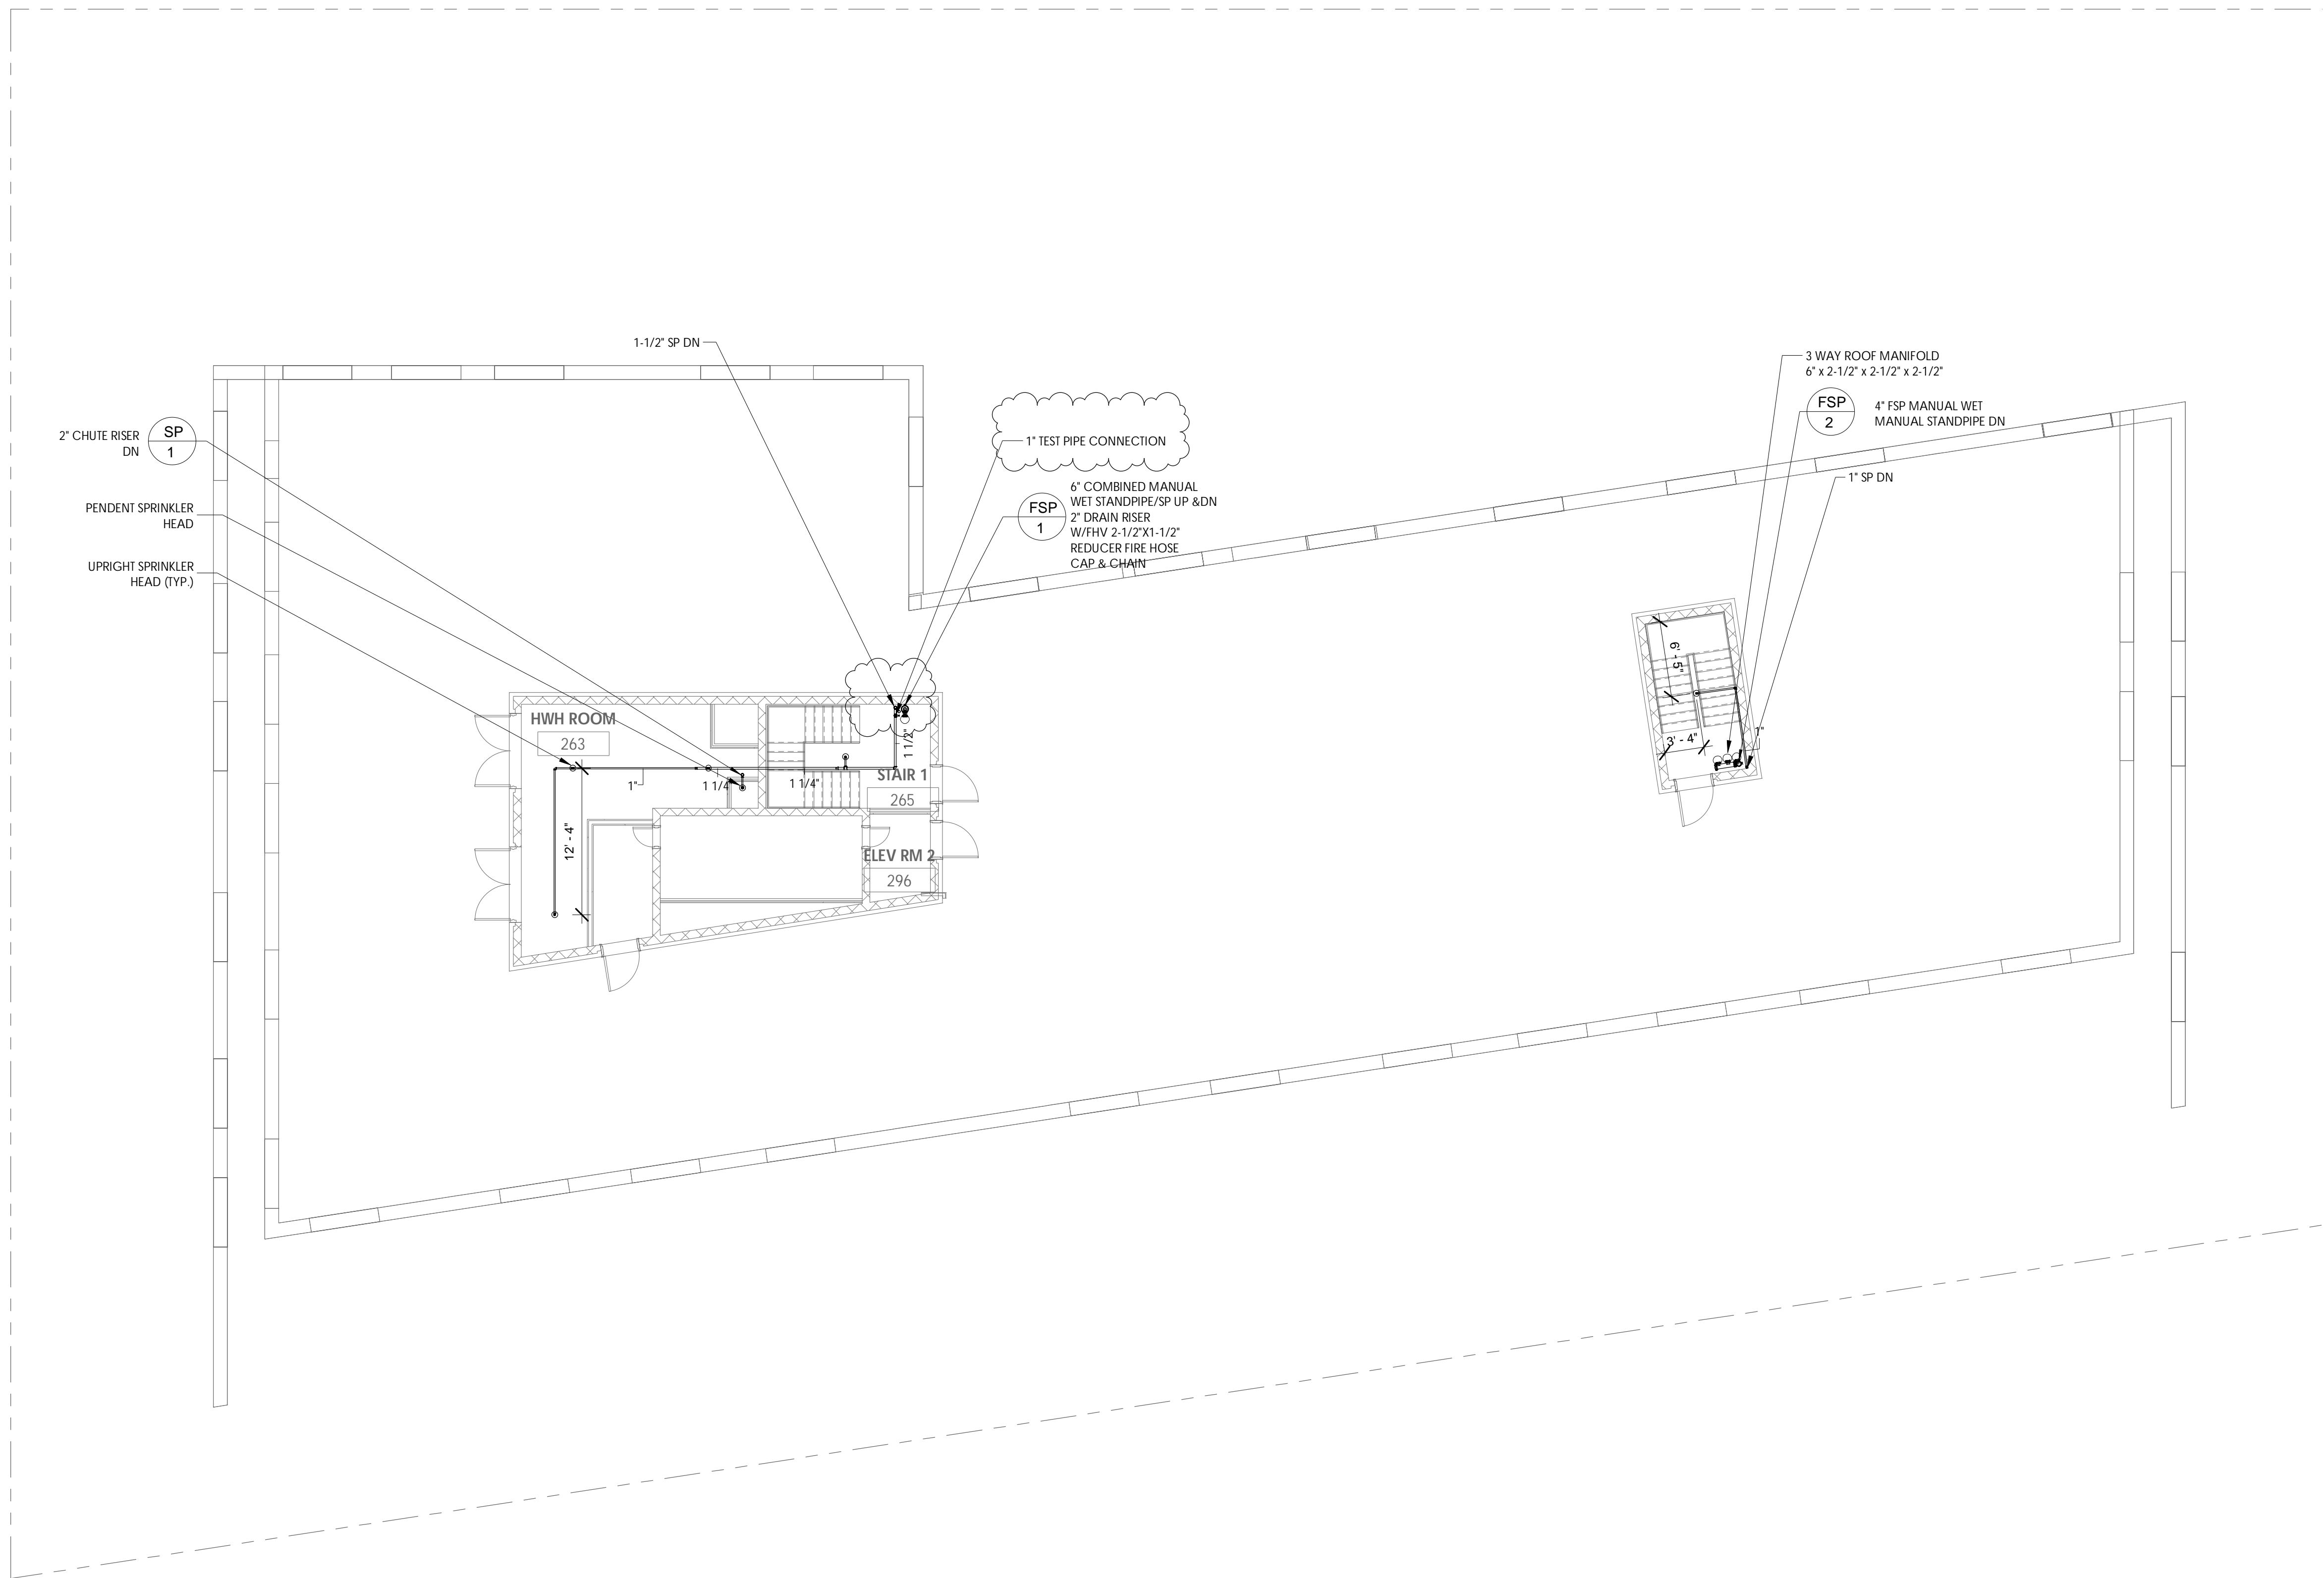

1 ROOF SPRINKLER PLAN
1/8" = 1'-0"

- GENERAL NOTE:
1. ALL SPRINKLER HEADS MEET DESIGN CRITERIA PER COVERAGE.
 2. FOR SPRINKLER AND STANDPIPE WORK ONLY.
 3. TRADE CONTRACTORS TO PROVIDE ALL LOCATIONS OF REQUIRED ACCESS TO GENERAL CONTRACTOR. GENERAL CONTRACTOR TO COORDINATE WITH ARCHITECT ON ACCESS DOOR LOCATIONS AND INSTALL ACCESS DOORS.
 4. ALL EXPOSED SPRINKLER PIPING IN UNITS TO BE PAINTED WHITE.

HAZARD CLASSIFICATION AND DESIGN DENSITY:

OCCUPANCY : LIGHT HAZARD
MINIMUM DESIGN DENSITY: 0.10 GPM/SQ.FT

HAZARD CLASSIFICATION AND DESIGN DENSITY:

OCCUPANCY : ORDINARY HAZARD
MINIMUM DESIGN DENSITY: 0.15 GPM/SQ.FT

SPRINKLER TYPE	QTY.
UPRIGHT	05
CHUTE SPRINKLER	01
TOTAL HEADS	06