


MATCH LINE - REFER PART PLAN 3 ON DRAWING P-102

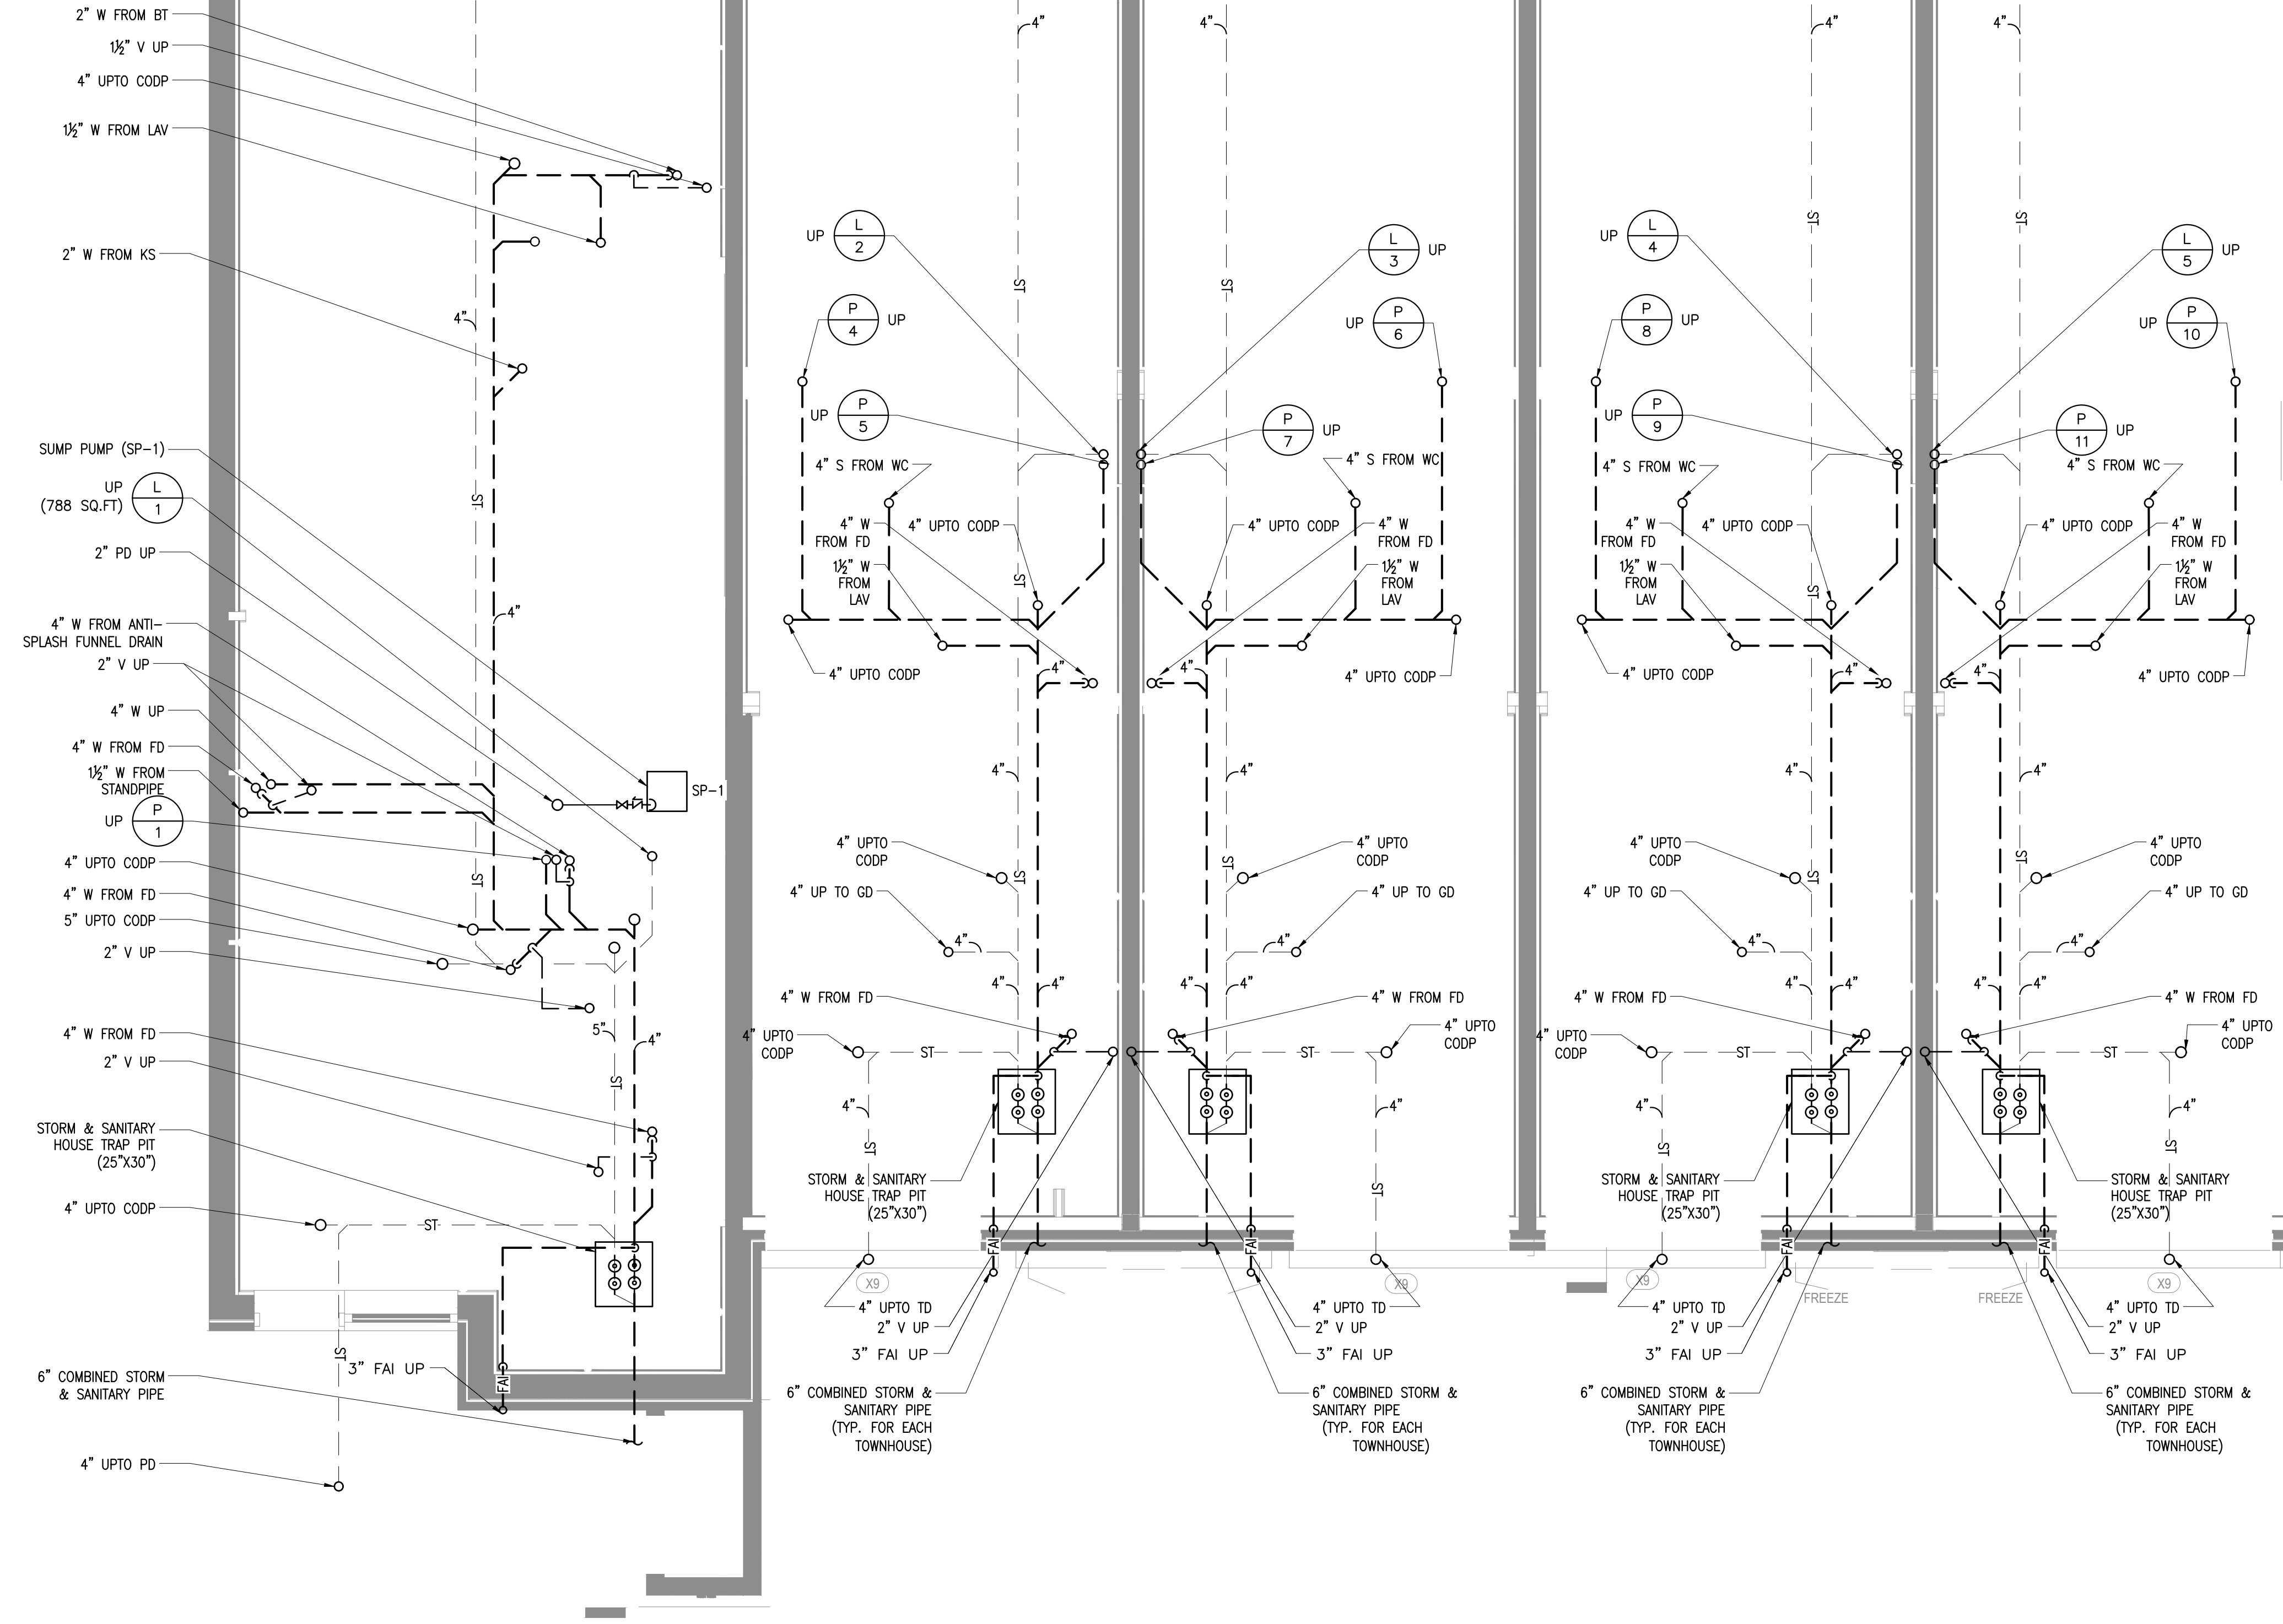


- 1 CONDENSATE DRAIN FROM MECHANICAL EQUIPMENT TO SPILL INDIRECTLY INTO LAVATORY WASTE PIPE WITH AIR GAP FITTINGS.
- 2 CONDENSATE DRAIN FROM MECHANICAL EQUIPMENT TO SPILL INDIRECTLY INTO LAVATORY WASTE PIPE WITH AIR GAP FITTINGS.

1. ALL WATER PIPING SHOULD BE PROVIDED WITH INSULATION ACCORDING TO NYC EDC 2016. REFER SECTION B OF POINT 1.06 ON DRAWING P-001.
2. PROVIDE ELECTRONIC TRAP PRIMER FOR BOILER ROOM & MECHANICAL ROOM FLOOR DRAIN & FLOW ACTIVATED TRAP PRIMER FOR W/D CLOSET FLOOR DRAIN.
3. FOR ALL PIPE SIZES, REFER TO RISER DIAGRAM.

- 1 NEW 4" COMBINED FIRE & DOMESTIC WATER SERVICE
- 2 NEW 4" HOUSE GATE VALVE (OS&Y TYPE)
- 3 1½" MCV WITH NYC APPROVED WATER METER.
- 4 4" DCDA FOR FIRE SERVICE STACKED BELOW 1½" RP;
INSTALLED ON DOMESTIC WATER SERVICE
- 5 1½" TEST TEE & 1½" MCOV
- 6 4" SANITARY & 5" STORM HOUSE TRAP INSTALLED
UNDERGROUND PROVIDE METAL COVER FOR ACCESS
- 8 DOMESTIC WATER DUPLEX BOOSTER PUMP (BP-1)

- 11 NEW 2" COMBINED WATER SERVICE WITH HOUSE GATE VALVE
- 12 NEW 1¼" GAS SERVICE WITH HOUSE GATE VALVE
- 13 NEW GAS METER
- 14 2" RESILIENT GATE VALVE STACKED ABOVE 2" NYC APPROVED METER AND 2" DOVA
- 15 ½" TEST TEE & ½" MOCV
- 16 4" SANITARY & 4" STORM HOUSE TRAP INSTALLED UNDERGROUND PROVIDE METAL COVER FOR ACCESS

① GROUND FLOOR PLUMBING PLAN
1/4" = 1'-0"

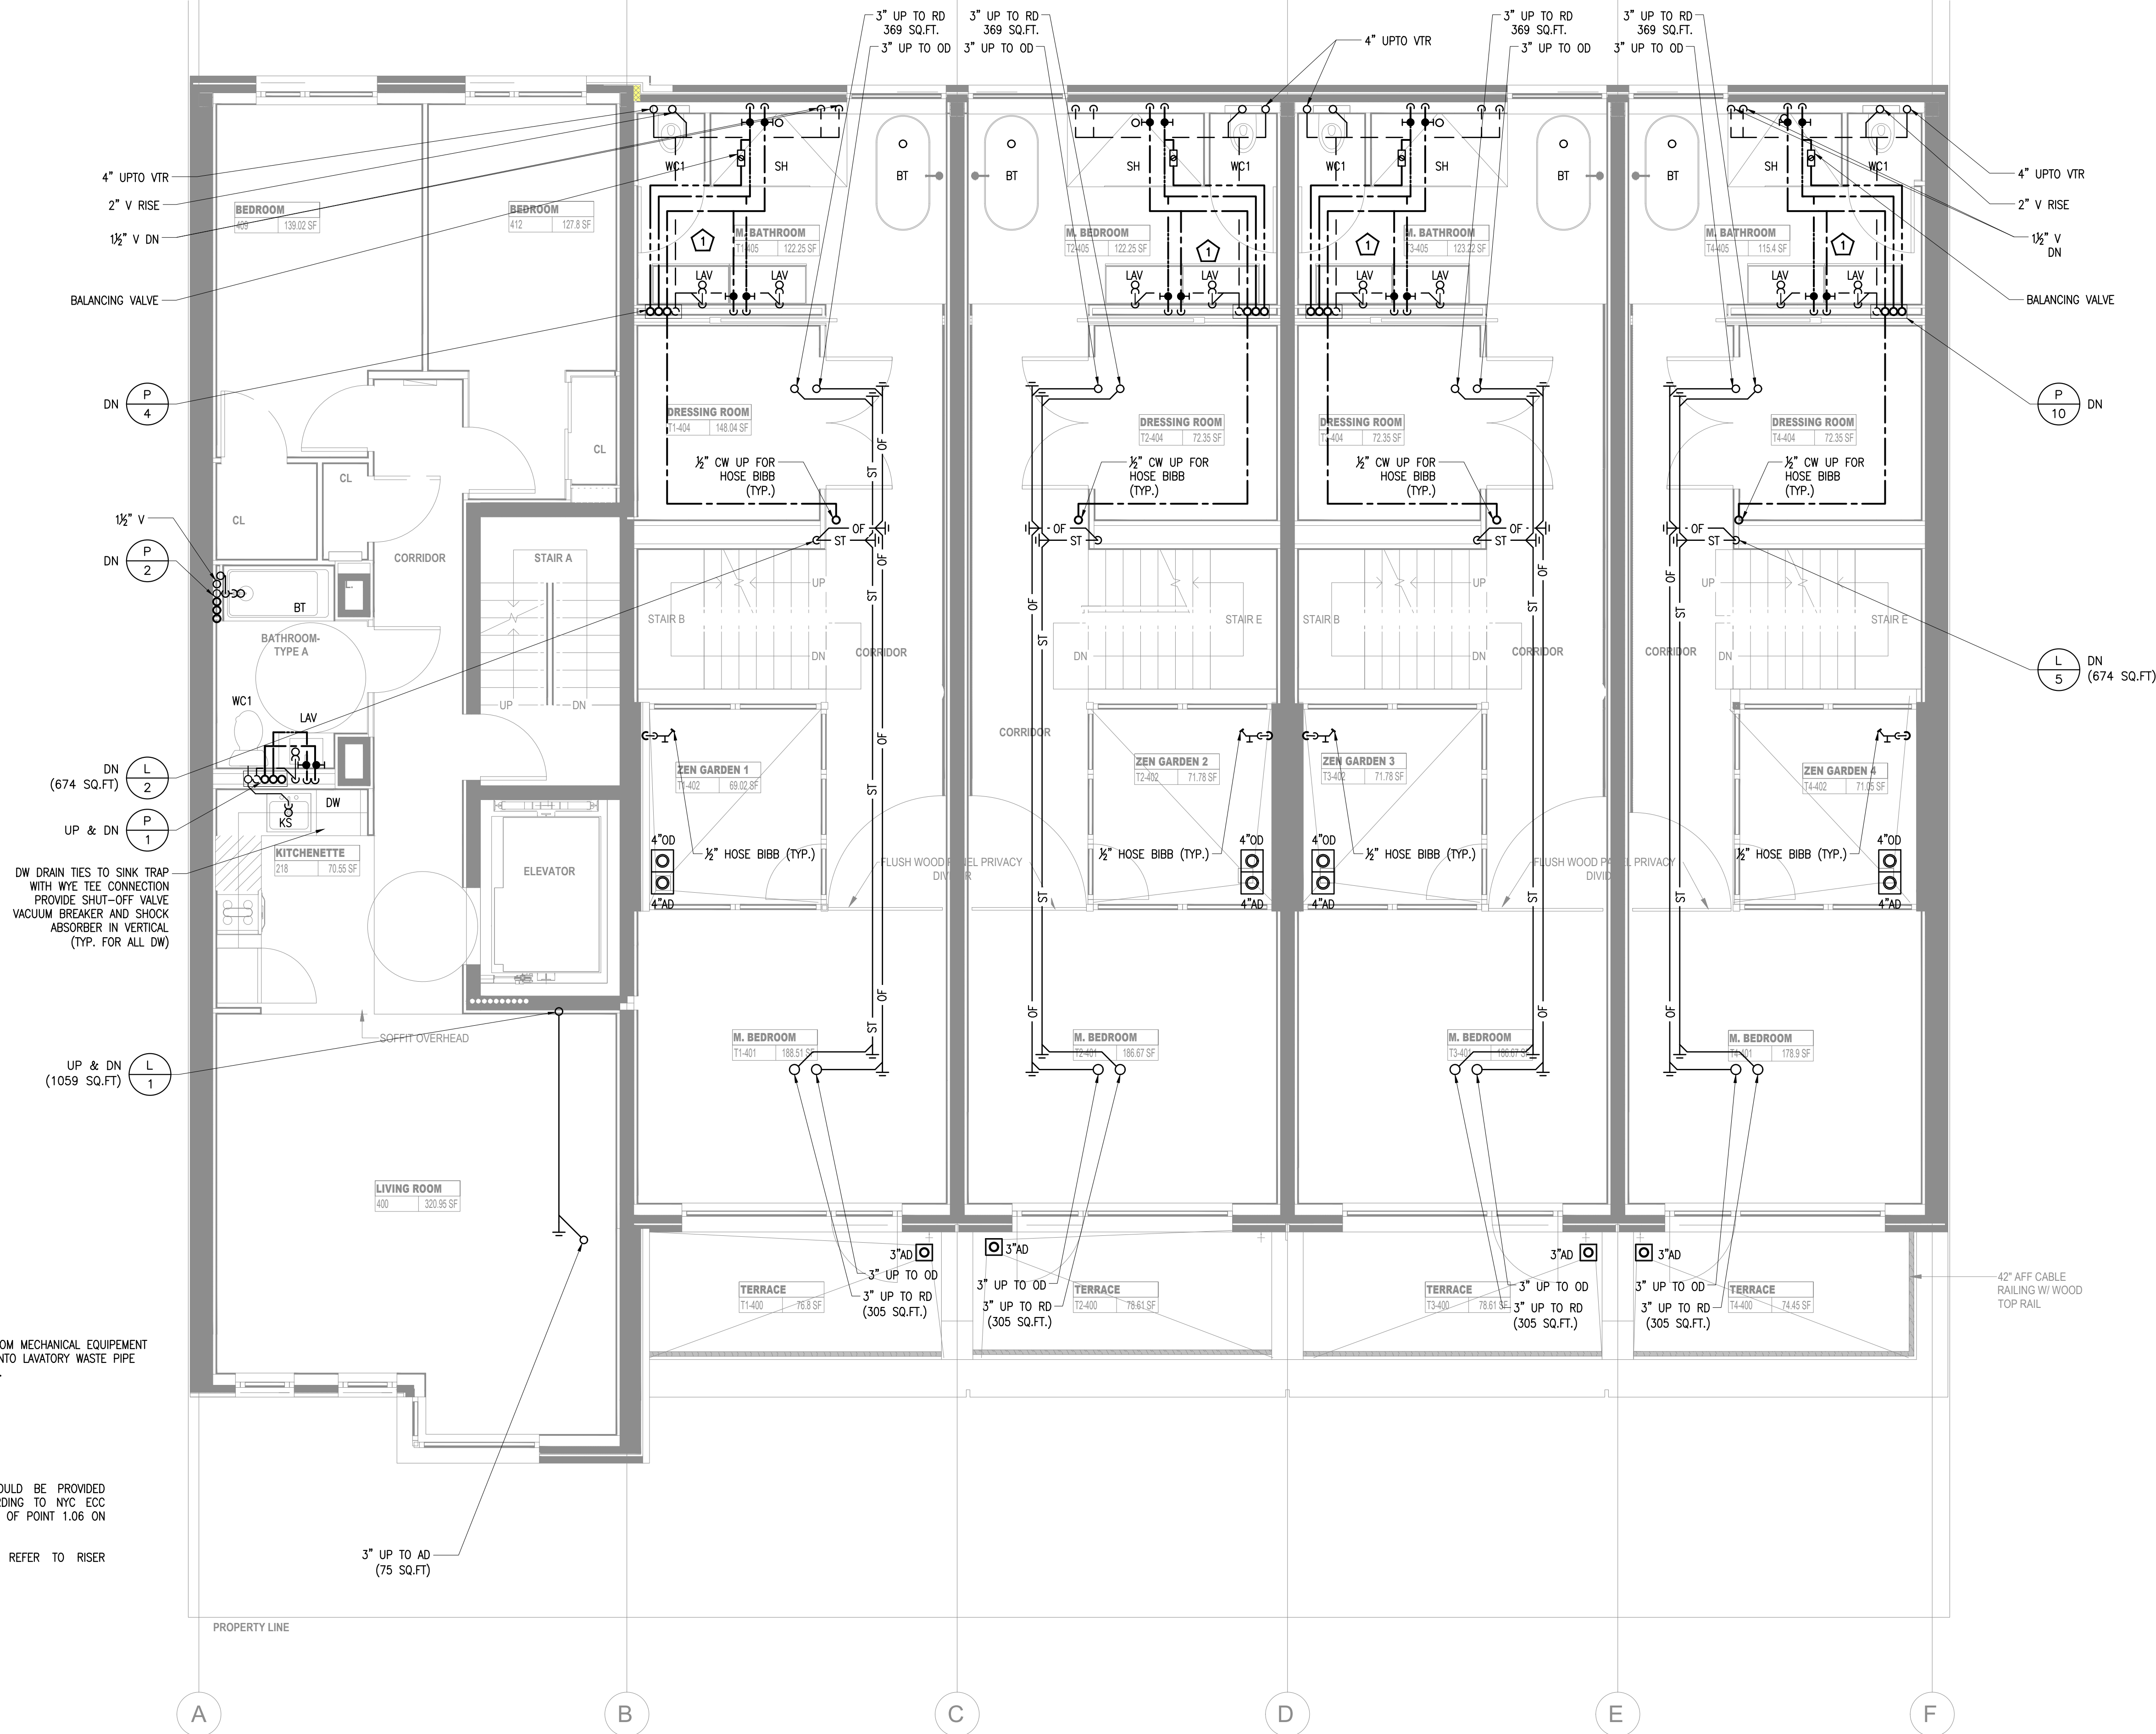

KEY NOTE:

1. CONDENSATE DRAIN FROM MECHANICAL EQUIPMENT TO SPILL INDIRECTLY INTO LAVATORY WASTE PIPE WITH AIR GAP FITTINGS.

GENERAL NOTE:


- ALL WATER PIPING SHOULD BE PROVIDED WITH INSULATION ACCORDING TO NYC ECC 2016. REFER SECTION B OF POINT 1.06 ON DRAWING P-001.
- FOR ALL PIPE SIZES, REFER TO RISER DIAGRAM.

KEY NOTE:

- 1 CONDENSATE DRAIN FROM MECHANICAL EQUIPMENT TO SPILL INDIRECTLY INTO LAVATORY WASTE PIPE WITH AIR GAP FITTINGS.

GENERAL NOTE:

1. ALL WATER PIPING SHOULD BE PROVIDED WITH INSULATION ACCORDING TO NYC ECC 2016. REFER SECTION B OF POINT 1.06 ON DRAWING P-001 .
2. FOR ALL PIPE SIZES, REFER TO RISER DIAGRAM.

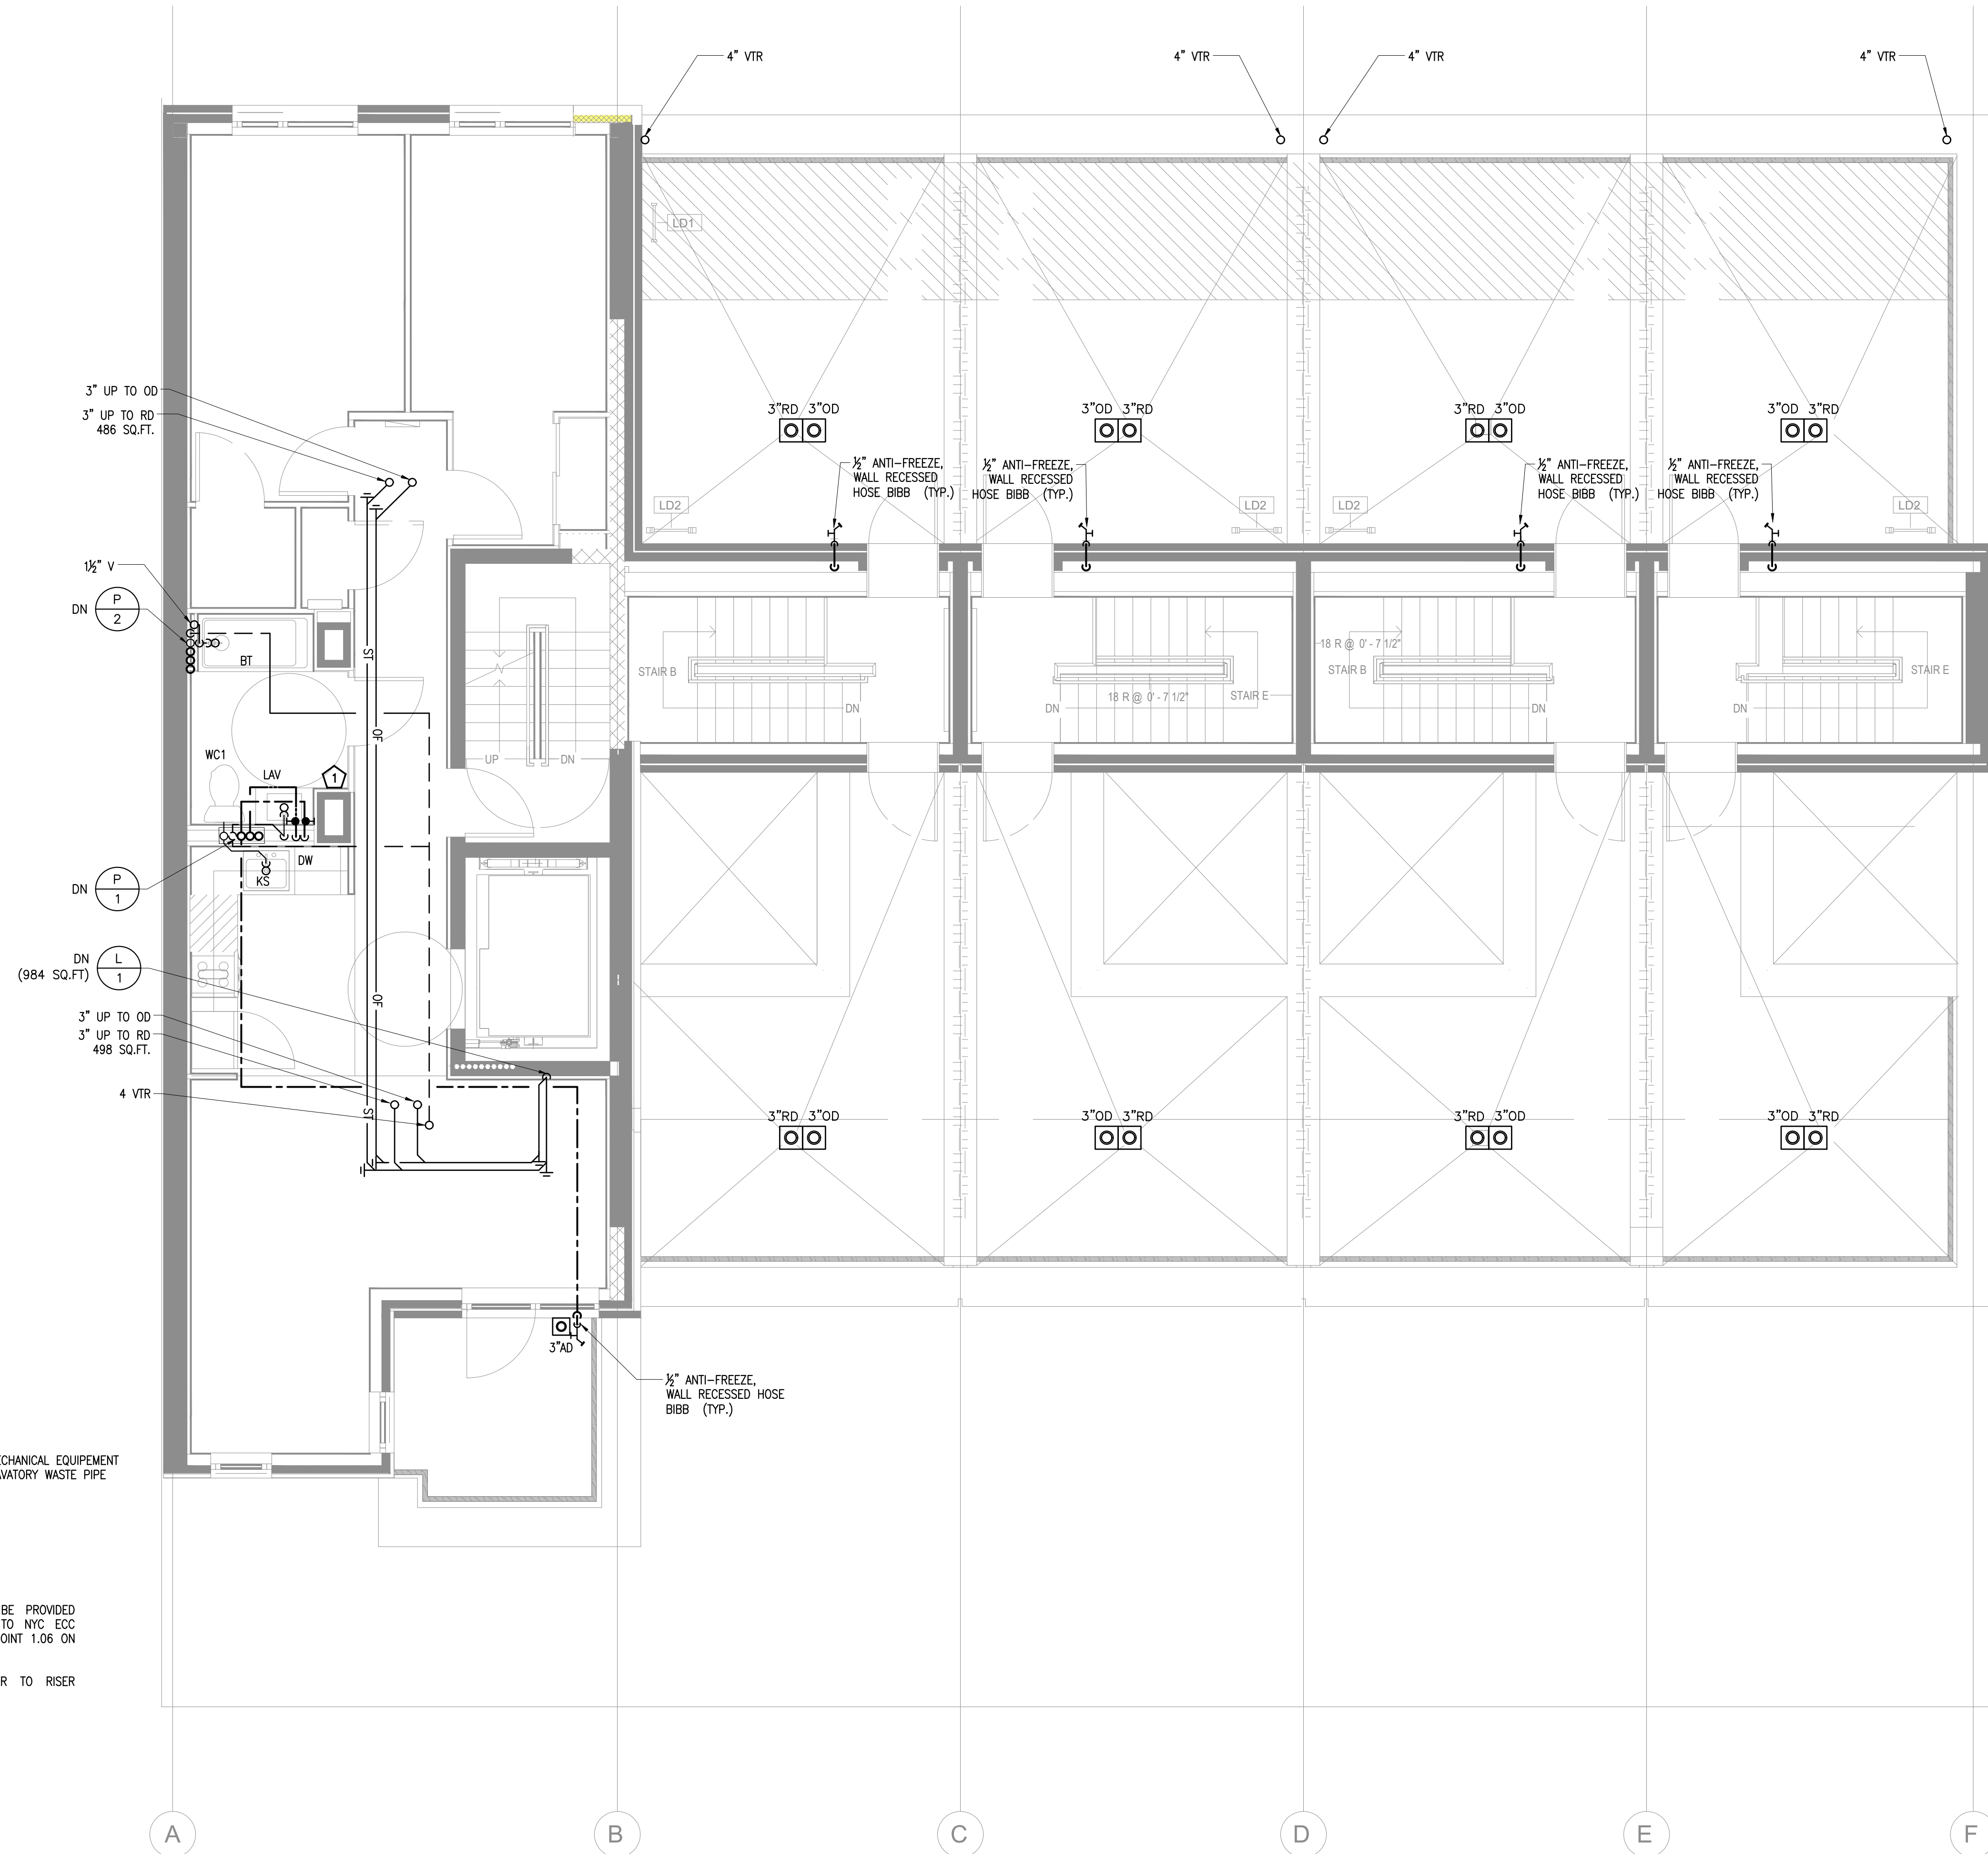

1 5TH FLOOR PLUMBING PLAN
1/4" = 1'-0"

