
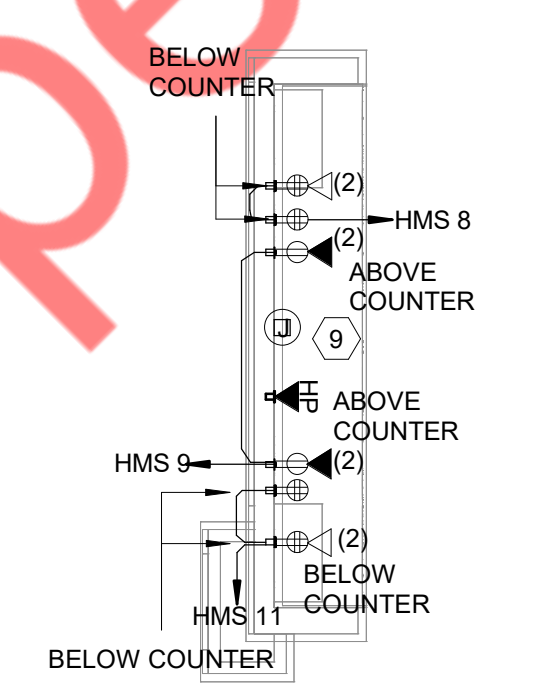



1 1ST FLOOR POWER PLAN-A
1/8" = 1'-0"

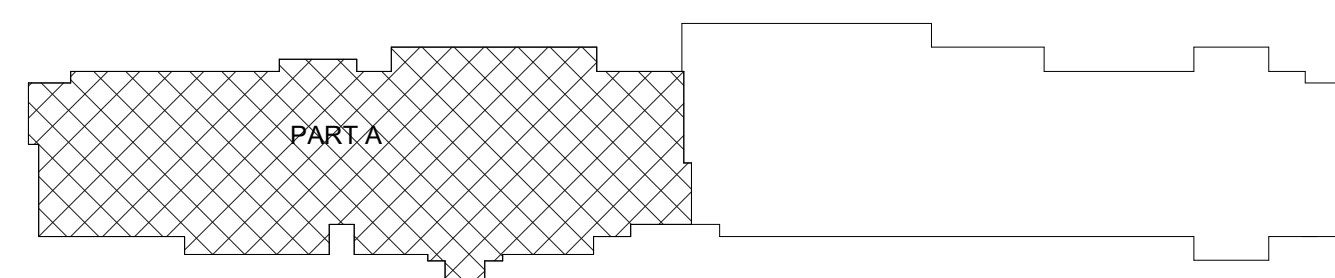


2 FRONT DESK
1/4" = 1'-0"

E-201A-KEYNOTES

KEYNOTE	TEXT
1	HOUSE PHONE ONLY W/AUTOMATIC DIAL TO FRONT DESK.
2	CARD READERS INSTALLED PER MANUFACTURERS INSTRUCTIONS. PROVIDE ELECTRICAL CONNECTION TO CARD READERS TYPICAL FOR ALL FLOOR.
3	PROVIDE TWO-WAY COMMUNICATION SYSTEM AT ELEVATOR LANDING ON EACH ACCESSIBLE FLOOR THAT IS ONE OR MORE STORIES ABOVE OR BELOW THE STORY OF EXIT DISCHARGE. COMPLY WITH IBC SECTIONS 1009.8.1 AND 1009.8.2. AS PER IBC SECTION 1009.08.1 TWO-WAY COMMUNICATION SYSTEM SHALL PROVIDE COMMUNICATION BETWEEN EACH REQUIRED LOCATION AND THE FIRE COMMAND CENTER OR A CENTRAL CONTROL POINT LOCATION APPROVED BY THE FIRE DEPARTMENT WHERE THE CENTRAL CONTROL POINT IS NOT CONSTANTLY ATTEND A TWO-WAY COMMUNICATION SYSTEM SHALL HAVE A TIMED AUTOMATIC TELEPHONE DIAL OUT CAPABILITY TO A MONITORING LOCATION OR 911. THE TWO-WAY COMMUNICATION SYSTEM SHALL INCLUDE BOTH AUDIBLE AND VISIBLE SIGNALS AS PER IBC SECTION 1009.8.2 DIRECTION FOR THE USE OF TWO-WAY COMMUNICATION SYSTEM INSTRUCTION FOR SUMMONING ASSISTANCE VIA THE TWO-WAY COMMUNICATION SYSTEM AND WRITTEN IDENTIFICATION OF THE LOCATION SHALL BE POSTED ADJACENT TO THE TWO-WAY COMMUNICATION SYSTEM. CONTRACTOR SHALL ALSO VERIFY TWO WAY COMMUNICATION AS PER IBC SECTION 3008.6.6.
4	WIRELESS ACCESS POINT ABOVE CEILING IN ACCESSIBLE LOCATION SITE SURVEY SHALL BE COMPLETED BY THE TECHNOLOGY CONTRACTOR TO DETERMINE BEST LOCATION FOR EACH ZONE. PREFERRED LOCATION IN GUESTROOM IS IN GUEST CLOSET.
5	FIRE DEPARTMENT LOCK BOX. PROVIDE CONNECTION TO FIRE ALARM SYSTEM FOR MONITORING. CONTRACTOR SHALL COORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH LOCAL REQUIREMENTS.
6	RECEPTACLES ARE IN FLOOR. CONTRACTOR NEEDS TO PROVIDE ADEQUATE PROTECTION FOR THE SAME. TYPICAL FOR ALL FLOOR MOUNTED BOXES.
7	MAGNETIC DOOR-HOLD TIED TO THE BUILDING FIRE ALARM CONTROL PANEL. PROVIDE ELECTRICAL CONNECTION TO MAGNETIC DOOR-HOLD. TYPICAL TO ALL FLOOR.
8	PANTRY AND FOOD PREP. AREA RECEPTACLE LAYOUT REFER TO THE ENLARGED SHEET E-206.
9	CONTRACTOR SHALL COORDINATE WITH MILLWORK VENDOR AND CONFIRM LATEST DESK SYSTEM STANDARDS PRIOR TO LOCATING PHONE, DATA & POWER. LOCATE PHONE/DATA AND POWER ABOVE COUNTER FOR WORKSTATIONS, RECEPTACLES.
10	FIRE VENDOR SHALL PROVIDE RADIO RESPONDER OF APPROVED RADIO COVERAGE FOR EMERGENCY RESPONDERS WITHIN THE BUILDING BASED UPON THE EXISTING COVERAGE LEVELS OF THE PUBLIC SAFETY COMMUNICATION SYSTEMS OF THE JURISDICTION AT THE EXTERIOR OF THE BUILDING.
11	ELECTRICAL CONTRACTOR SHALL CO-ORDINATE ELECTRICAL ROOM SIZE AND PHYSICAL VERIFY AND MAINTAIN CLEARANCE AS PER NEC ARTICLE 110.26 BEFORE PRIOR TO PANEL CONSTRUCTION
12	CONTRACTOR TO PROVIDE JUNCTION BOX FOR SPLIT UNIT CONNECTION BEING FED BY ITS RESPECTIVE OUTDOOR UNIT. CONTRACTOR TO COORDINATE WITH MECHANICAL VENDOR ON SITE AND PROVIDE NECESSARY ARRANGEMENTS.
13	GUEST ROOM PANEL BOARD SHALL BE FLUSH MOUNTED ON WALL AND MAINTAIN MIN. 2HR FIRE RESISTANCE RATING OF THE WALL. CONTRACTOR SHALL REFER DETAIL 1 ON SHEET E-104. CONTRACTOR SHALL MAINTAIN MIN CLEAR SPACE REQUIRED AS PER NEC ARTICLE 110.26.
14	PROVIDE CONDUIT FOR UPPER FLOOR AND ROOF ANTENNA. CONTRACTOR SHALL COORDINATE WITH LV VENDOR FOR QTY, SIZE AND LOCATION.
15	FIRE/SMOKE DAMPER CONNECT TO FIRE ALARM SYSTEM. SEE MECHANICAL DWG FOR LOCATION AND REQUIREMENT. PROVIDE ELECTRICAL CONNECTION TO SMOKE/FIRE DAMPER FROM MP2: 25 TYPICAL FOR ALL FLOOR.
16	CONTRACTOR SHALL PROVIDE HARD WIRE CONNECTION TO STAIR CUH UNIT. CONTRACTOR SHALL CO-ORDINATE WITH MECHANICAL VENDOR AND PROVIDE CONNECTION ACCORDINGLY.
17	EXHAUST FANS ARE CONNECTED THROUGH HARD WIRE CONNECTION. PROVIDE HARD WIRE CONNECTION TO EXHAUST FAN CONTRACTOR SHALL CO-ORDINATE WITH MECHANICAL VENDOR FOR EXACT LOCATION AND REQUIREMENT.
18	CONTRACTOR SHALL PROVIDE CAT6 CABLE AND COAXIAL CABLE FOR ALL TV OUTLETS IN THE BUILDING.
19	CONTRACTOR SHALL PROVIDE IG TYPE OUTLET FOR LV EQUIPMENTS CONNECTION FOR SHOW OR SHOW IG TYPE RECEPTACLE.

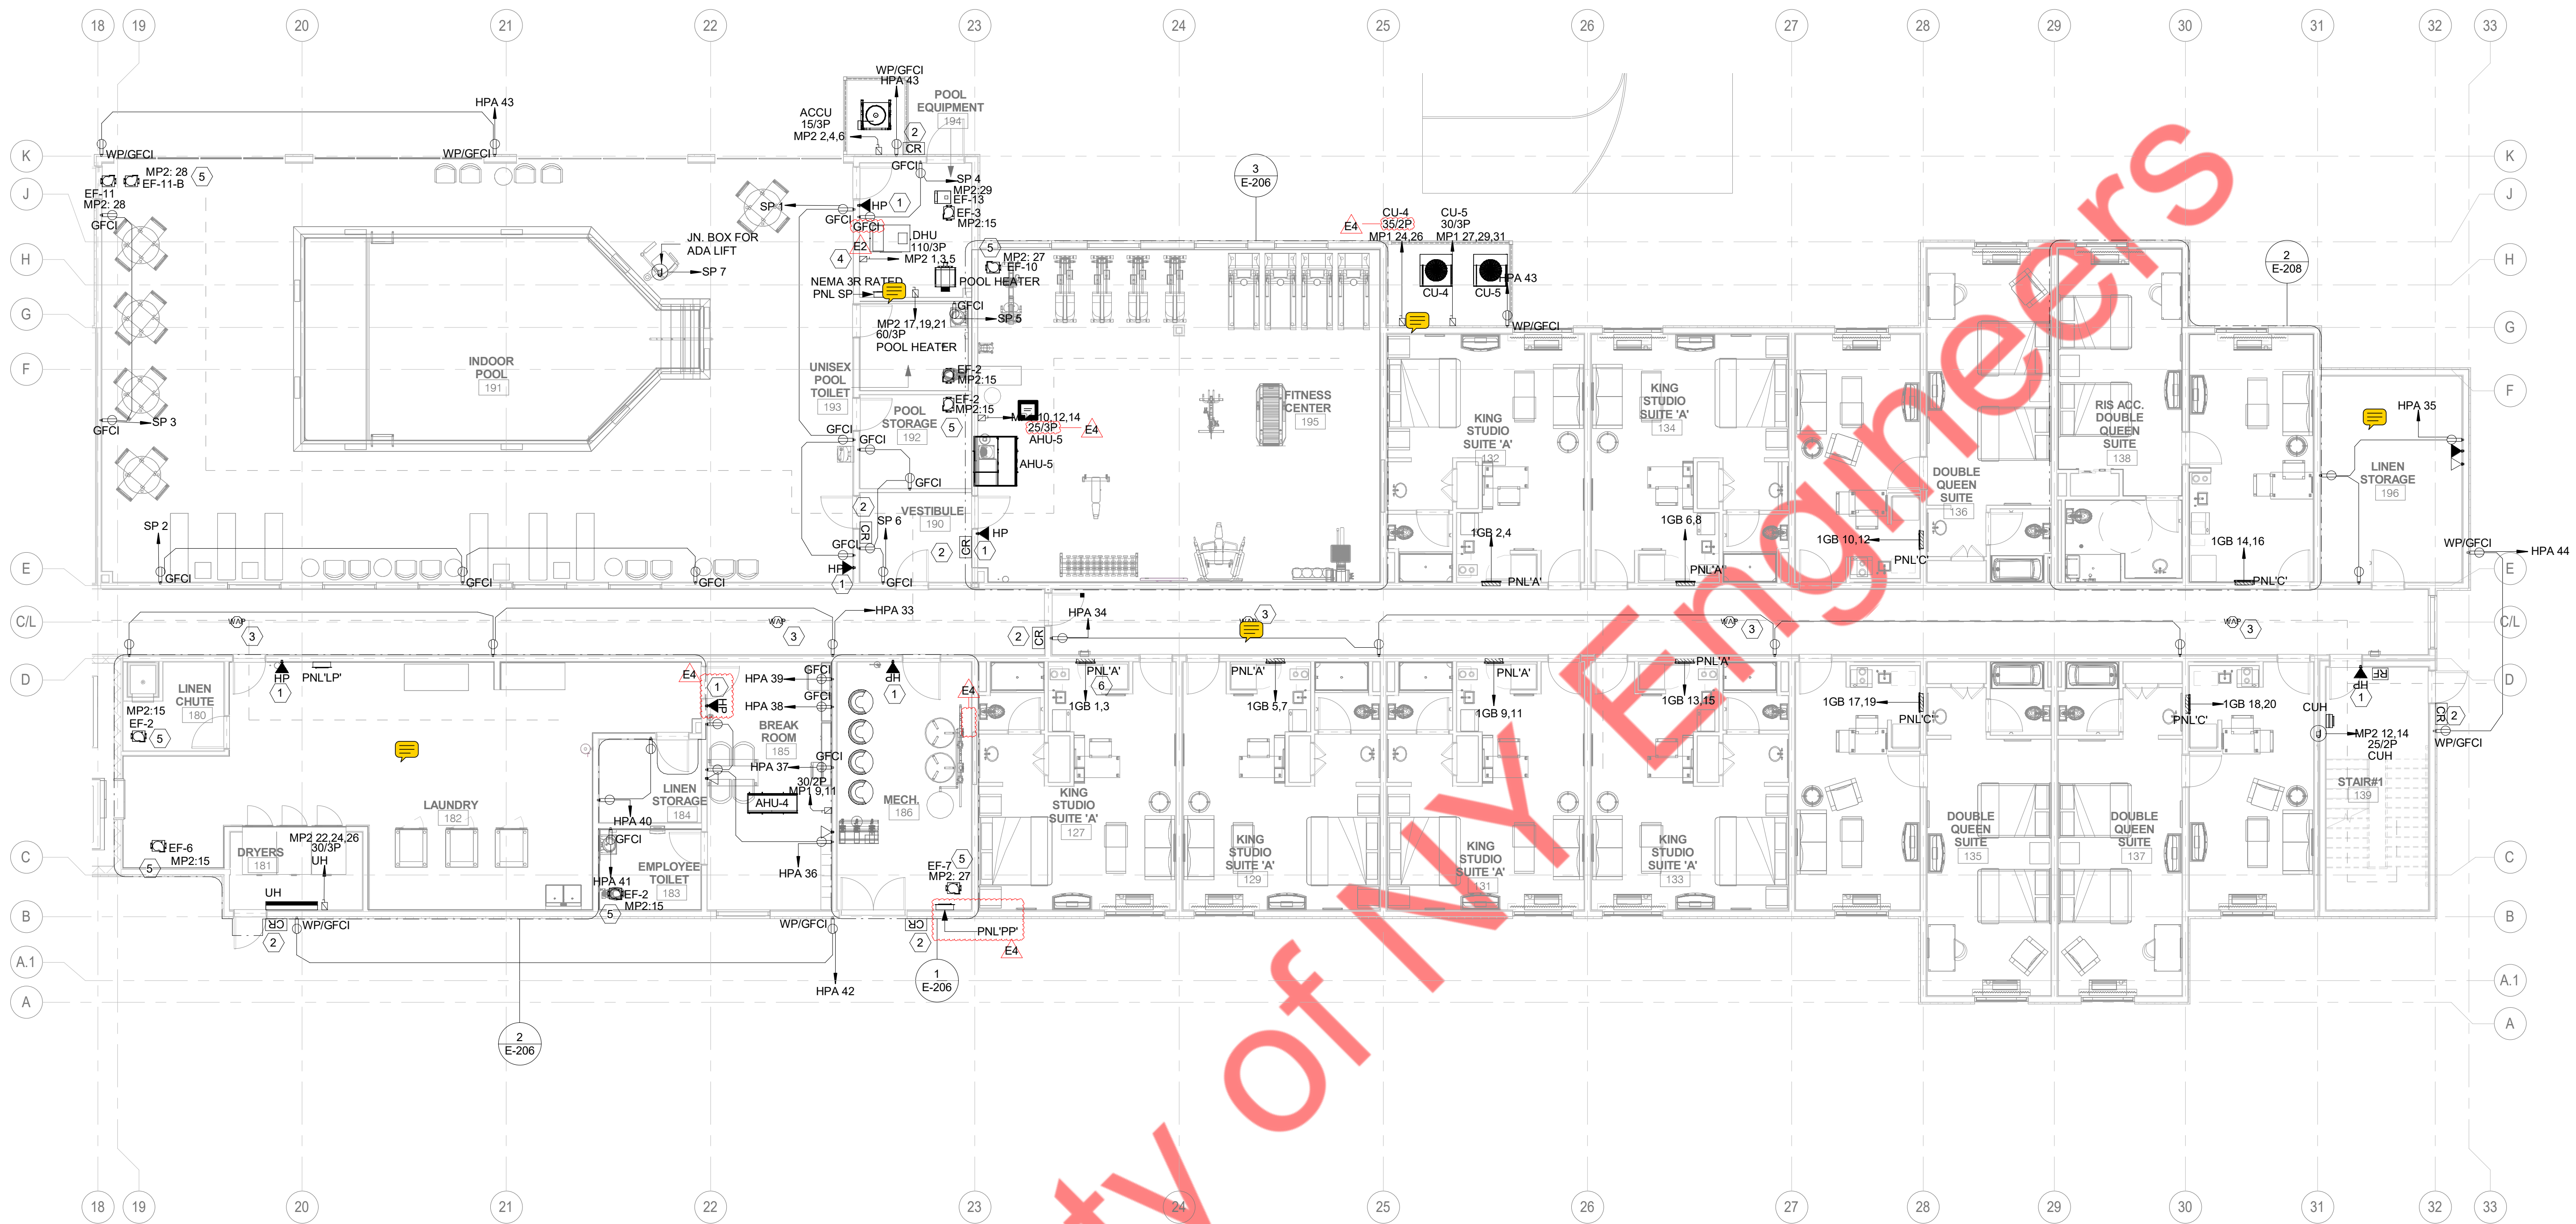


1 1ST FLOOR POWER PLAN-B
1/8" = 1'-0"

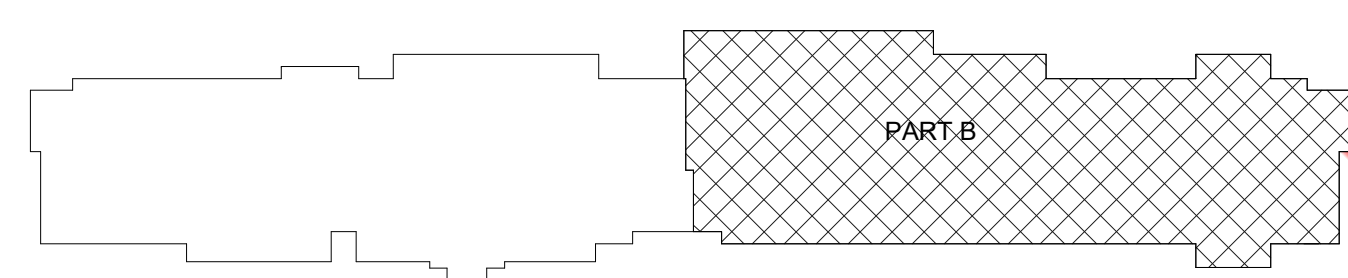


Property of MY Engineers

201B- KEY NOTES	
Symbol	Text
1	HOUSE PHONE ONLY W/AUTOMATIC DIAL TO FRONT DESK.
2	CARD READERS INSTALLED PER MANUFACTURERS INSTRUCTIONS. PROVIDE ELECTRICAL CONNECTION TO CARD READERS TYPICAL FOR ALL FLOOR
3	WIRELESS ACCESS POINT ABOVE CEILING IN ACCESSIBLE LOCATION SITE SURVAY SHALL BE COMPLETED BY THE TECHNOLOGY CONTRACTOR TO DETERMINE BEST LOCATION FOR EACH ZONE. PREFERRED LOCATION IN GUESTROOM IS IN GUEST CLOSET.
4	CONTRACTOR SHALL CO-ORDINATE WITH POOL VENDOR FOR POOL EQUIPMENT DETAIL AND FINAL LOAD SCHEDULE.
5	EXHAUST FANS ARE CONNECTED THROUGH HARD WIRE CONNECTION.PROVIDE HARD WIRE CONNECTION TO EXHAUST FAN CONTRACTOR SHALL CO-ORDINATE WITH MECHANICAL VENDOR FOR EXACT LOCATION AND REQUIREMENT.
6	GUEST ROOM PANEL BOARD SHALL BE FLUSH MOUNTED ON WALL AND MAINTAIN MIN. 2HR FIRE RESISTANCE RATING OF THE WALL. CONTRACTOR SHALL REFER DETAIL 1 ON SHEET E-104. CONTRACTOR SHALL MAINTAIN MIN CLEAR SPACE REQUIRED AS PER NEC ARTICLE 110.26.

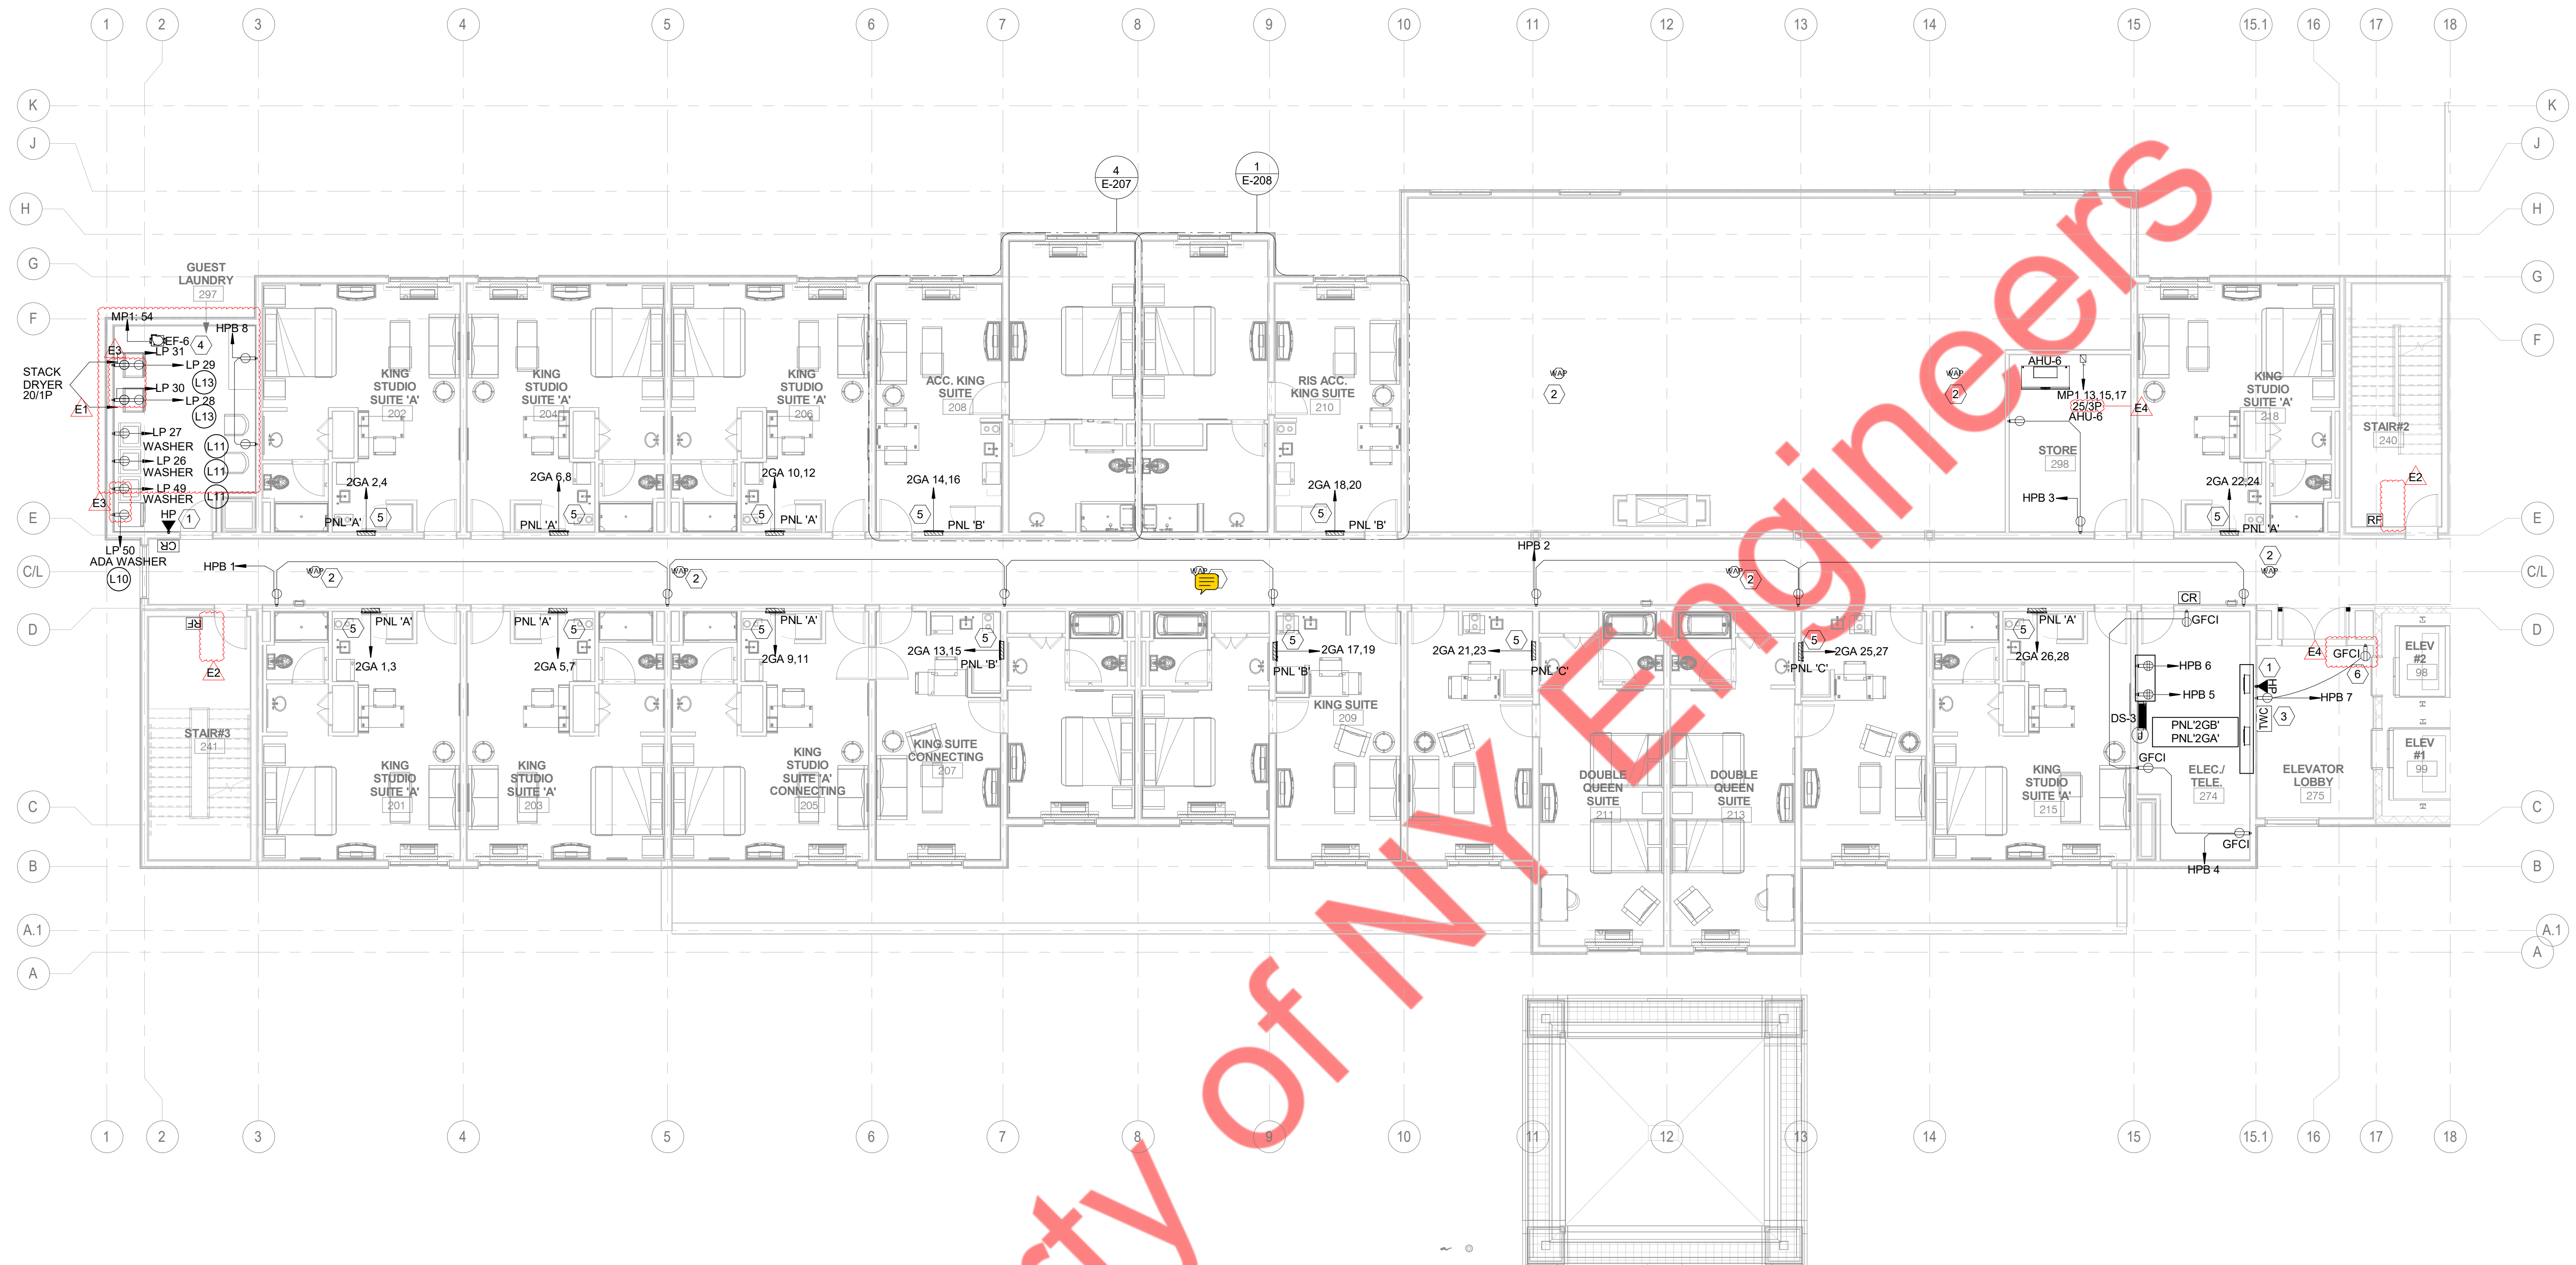


1 2ND FLOOR POWER PLAN-A
1/8" = 1'-0"

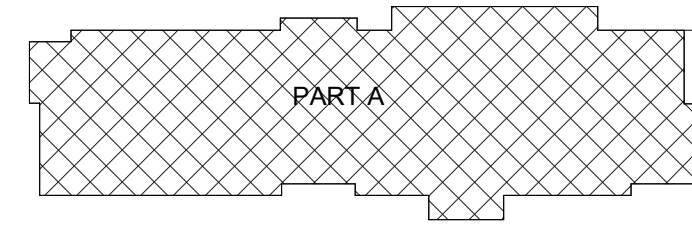

Property of NY Engineers


202A - KEY NOTES	
#	Text
1	HOUSE PHONE ONLY W/AUTOMATIC DIAL TO FRONT DESK.
2	WIRELESS ACCESS POINT ABOVE CEILING IN ACCESSIBLE LOCATION SITE SURVAY SHALL BE COMPLETED BY THE TECHNOLOGY CONTRACTOR TO DETERMINE BEST LOCATION FOR EACH ZONE. PREFERRED LOCATION IN GUESTROOM IS IN GUEST CLOSET.
3	PROVIDE TWO WAY COMMUNICATION SYSTEM AT ELEVATOR LANDING ON EACH ACCESSIBLE FLOOR THAT IS ONE OR MORE STORIES ABOVE OR BELOW THE STORY OF EXIT DISCHARGE . COMPLY WITH IBC SECTION 1009.8.1 AND 1009.8.2. AS PER IBC SECTION 1009.08.1 TWO WAY COMMUNICATION SYSTEM SHALL PROVIDE COMMUNICATION BETWEEN EACH REQUIRED LOCATION AND THE FIRE COMMAND CENTER OR A INTERNAL CONTROL POINT LOCATION APPROVED BY THE FIRE DEPARTMENT. WHERE THE CENTRAL CONTROL POINT IS NOT CONSTANTLY ATTENDED A TWO WAY COMMUNICATION SYSTEM SHALL HAVE A TIMED AUTOMATIC TELEPHONE DIAL OUT CAPABILITY TO A MONITORING LOCATION OR 911. THE TWO WAY COMMUNICATION SYSTEM SHALL INCLUDE BOTH AUDIBLE AND VISIBLE SIGNALS. AS PER IBC SECTION 1009.8.2 DIRECTION FOR THE USE OF TWO WAY COMMUNICATION SYSTEM INSTRUCTION FOR SUMMONING ASSISTANCE VIA THE TWO WAY COMMUNICATION SYSTEM AND WRITTEN IDENTIFICATION OF THE LOCATION SHALL BE POSTED ADJACENT TO THE TWO WAY COMMUNICATION SYSTEM. CONTRACTOR SHALL ALSO VERIFY TWO WAY COMMUNICATION AS PER IBC SECTION 3008.6.6.
4	EXHAUST FANS ARE CONNECTED THROUGH HARD WIRE CONNECTION.PROVIDE HARD WIRE CONNECTION TO EXHAUST FAN CONTRACTOR SHALL CO-ORDINATE WITH MECHANICAL VENDOR FOR EXACT LOCATION AND REQUIREMENT.
5	GUEST ROOM PANEL BOARD SHALL BE FLUSH MOUNTED ON WALL AND MAINTAIN MIN. 2HR FIRE RESISTANCE RATING OF THE WALL. CONTRACTOR SHALL REFER DETAIL 1 ON SHEET E-104. CONTRACTOR SHALL MAINTAIN MIN CLEAR SPACE REQUIRED AS PER NEC. ARTICLE 110.26
6	CONTRACTOR SHALL PROVIDE CONVENIENCE OUTLETS WITH GFCI PROTECTION AS PER NEC


E4

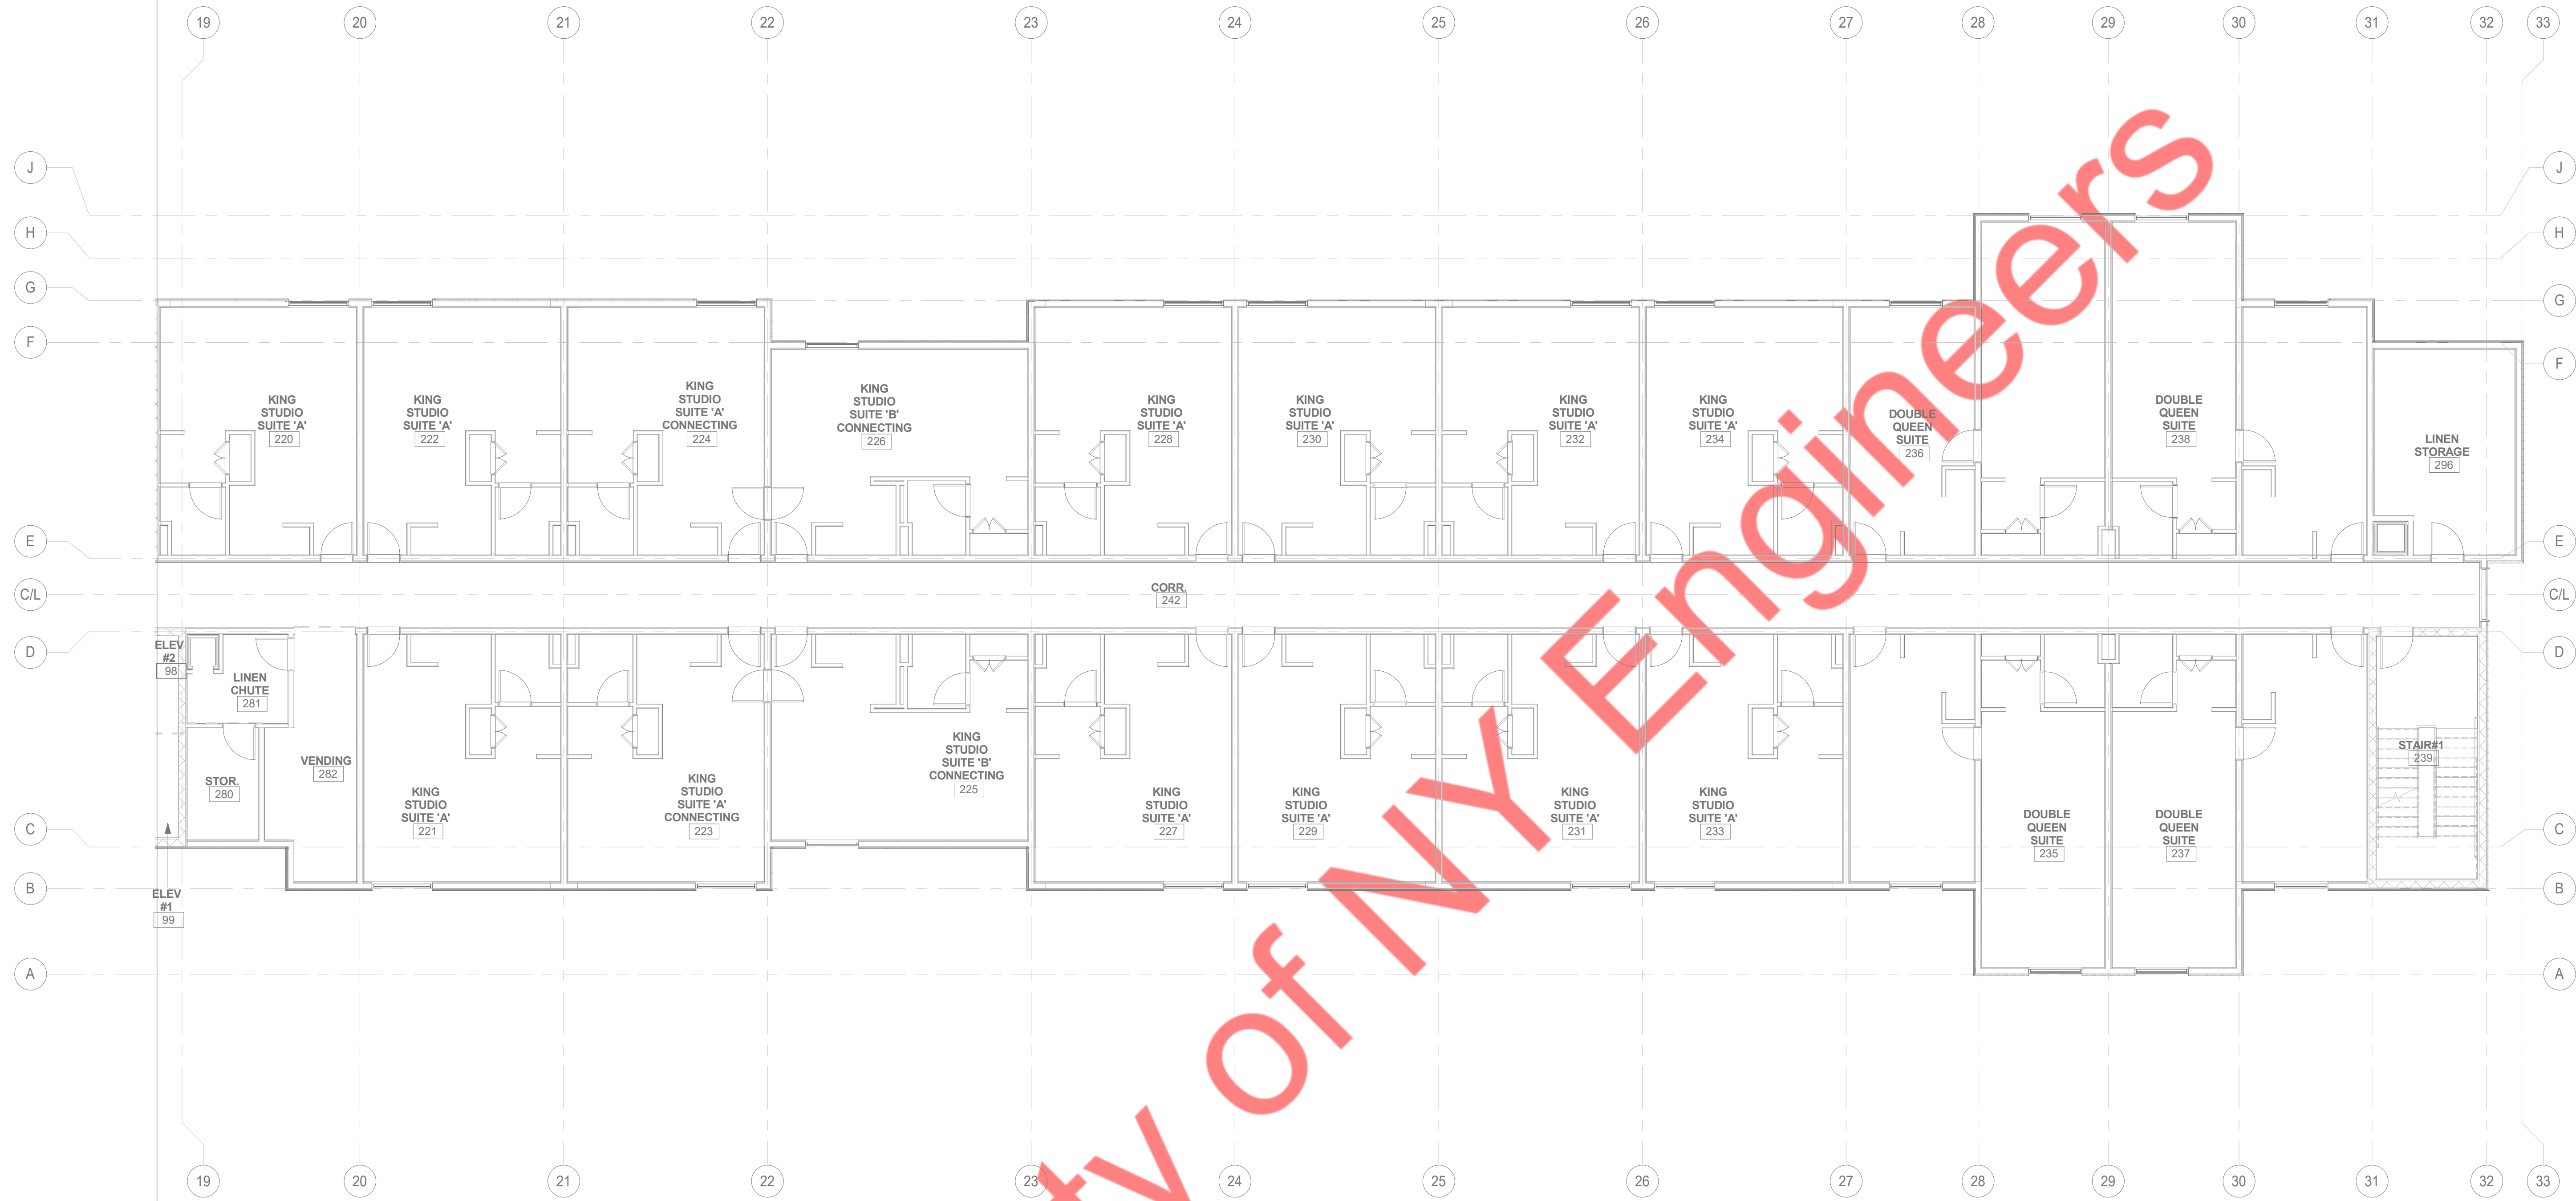

1 2ND FLOOR POWER PLAN-B
 1/8" = 1'-0"

Property of NY Engineers

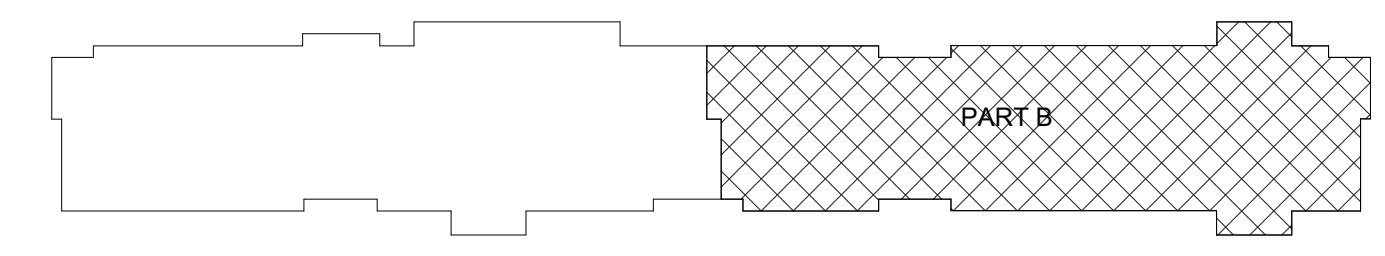

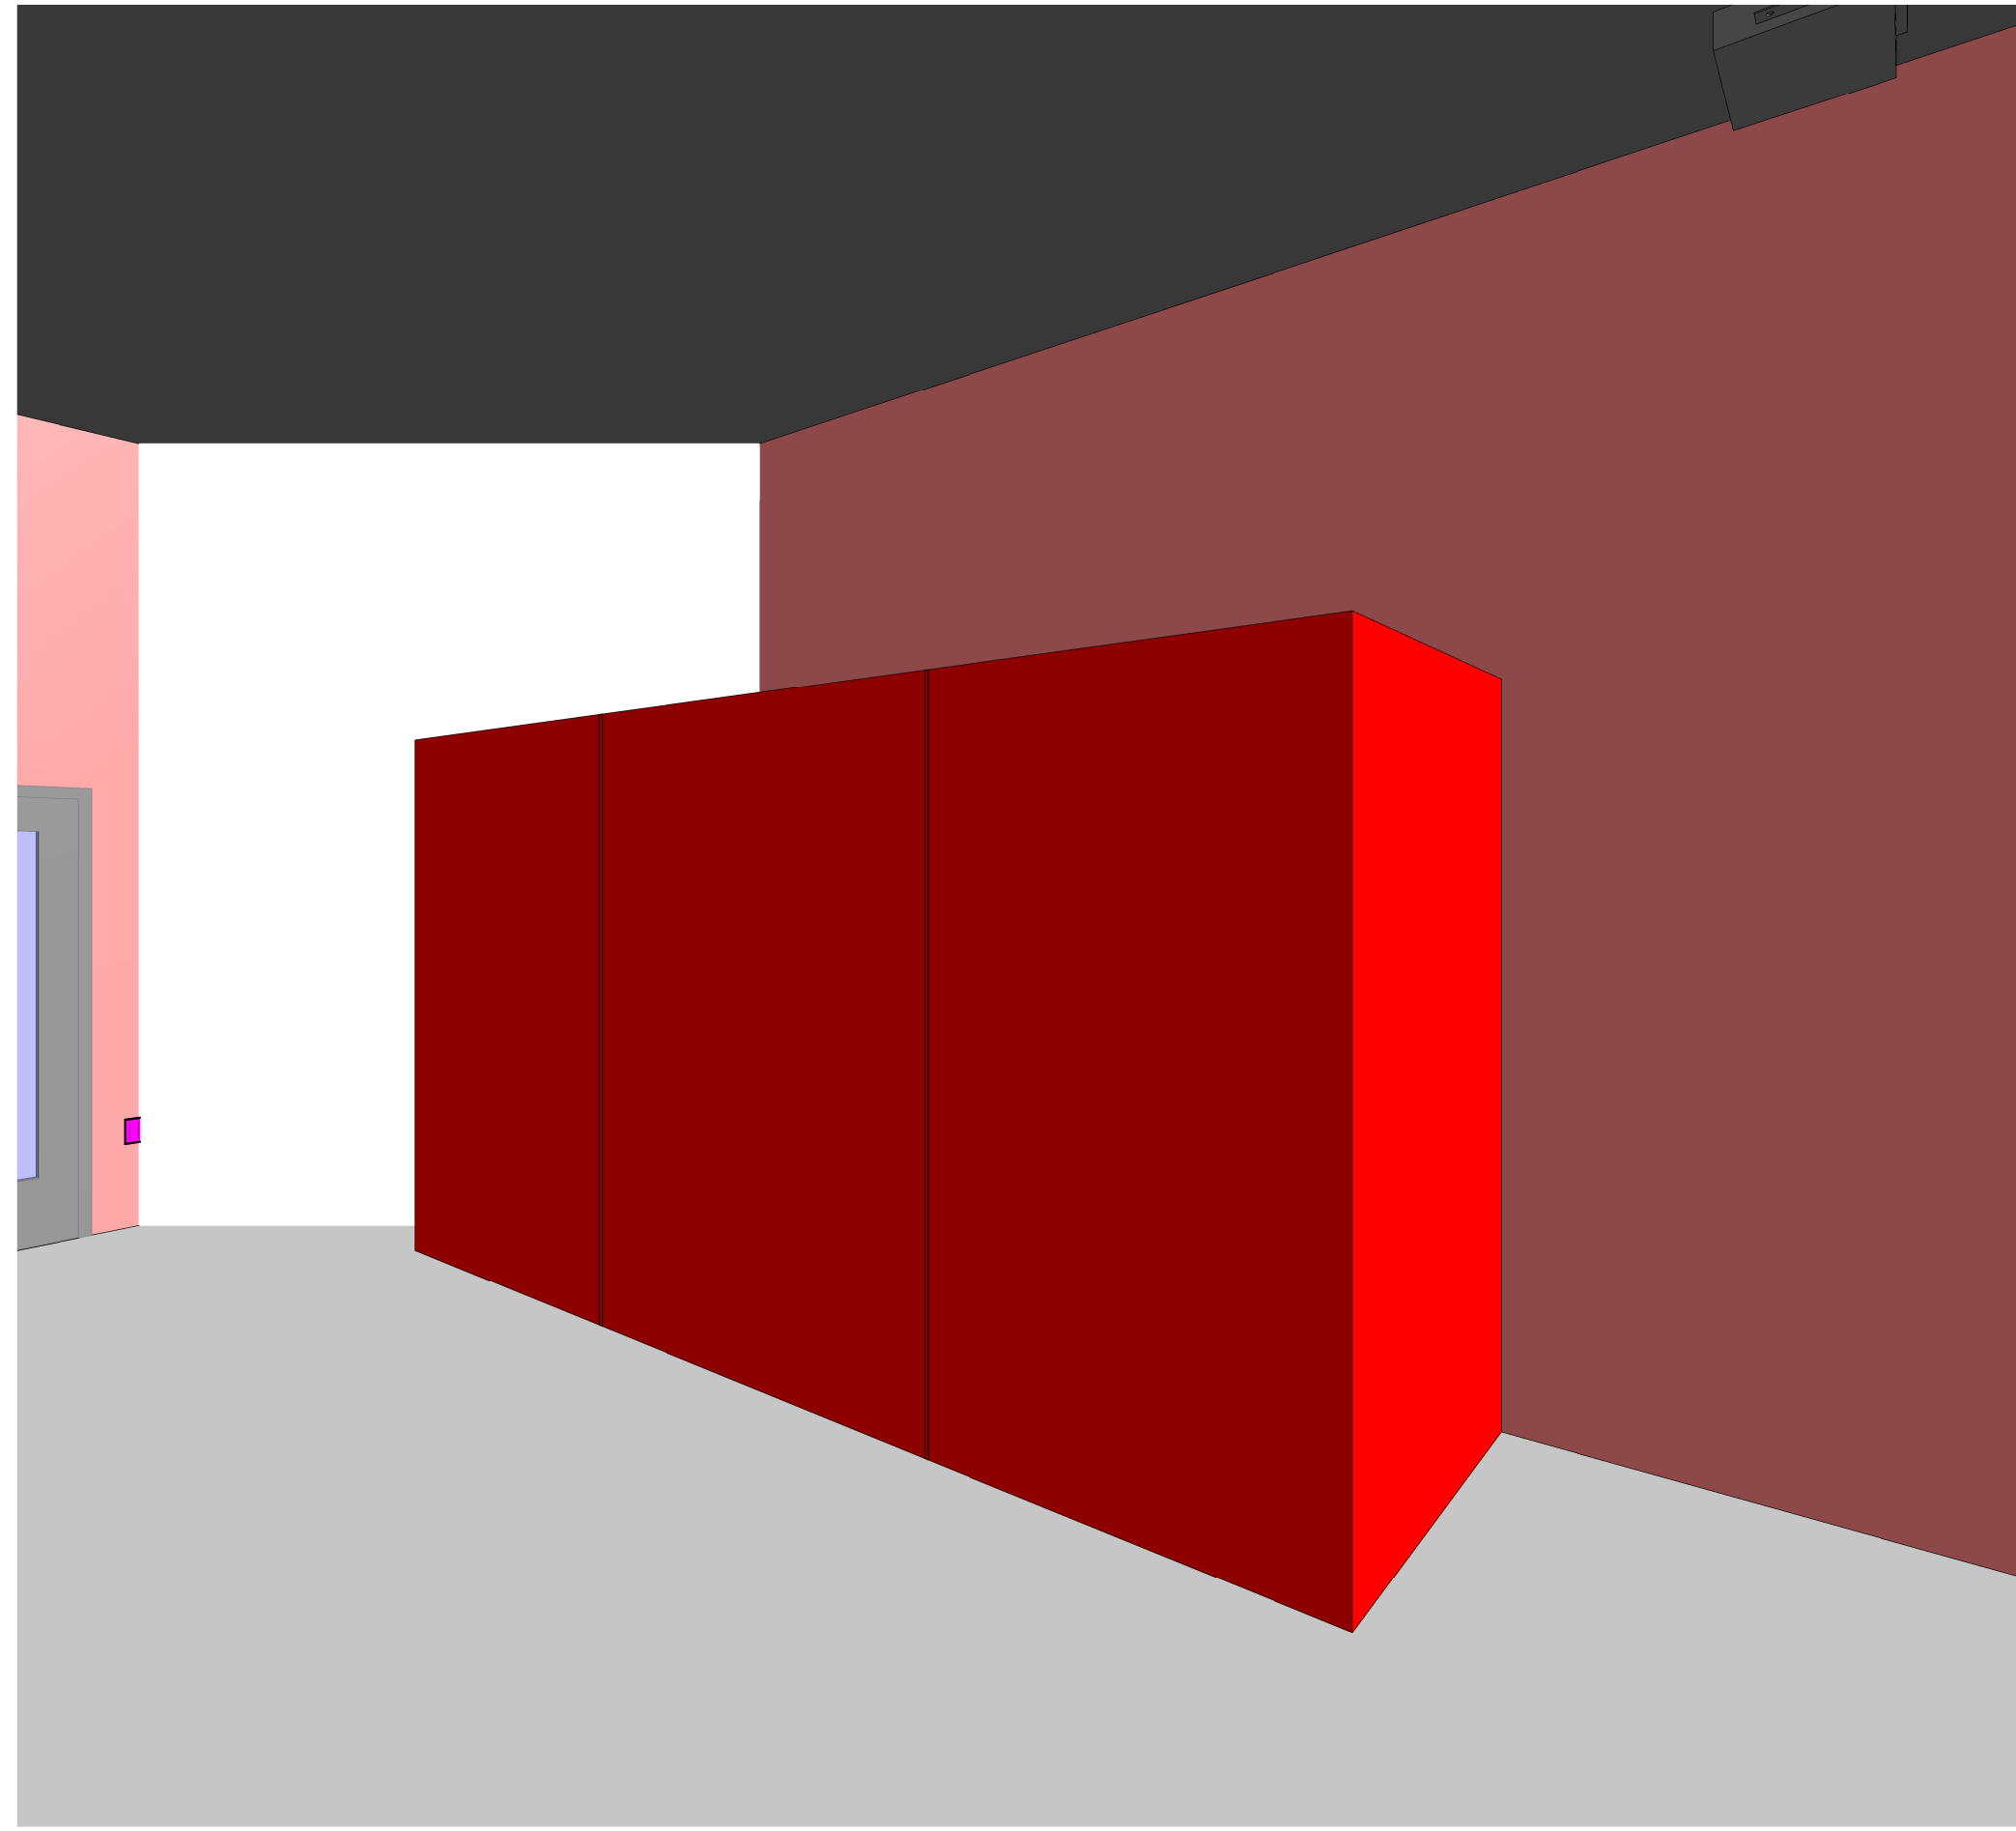

① 3D ELECTRICAL ROOM




② 3D FITNESS AREA




③ 3D FOOD PREPARATION AREA




④ 3D PANTRY AREA

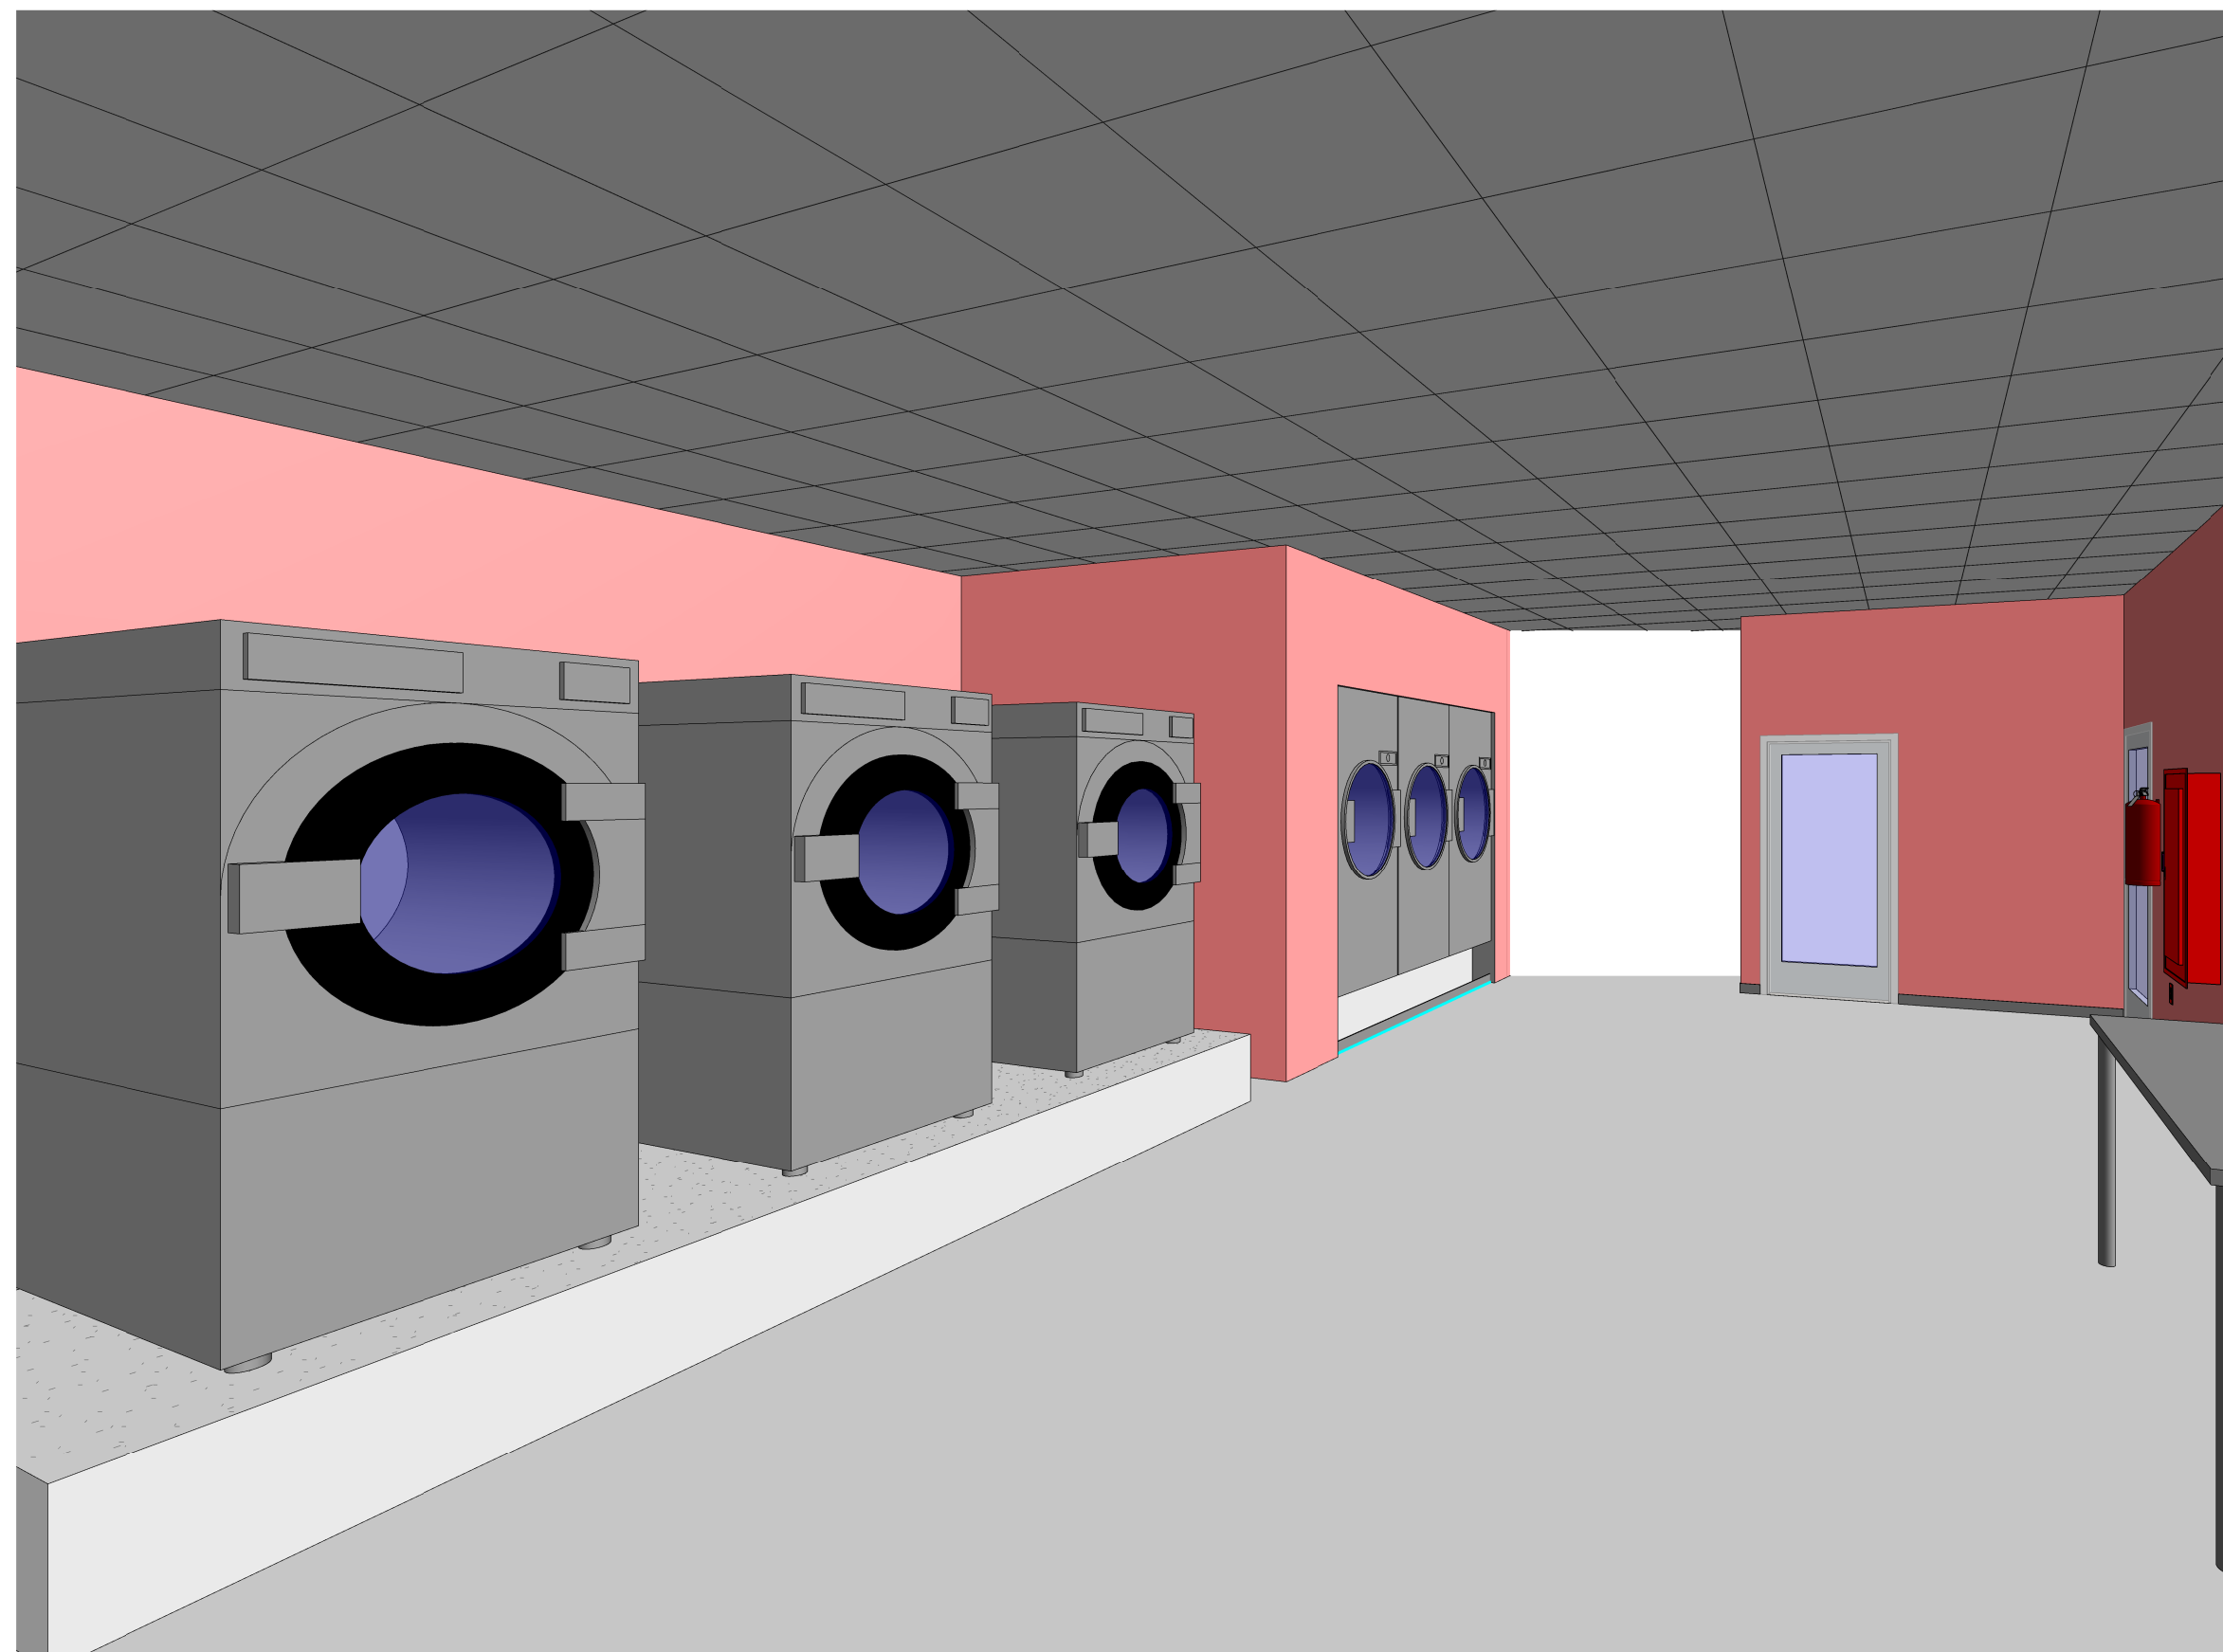

① 3D LAUNDRY AREA

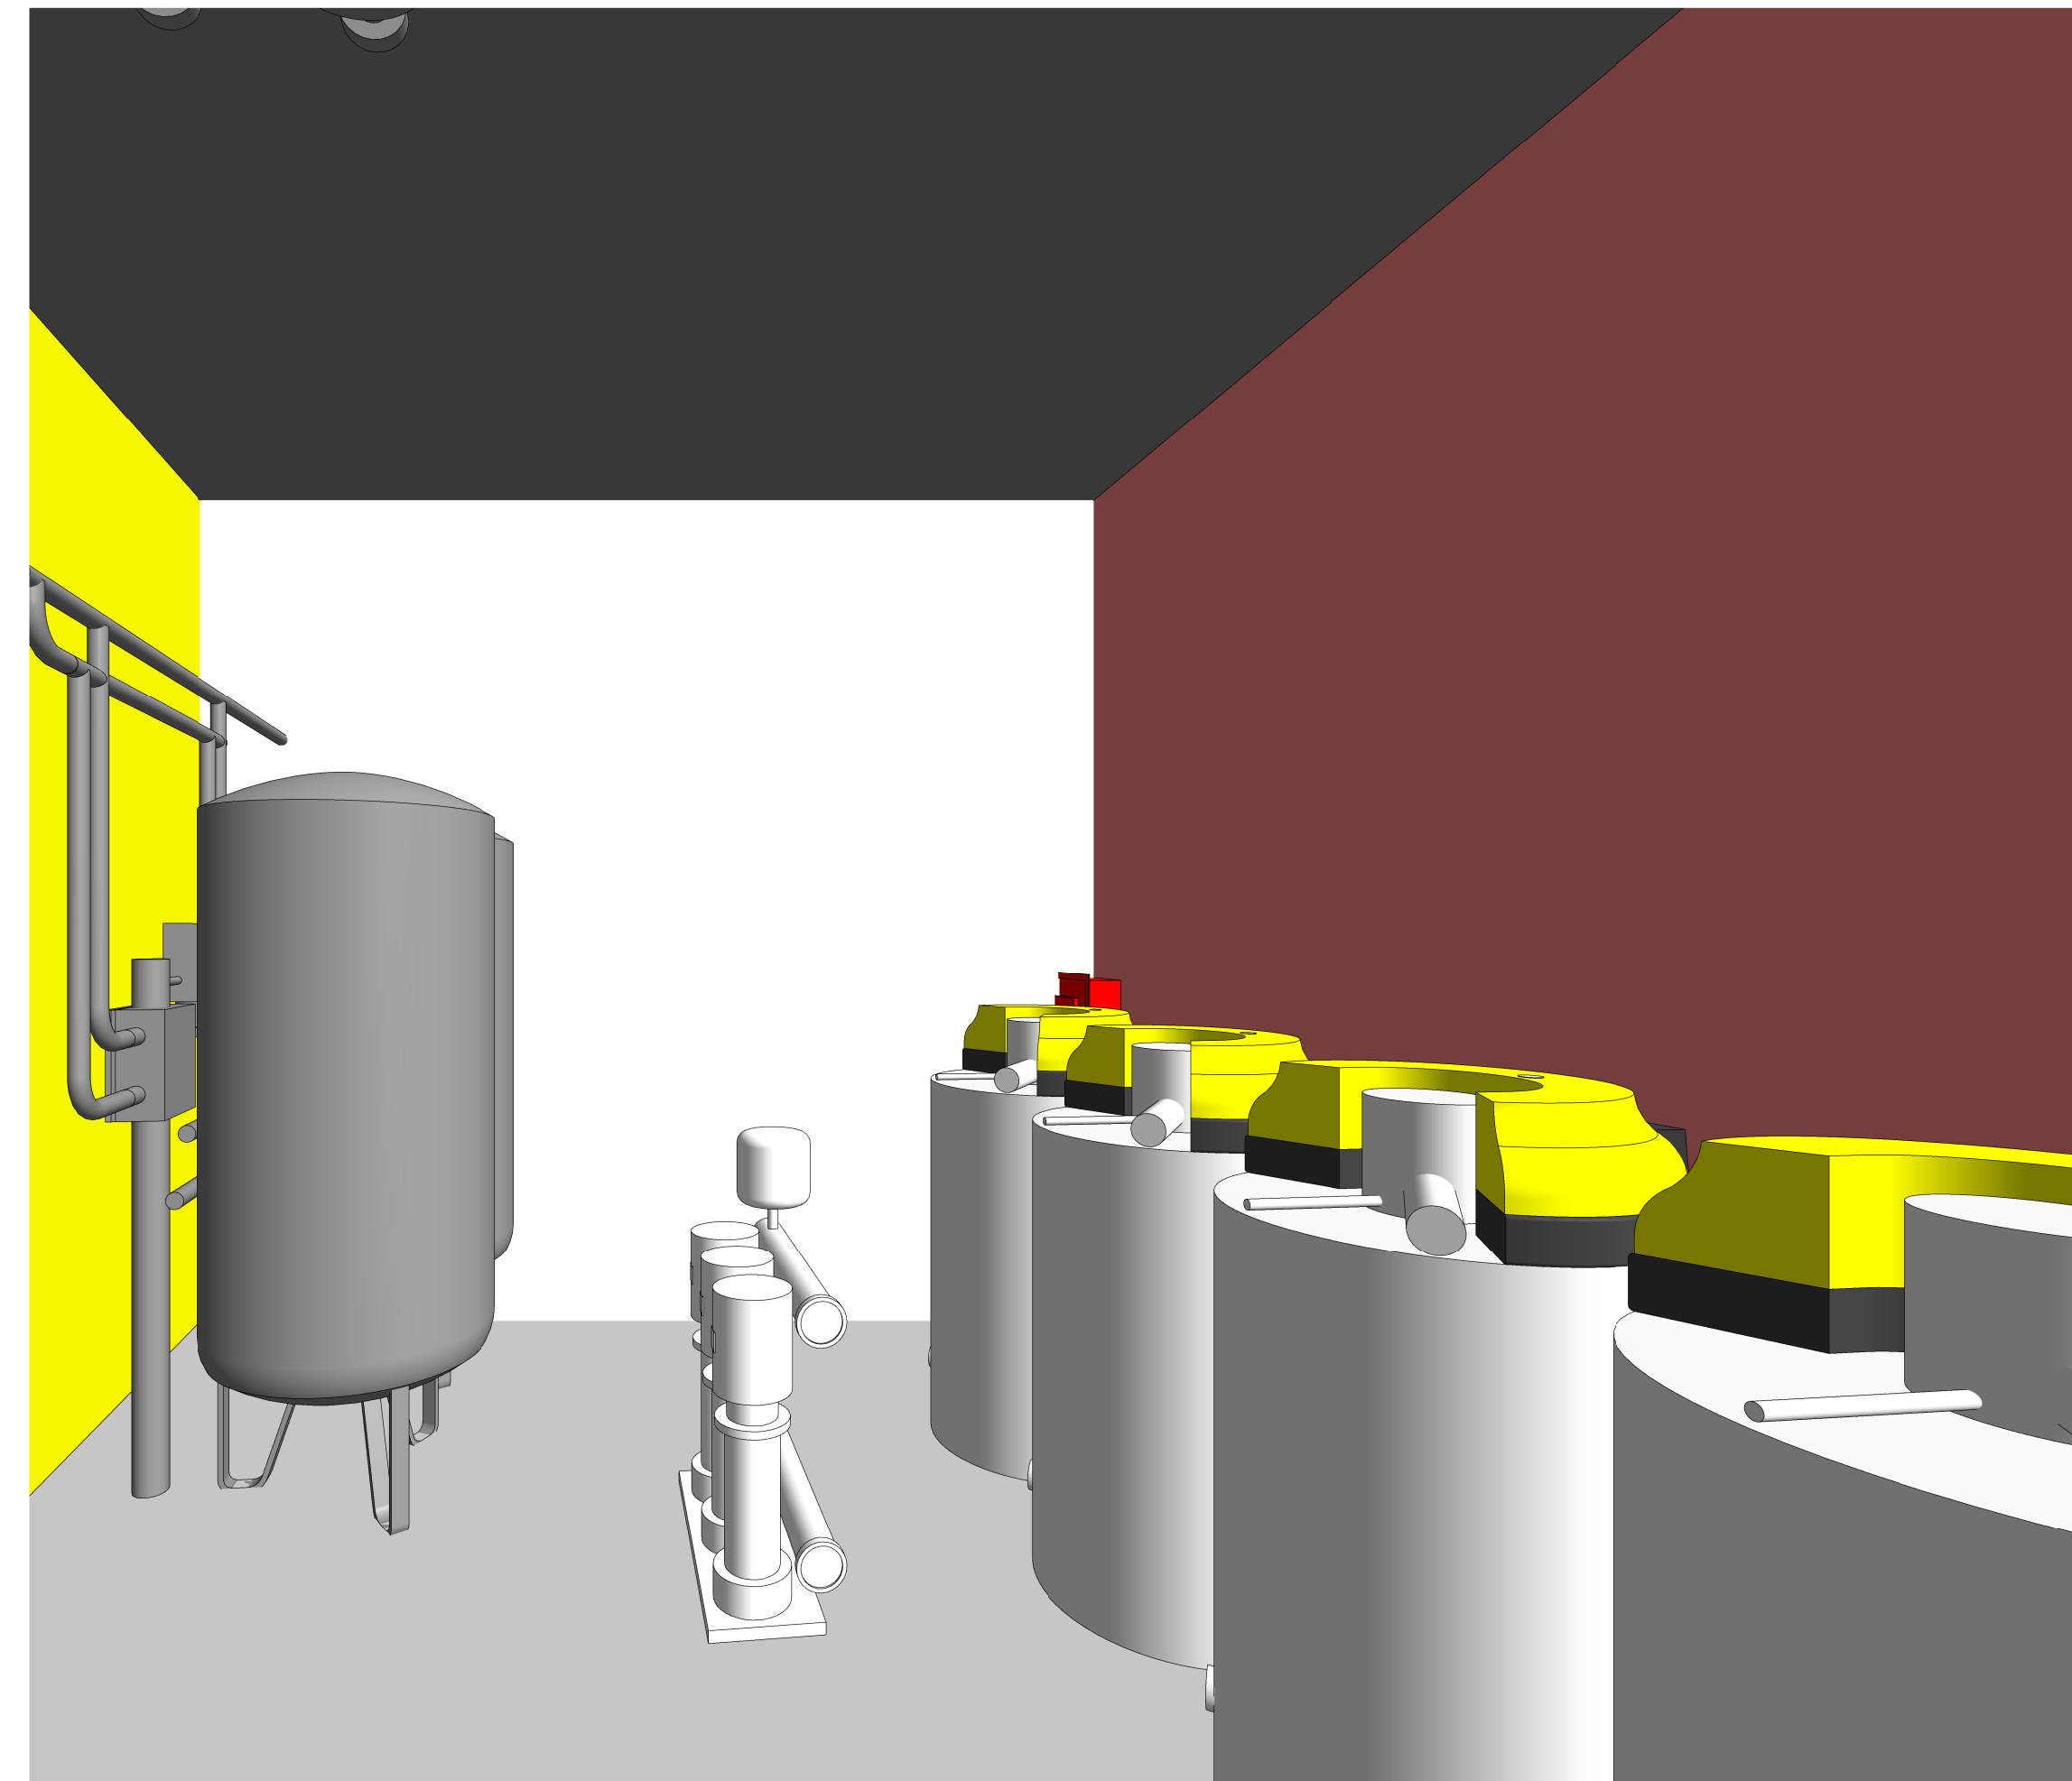

② 3D MECHANICAL ROOM

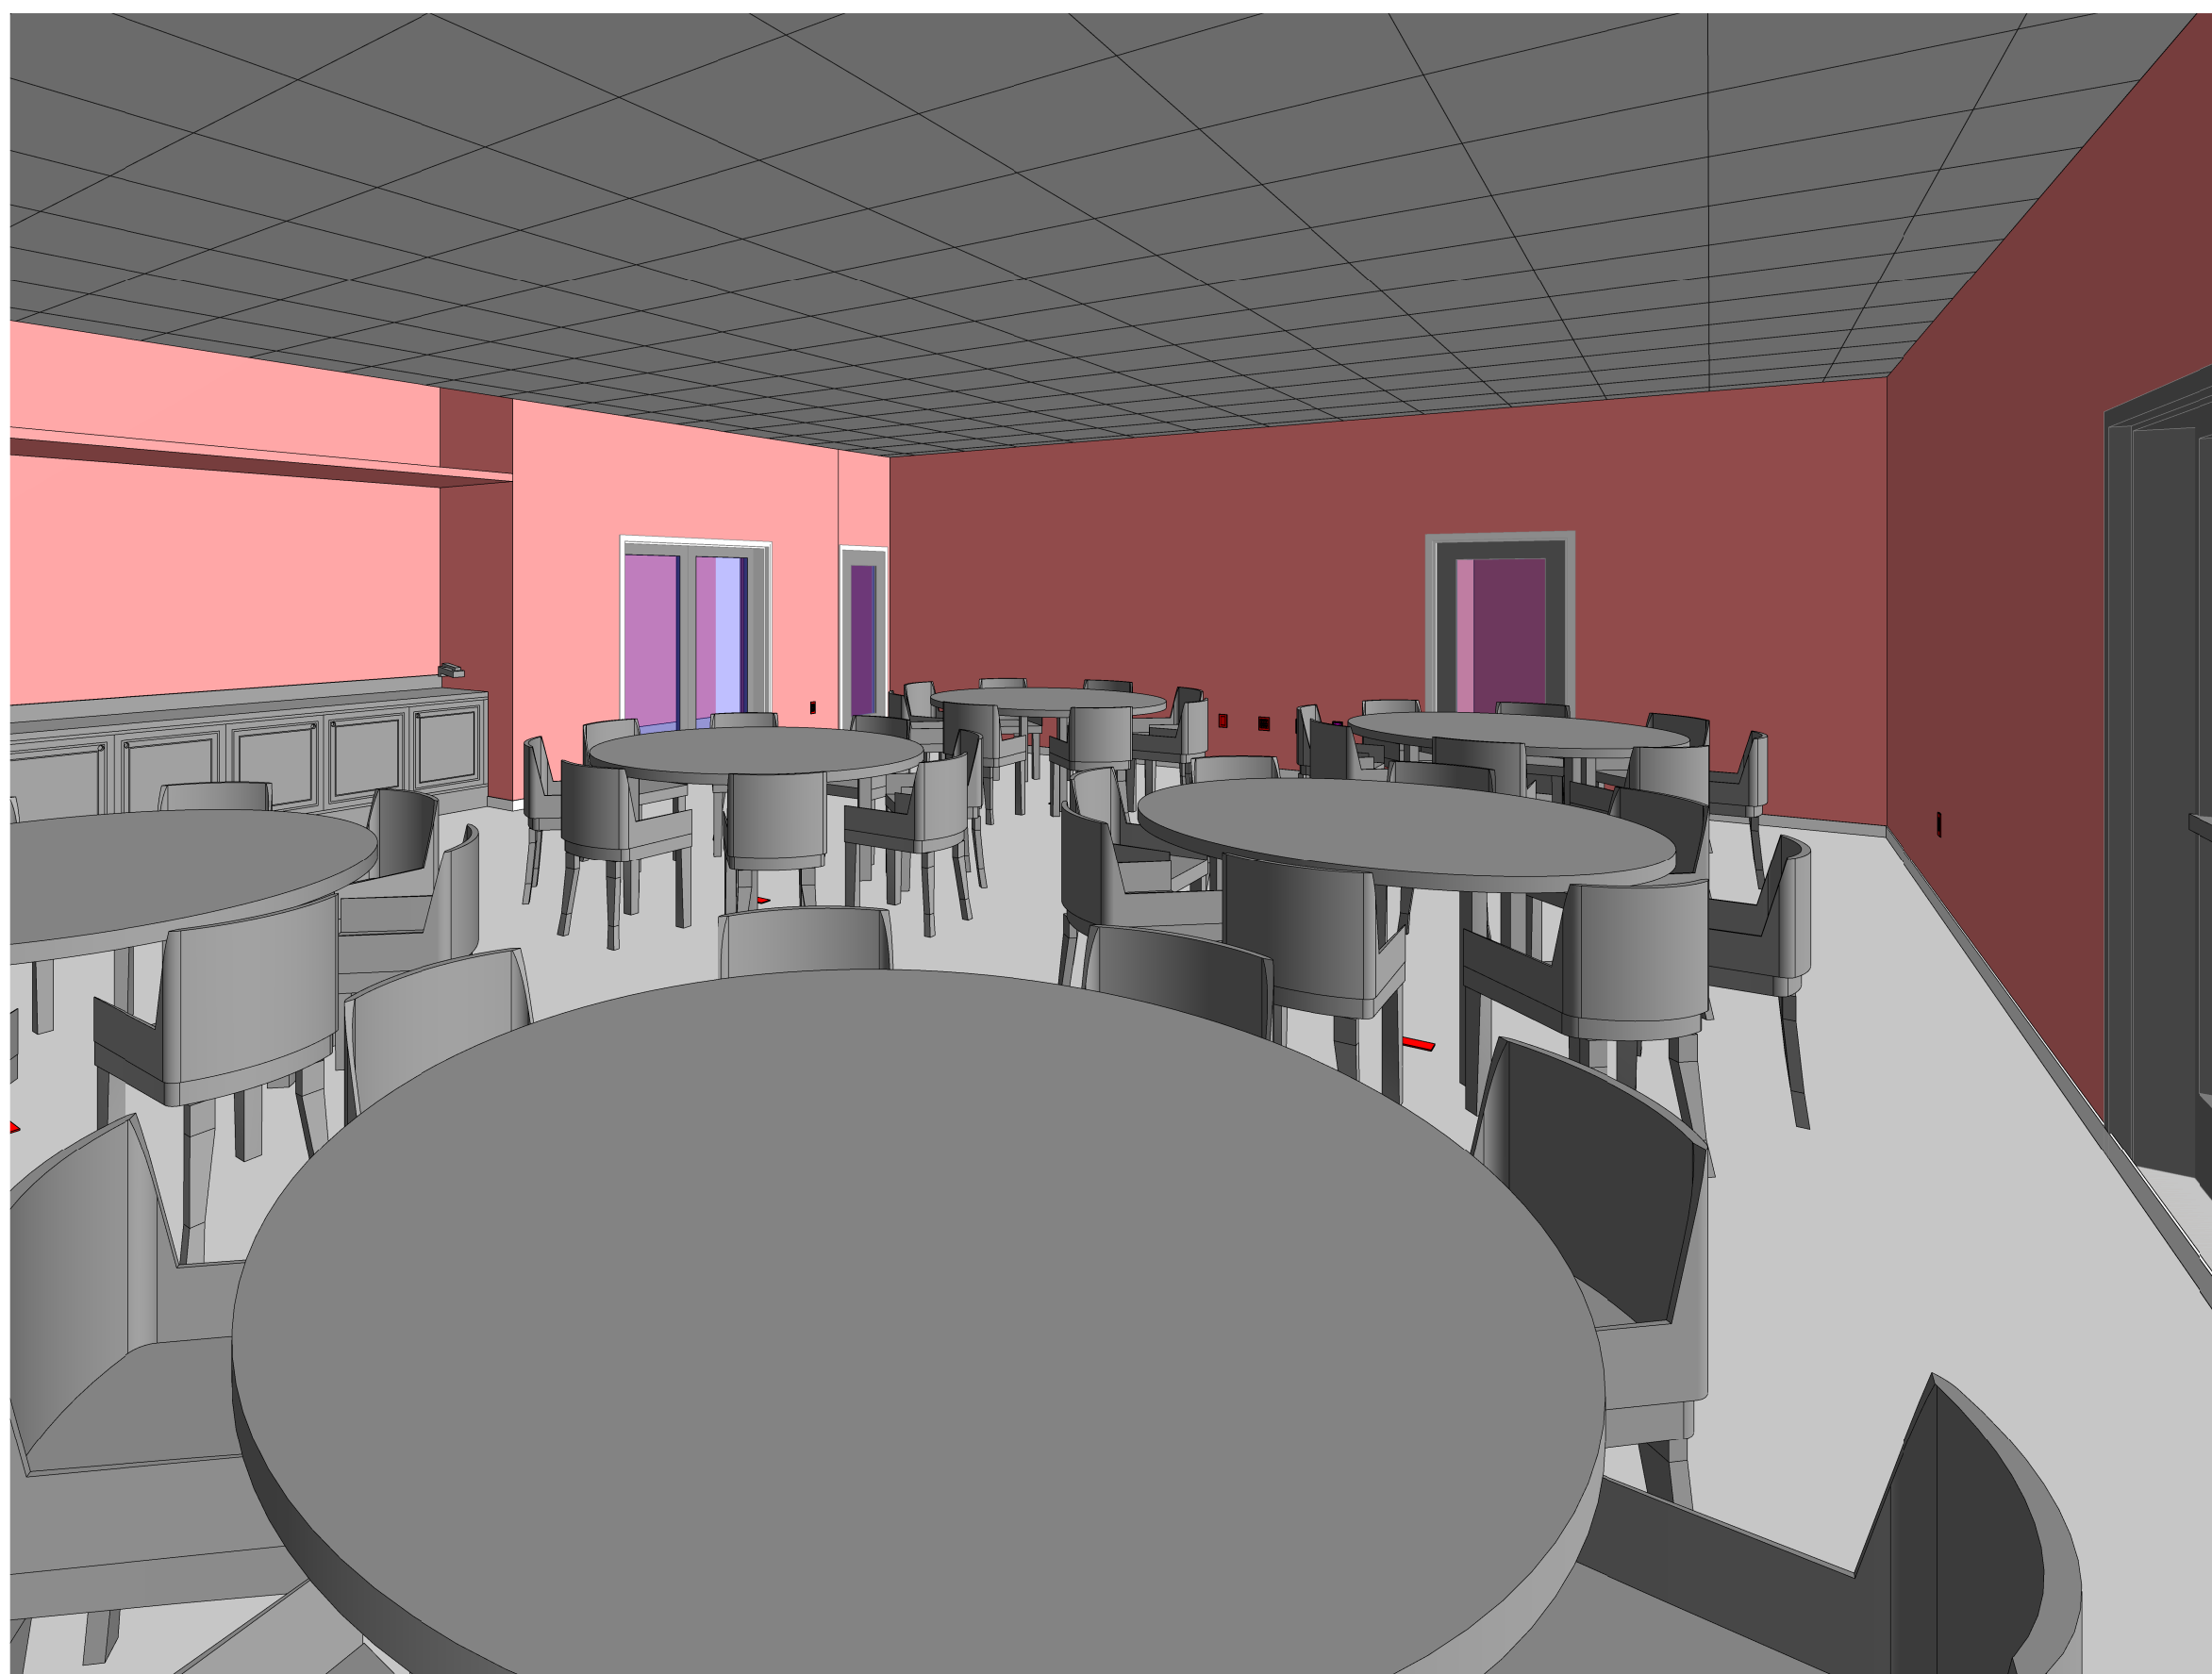

③ 3D MEETING ROOM

NOT IN USE