



2 1ST FLOOR LIGHTING PLAN  
1/4" = 1'-0"

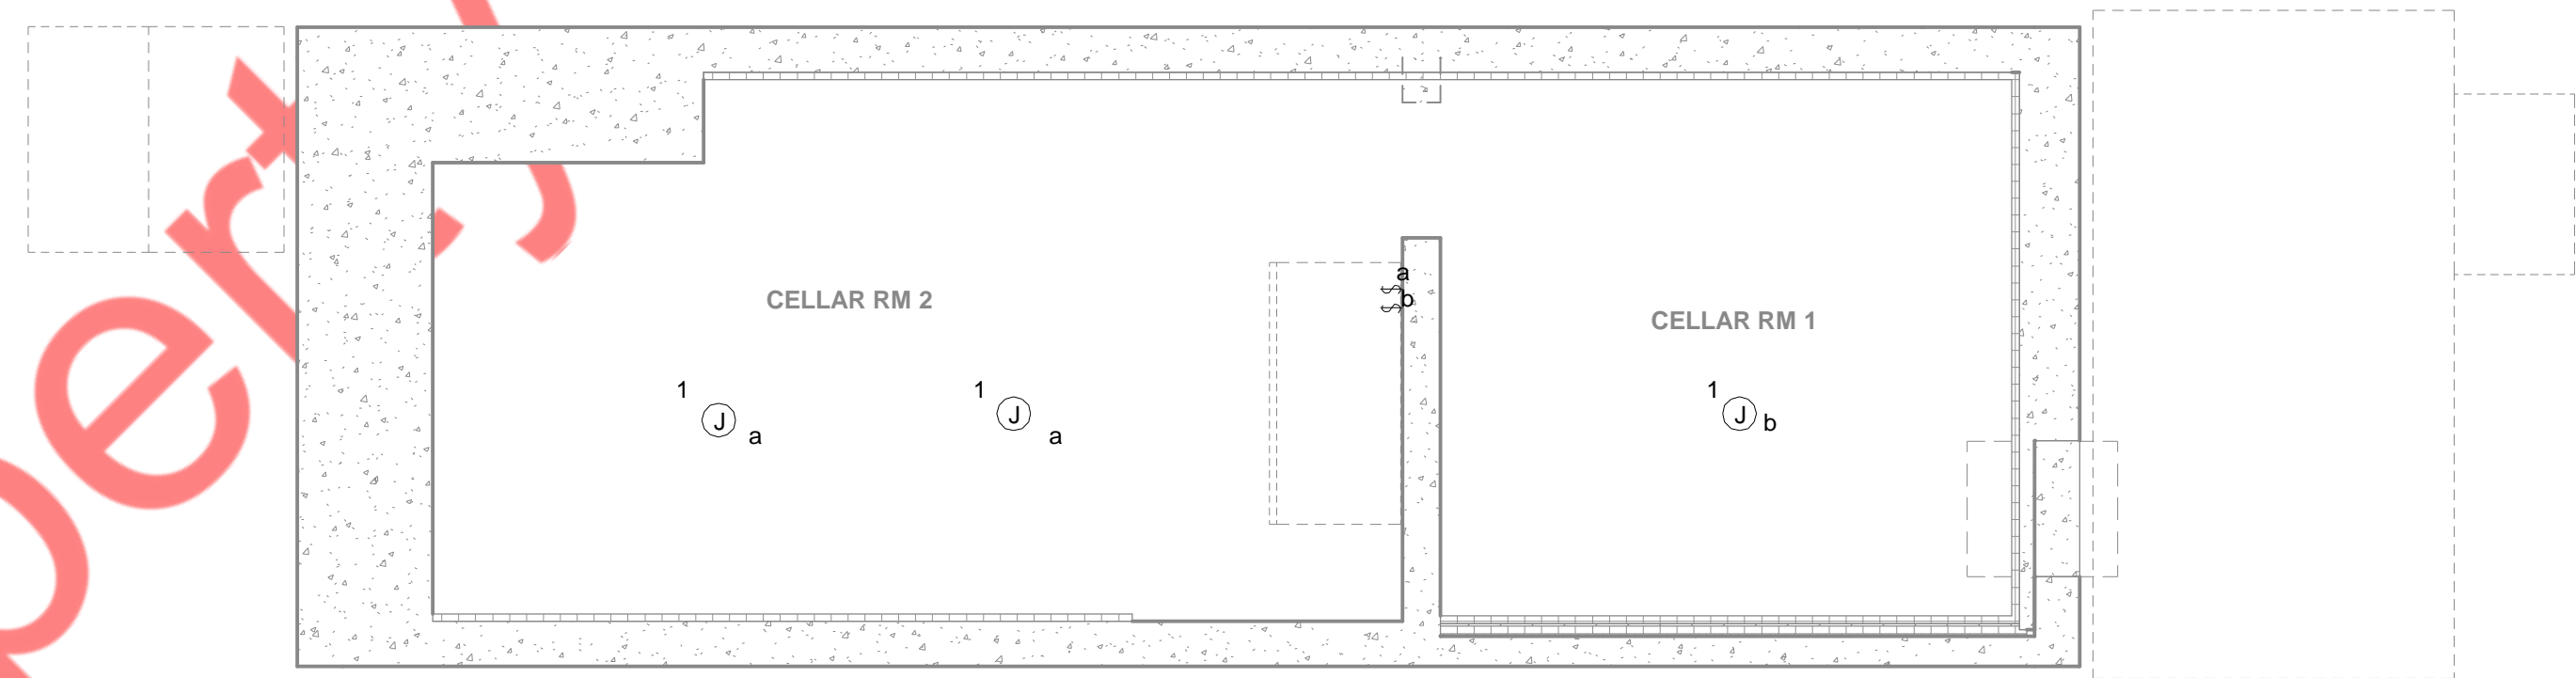

1 CELLAR LIGHTING PLAN  
1/4" = 1'-0"

LIGHTING DRAWING NOTES:


1. REFER TO DWG. E-001.00 FOR ELECTRICAL GENERAL NOTES, SYMBOL LIST AND ABBREVIATIONS.
2. ALL BRANCH CIRCUITS HOMERUNS ASSIGN INDICATED ON THIS PLAN SHALL BE CIRCUITED TO THE PANEL 'AP-1', CIRCUIT NUMBER INDICATED, U.O.N.
3. CIRCUITING FOR LIGHTING FIXTURES IN ROOMS WITH TOGGLE SWITCHES SHALL BE CONTROLLED BY DESIGNATED SWITCHES. IF SPECIFIC DESIGNATION IS NOT INDICATED, ALL LIGHTING FIXTURES IN ROOM/AREA SHALL BE CONTROLLED BY THE SWITCH INDICATED.
4. REFER DWG E-002.00 FOR LIGHTING CONTROL NOTES.

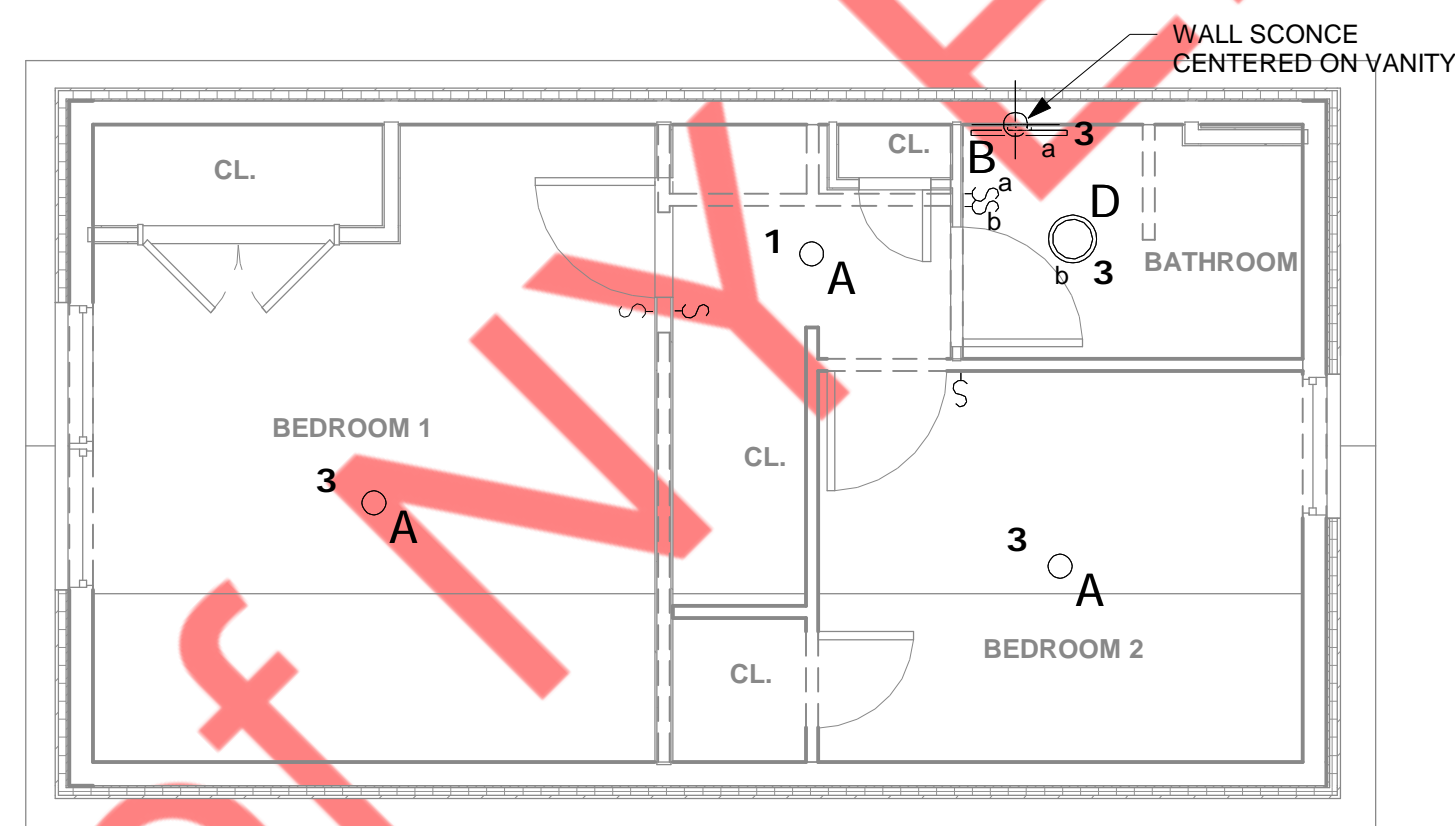


1 2ND FLOOR LIGHTING PLAN  
1/4" = 1'-0"

LIGHTING DRAWING NOTES:

1. REFER TO DWG. E-001.00 FOR ELECTRICAL GENERAL NOTES, SYMBOL LIST AND ABBREVIATIONS.
2. ALL BRANCH CIRCUITS HOMERUNS ASSIGN INDICATED ON THIS PLAN SHALL BE CIRCUITED TO THE PANEL 'AP-1', CIRCUIT NUMBER INDICATED, U.O.N.
3. CIRCUITING FOR LIGHTING FIXTURES IN ROOMS WITH TOGGLE SWITCHES SHALL BE CONTROLLED BY DESIGNATED SWITCHES. IF SPECIFIC DESIGNATION IS NOT INDICATED, ALL LIGHTING FIXTURES IN ROOM/AREA SHALL BE CONTROLLED BY THE SWITCH INDICATED.
4. REFER DWG E-002.00 FOR LIGHTING CONTROL NOTES.

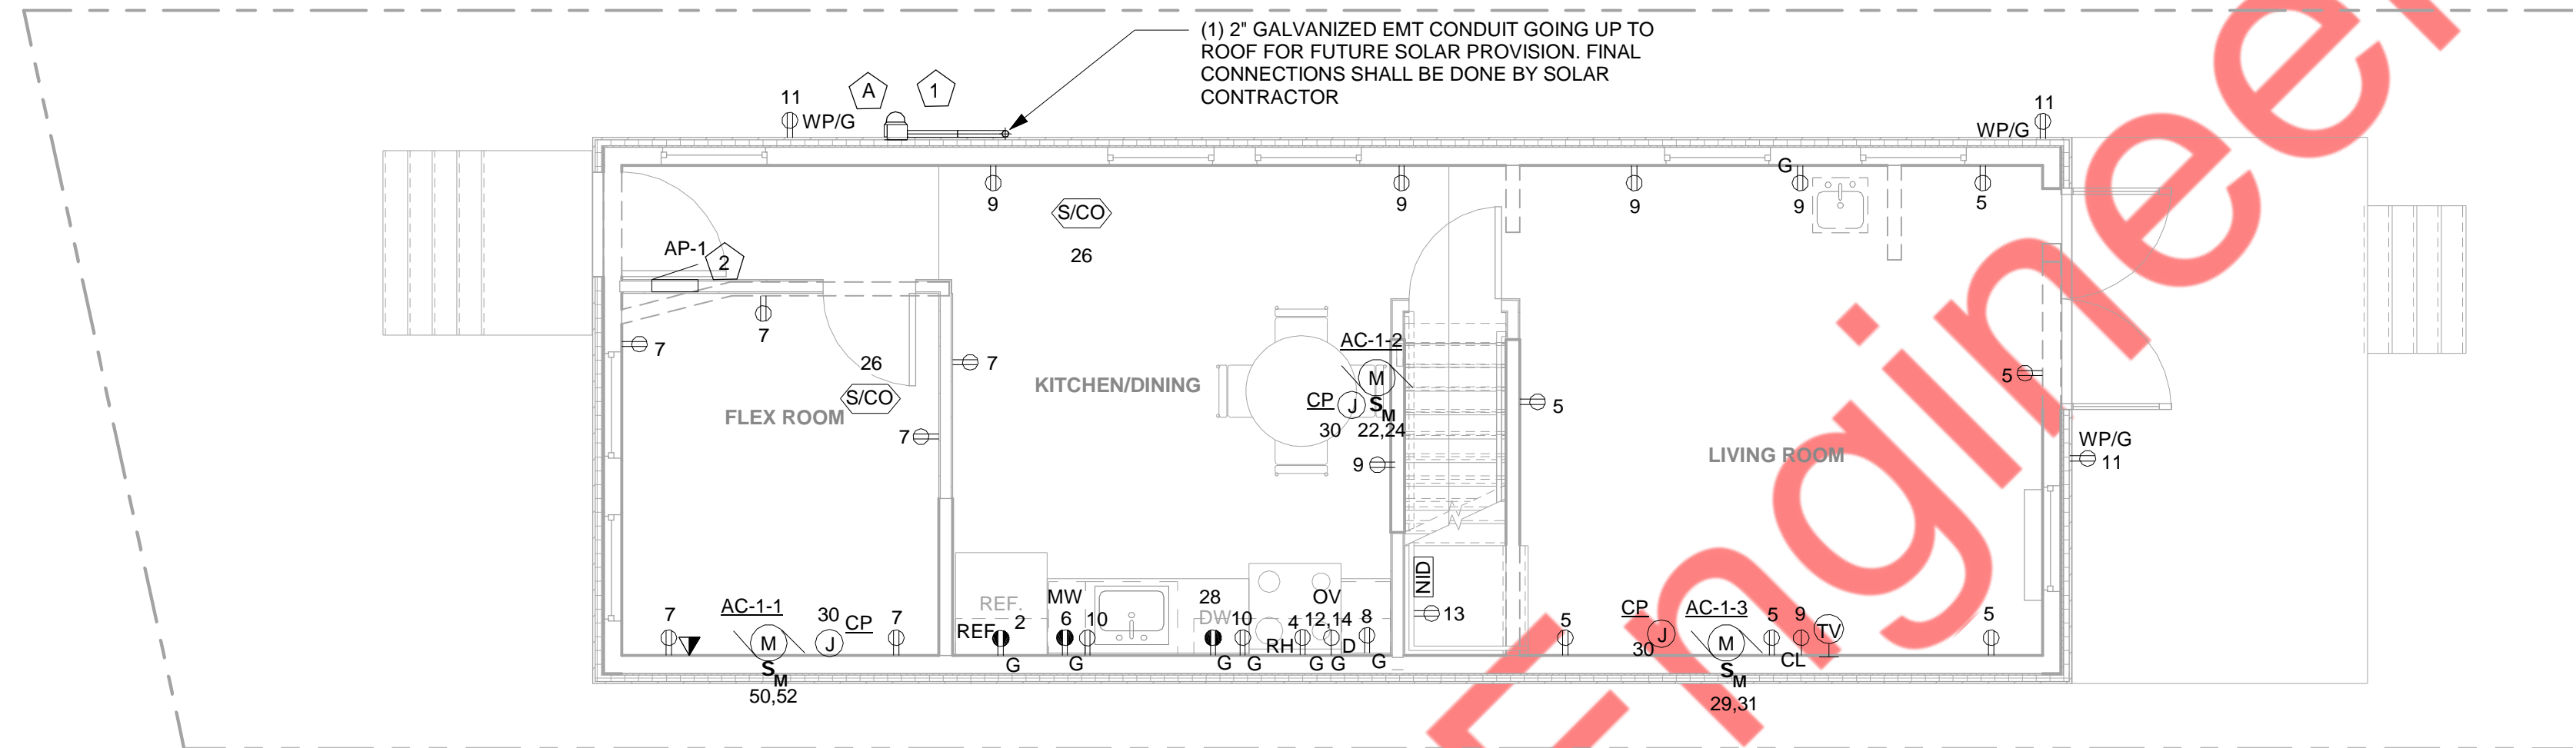

2 1ST FLOOR ELECTRICAL POWER PLAN  
1/4" = 1'-0"

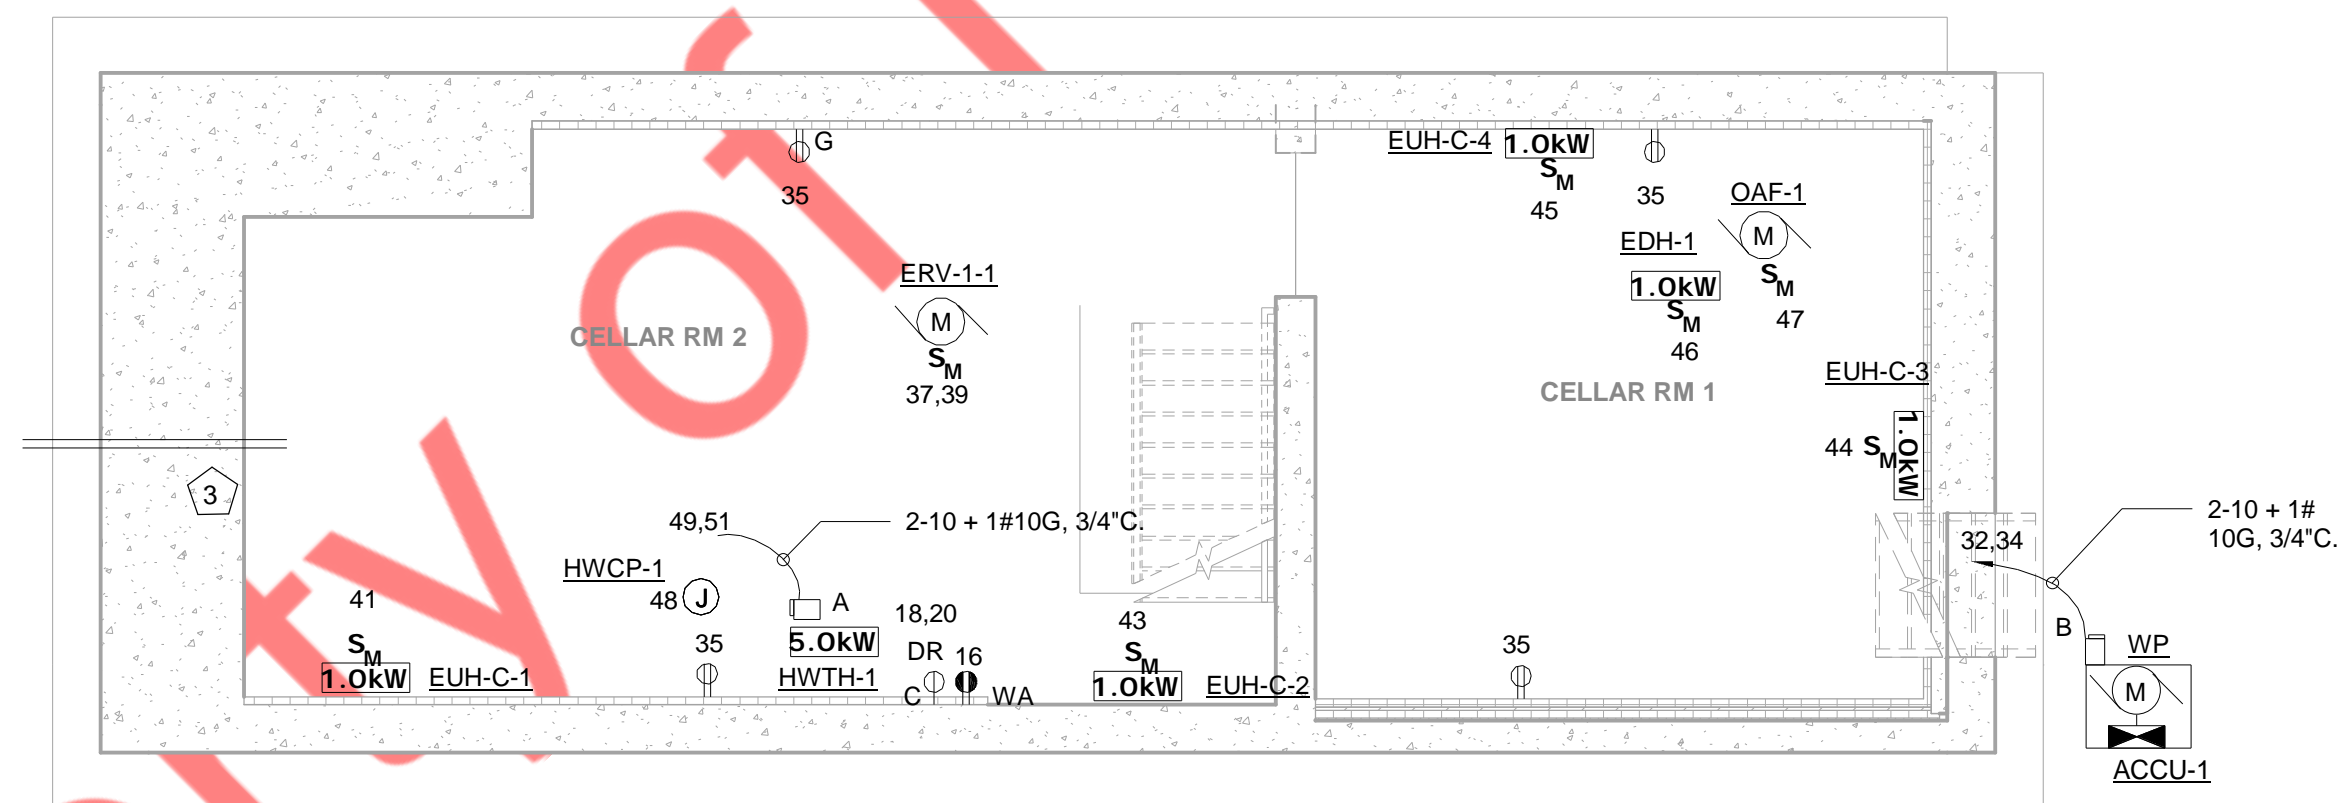

1 CELLAR ELECTRICAL POWER PLAN  
1/4" = 1'-0"

#### ELECTRICAL LEGEND:


1. WALL MOUNTED 200A ELECTRIC METER AND DISCONNECT SWITCH STACKED. REFER ELECTRICAL DETAIL 3/E-400.00 FOR MORE INFORMATION
2. 200A-SINGLE PHASE RECESSED PANEL
3. INCOMING (1) 2" TELECOM CONDUIT

#### POWER DRAWING NOTES:


1. REFER TO DWG. E-001.00 FOR ELECTRICAL GENERAL NOTES, SYMBOL LIST & ABBREVIATIONS. E-003 & E-004 FOR ADDITIONAL ELECTRICAL SPECIFICATIONS
2. ALL BRANCH CIRCUITS HOMERUNS ASSIGN INDICATED ON THIS PLAN SHALL BE CIRCUITED TO THE PANEL 'AP-1', CIRCUIT NUMBER INDICATED, U.O.N.
3. ELECTRICAL CONTRACTOR TO COORDINATE THE LOCATION OF S/CO DETECTORS WITH THE ARCHITECT.

#### KEYED WORK NOTE:

- A. PROVIDE NEMA 3R ENCLOSURE FOR OUTDOOR DISCONNECT SWITCH AND METER.

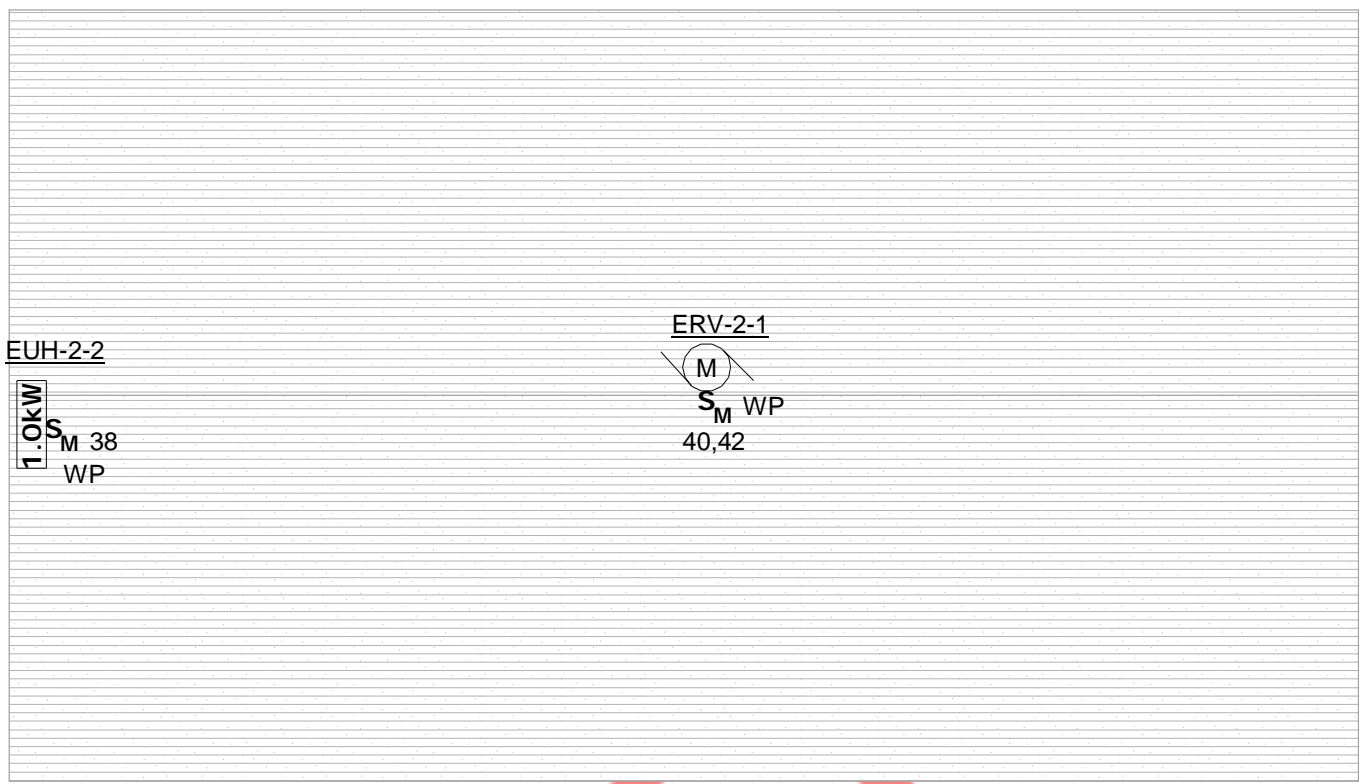

2 ATTIC  
1/4" = 1'-0"

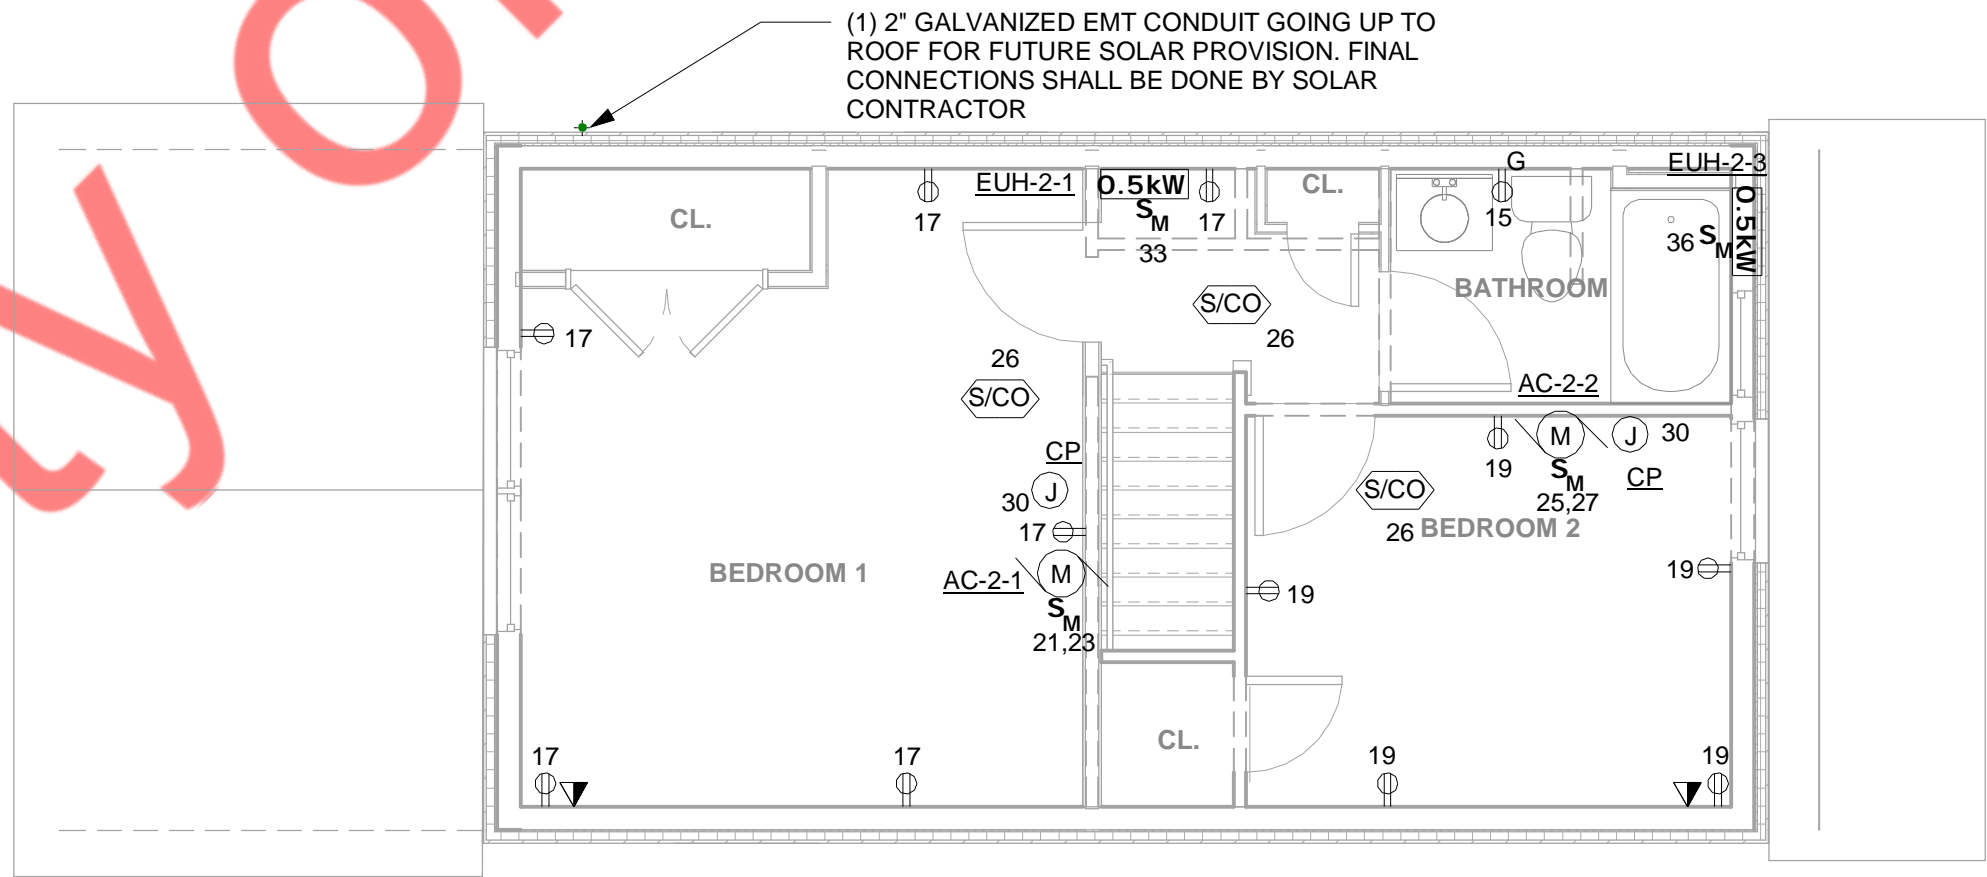

1 2ND FLOOR ELECTRICAL POWER PLAN  
1/4" = 1'-0"

POWER DRAWING NOTES:

1. REFER TO DWG. E-001.00 FOR ELECTRICAL GENERALNOTES, SYMBOL LIST & ABBREVIATIONS. E-003 & E-004FOR ADDITIONAL ELECTRICAL SPECIFICATIONS
2. ALL BRANCH CIRCUITS HOMERUNS ASSIGN INDICATED ON THIS PLAN SHALL BE CIRCUITED TO THE PANEL 'AP-1', CIRCUIT NUMBER INDICATED, U.O.N.
3. ELECTRICAL CONTRACTOR TO COORDINATE THE LOCATION OF S/CO DETECTORS WITH THE ARCHITECT.