


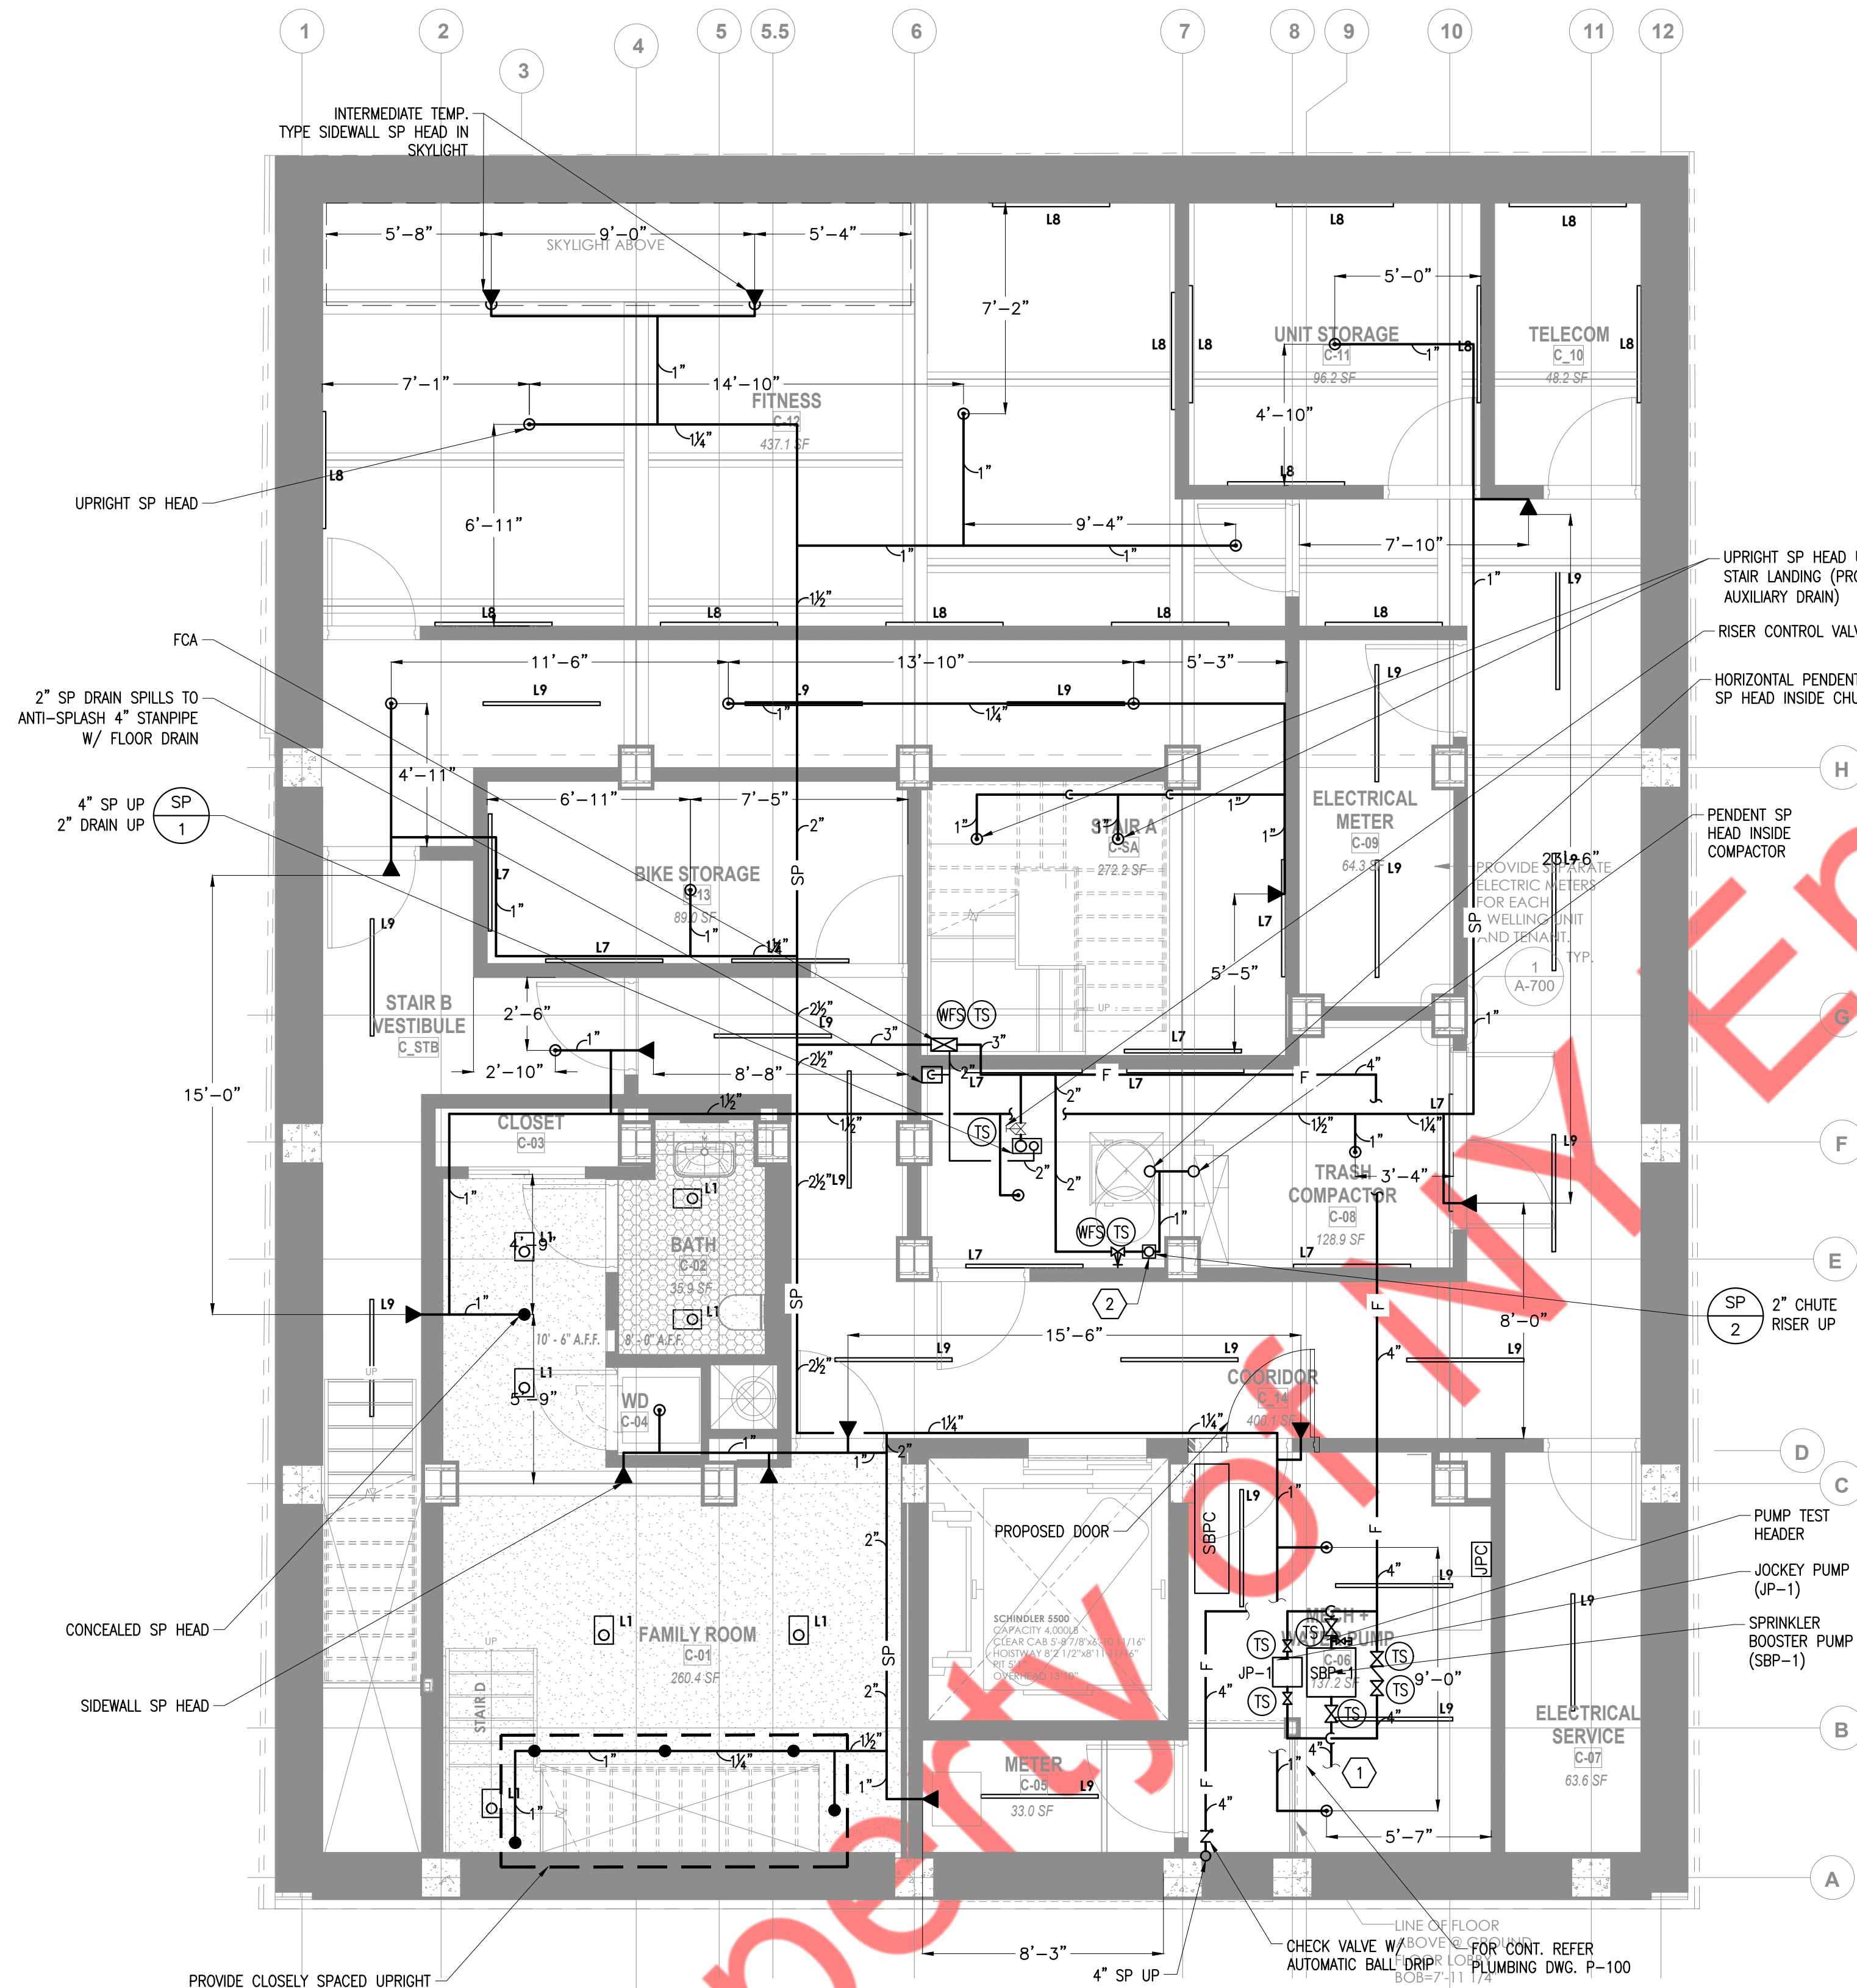


PROVIDE CLOSELY SPACED UPRIGHT SPRINKLER HEADS AT 6'-0" MAX AND 6" TO 12" AWAY FROM DRAFT STOP NEAR SLAB OPENING

- SPRINKLER NOTES:**
- 1 FOR ADDITIONAL TAMPER SWITCH, REFER TO RISER DIAGRAM
 - 2 EXTEND 1" CHUTE RISER DRAIN TO ANTI-SPLASH DRAIN (REFER DETAIL 10 ON SP-501.00)

SPRINKLER HEADS COUNT	
SPK. HEAD TYPE	QTY.
UPRIGHT	16
CONCEALED	06
SIDEWALL	13
PENDENT	02


SPRINKLER PLAN - CELLAR
1/4" = 1'-0"

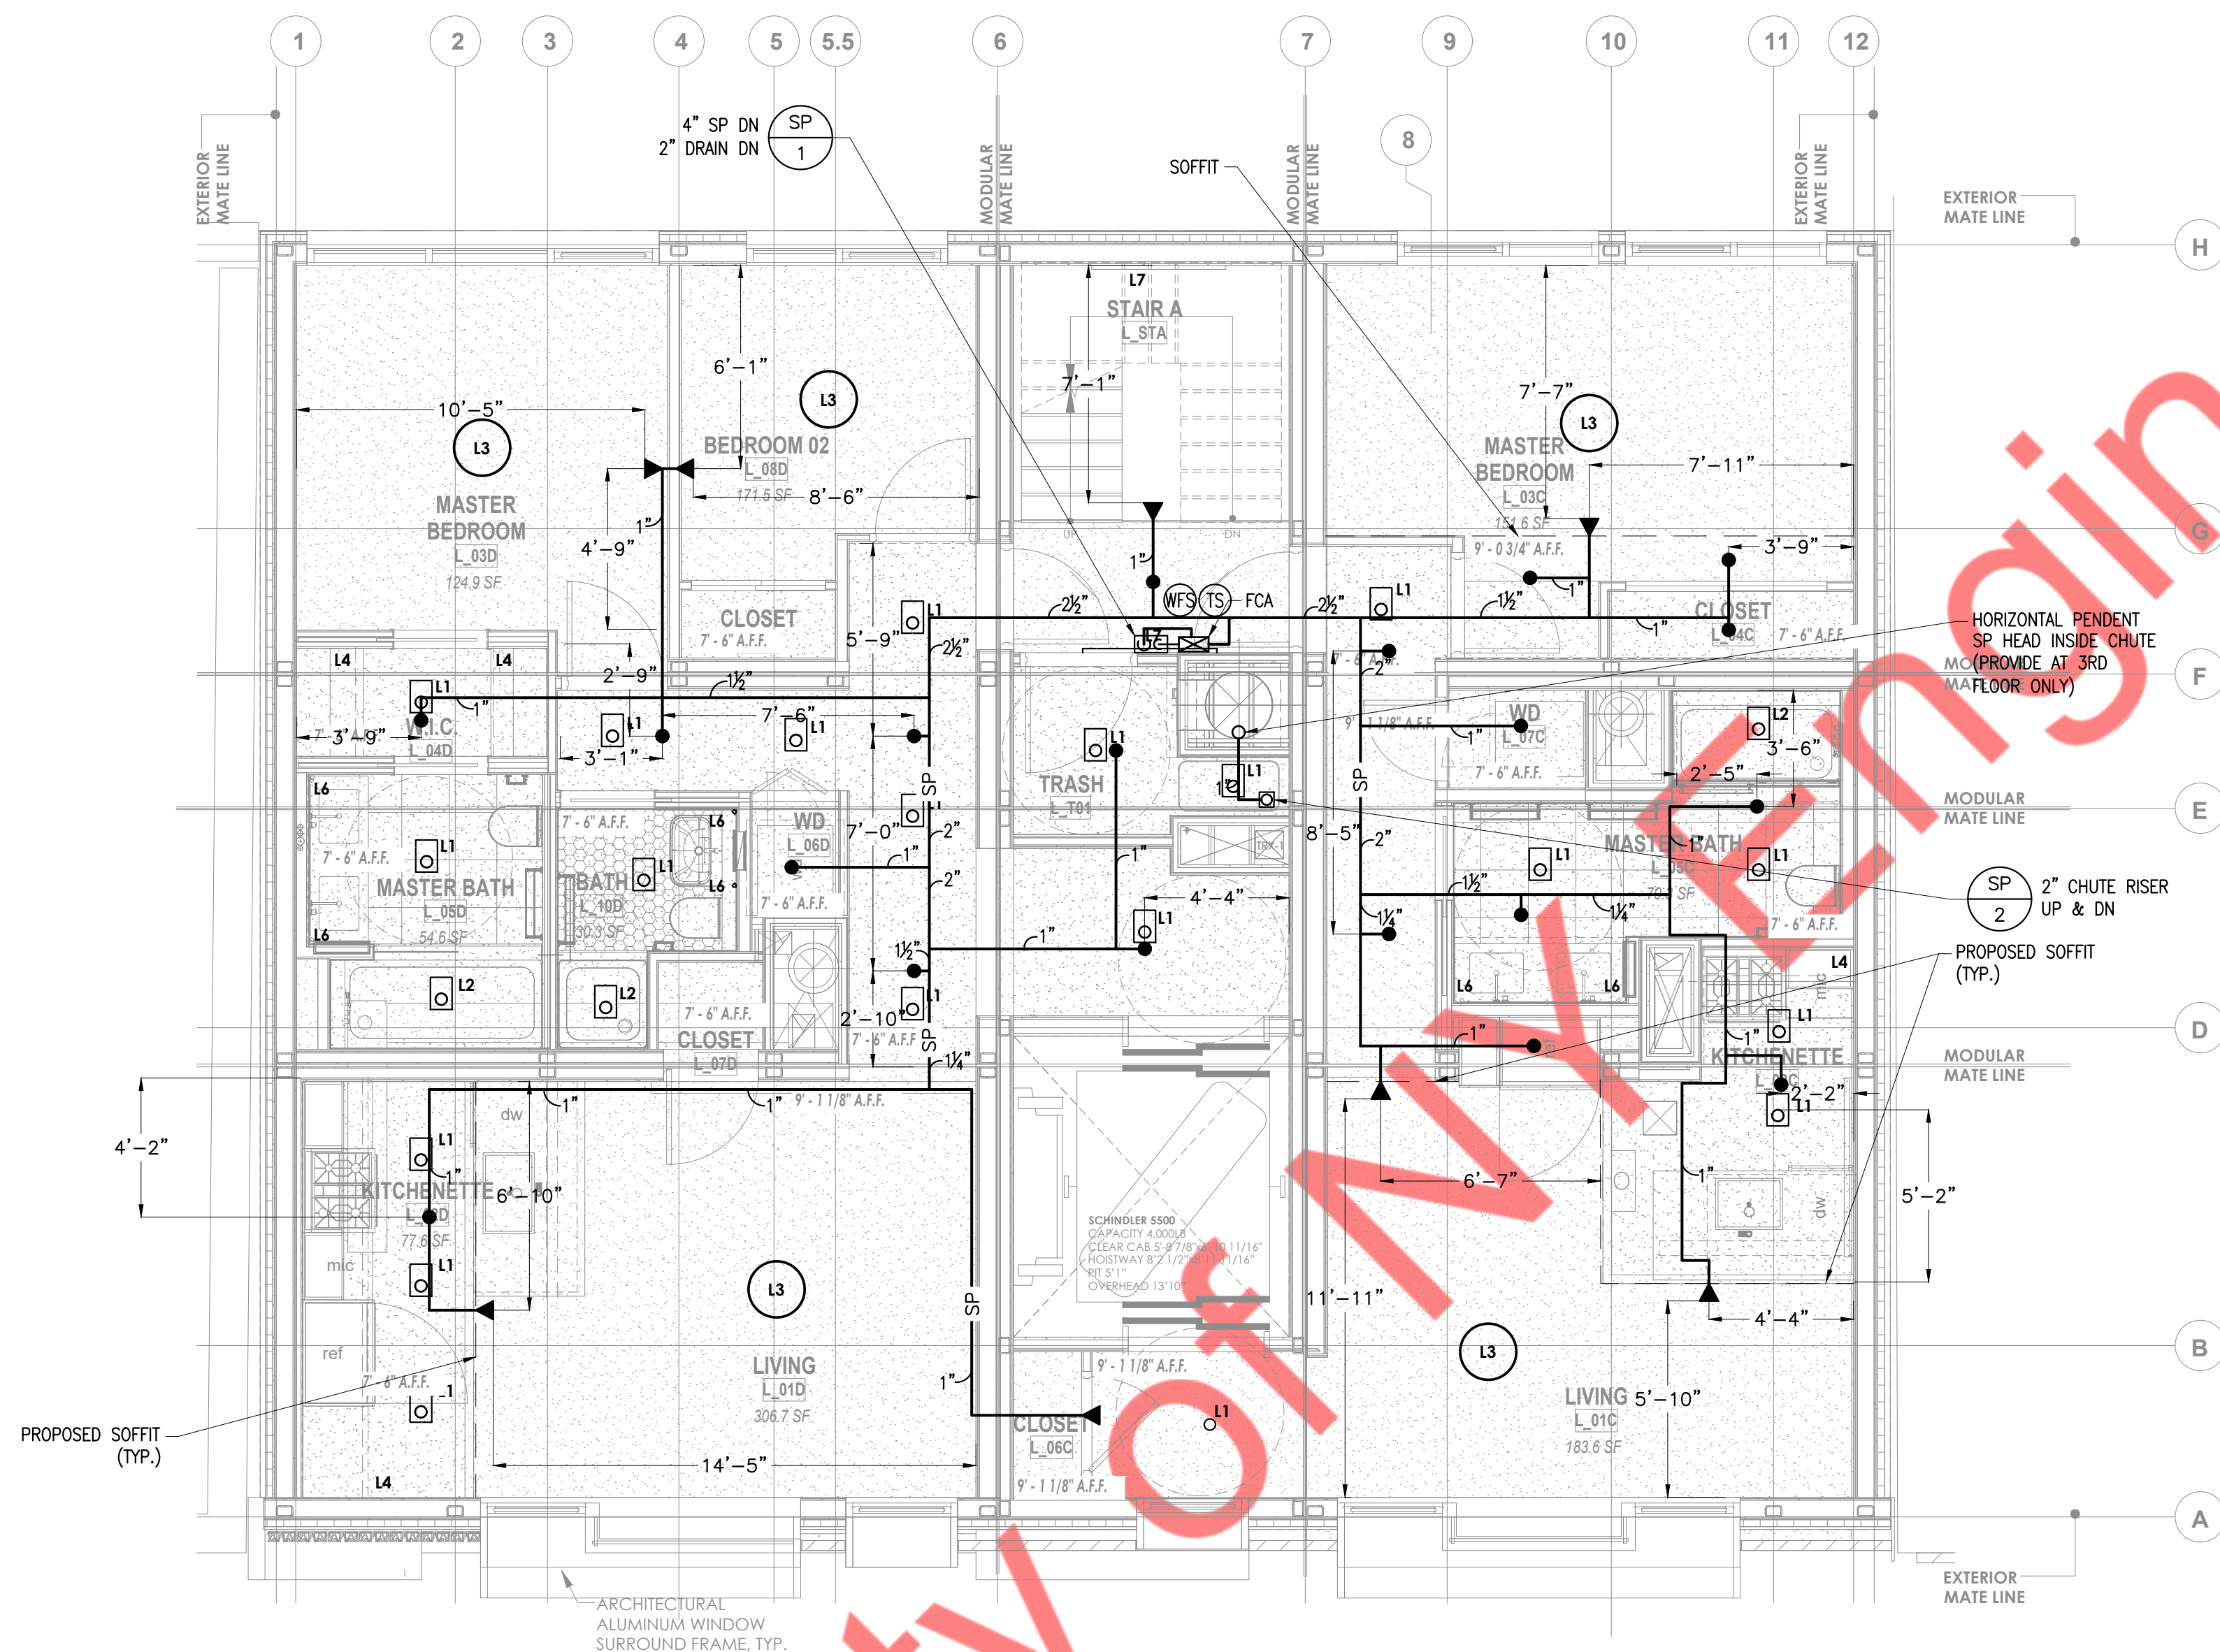

SPRINKLER HEADS COUNT FOR 2ND & 4TH	
SPK. HEAD TYPE	QTY.
CONCEALED PENDENT	19
SIDEWALL	8


SPRINKLER HEADS COUNT FOR 3RD FLOOR	
SPK. HEAD TYPE	QTY.
CONCEALED PENDENT	19
SIDEWALL	8
PENDENT	1

SPRINKLER PLAN - 2ND TO 4TH FLOOR (TYPICAL)
1/4" = 1'-0"

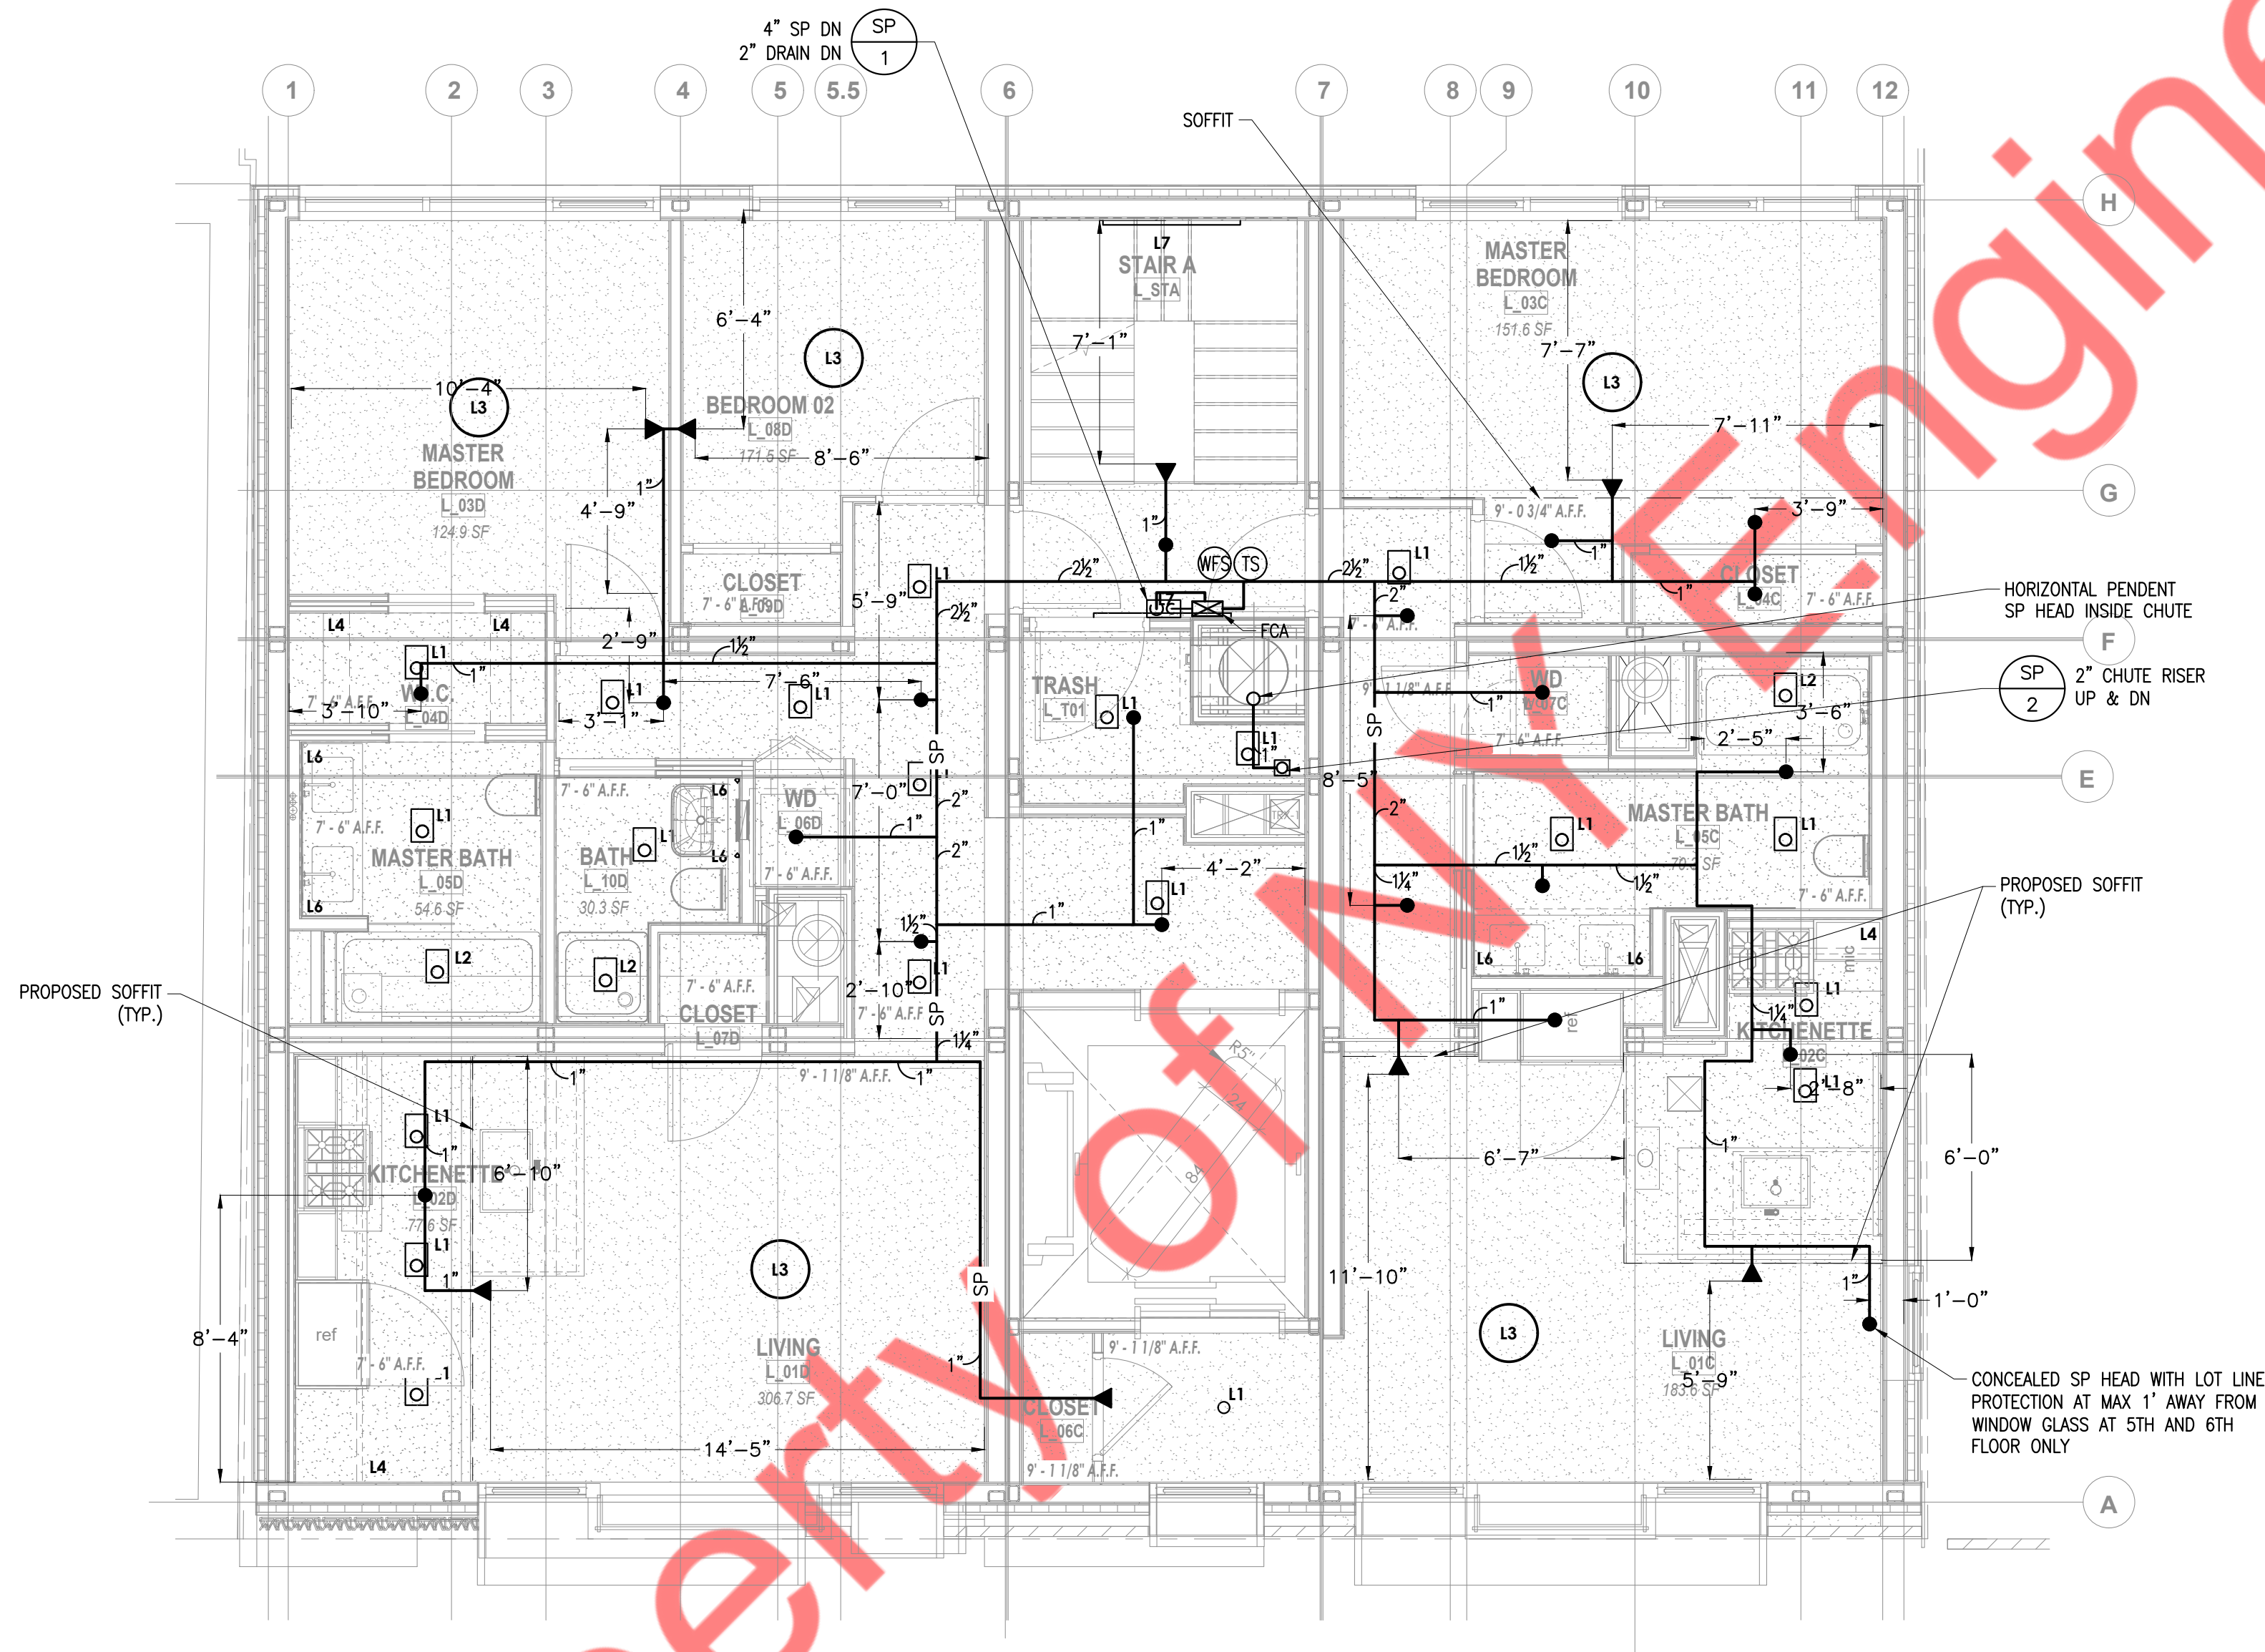


SPRINKLER HEADS COUNT FOR 5TH FLOOR	
SPK. HEAD TYPE	QTY.
CONCEALED PENDENT	20
SIDEWALL	8
PENDENT	1

SPRINKLER PLAN - 5TH FLOOR
1/4" = 1'-0"

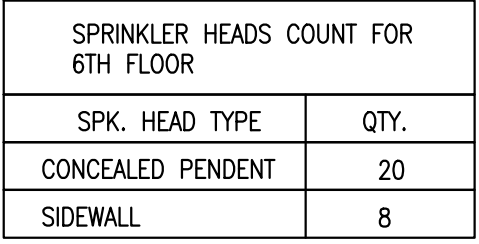

SPRINKLER PLAN - 6TH FLOOR
1/4" = 1'-0"

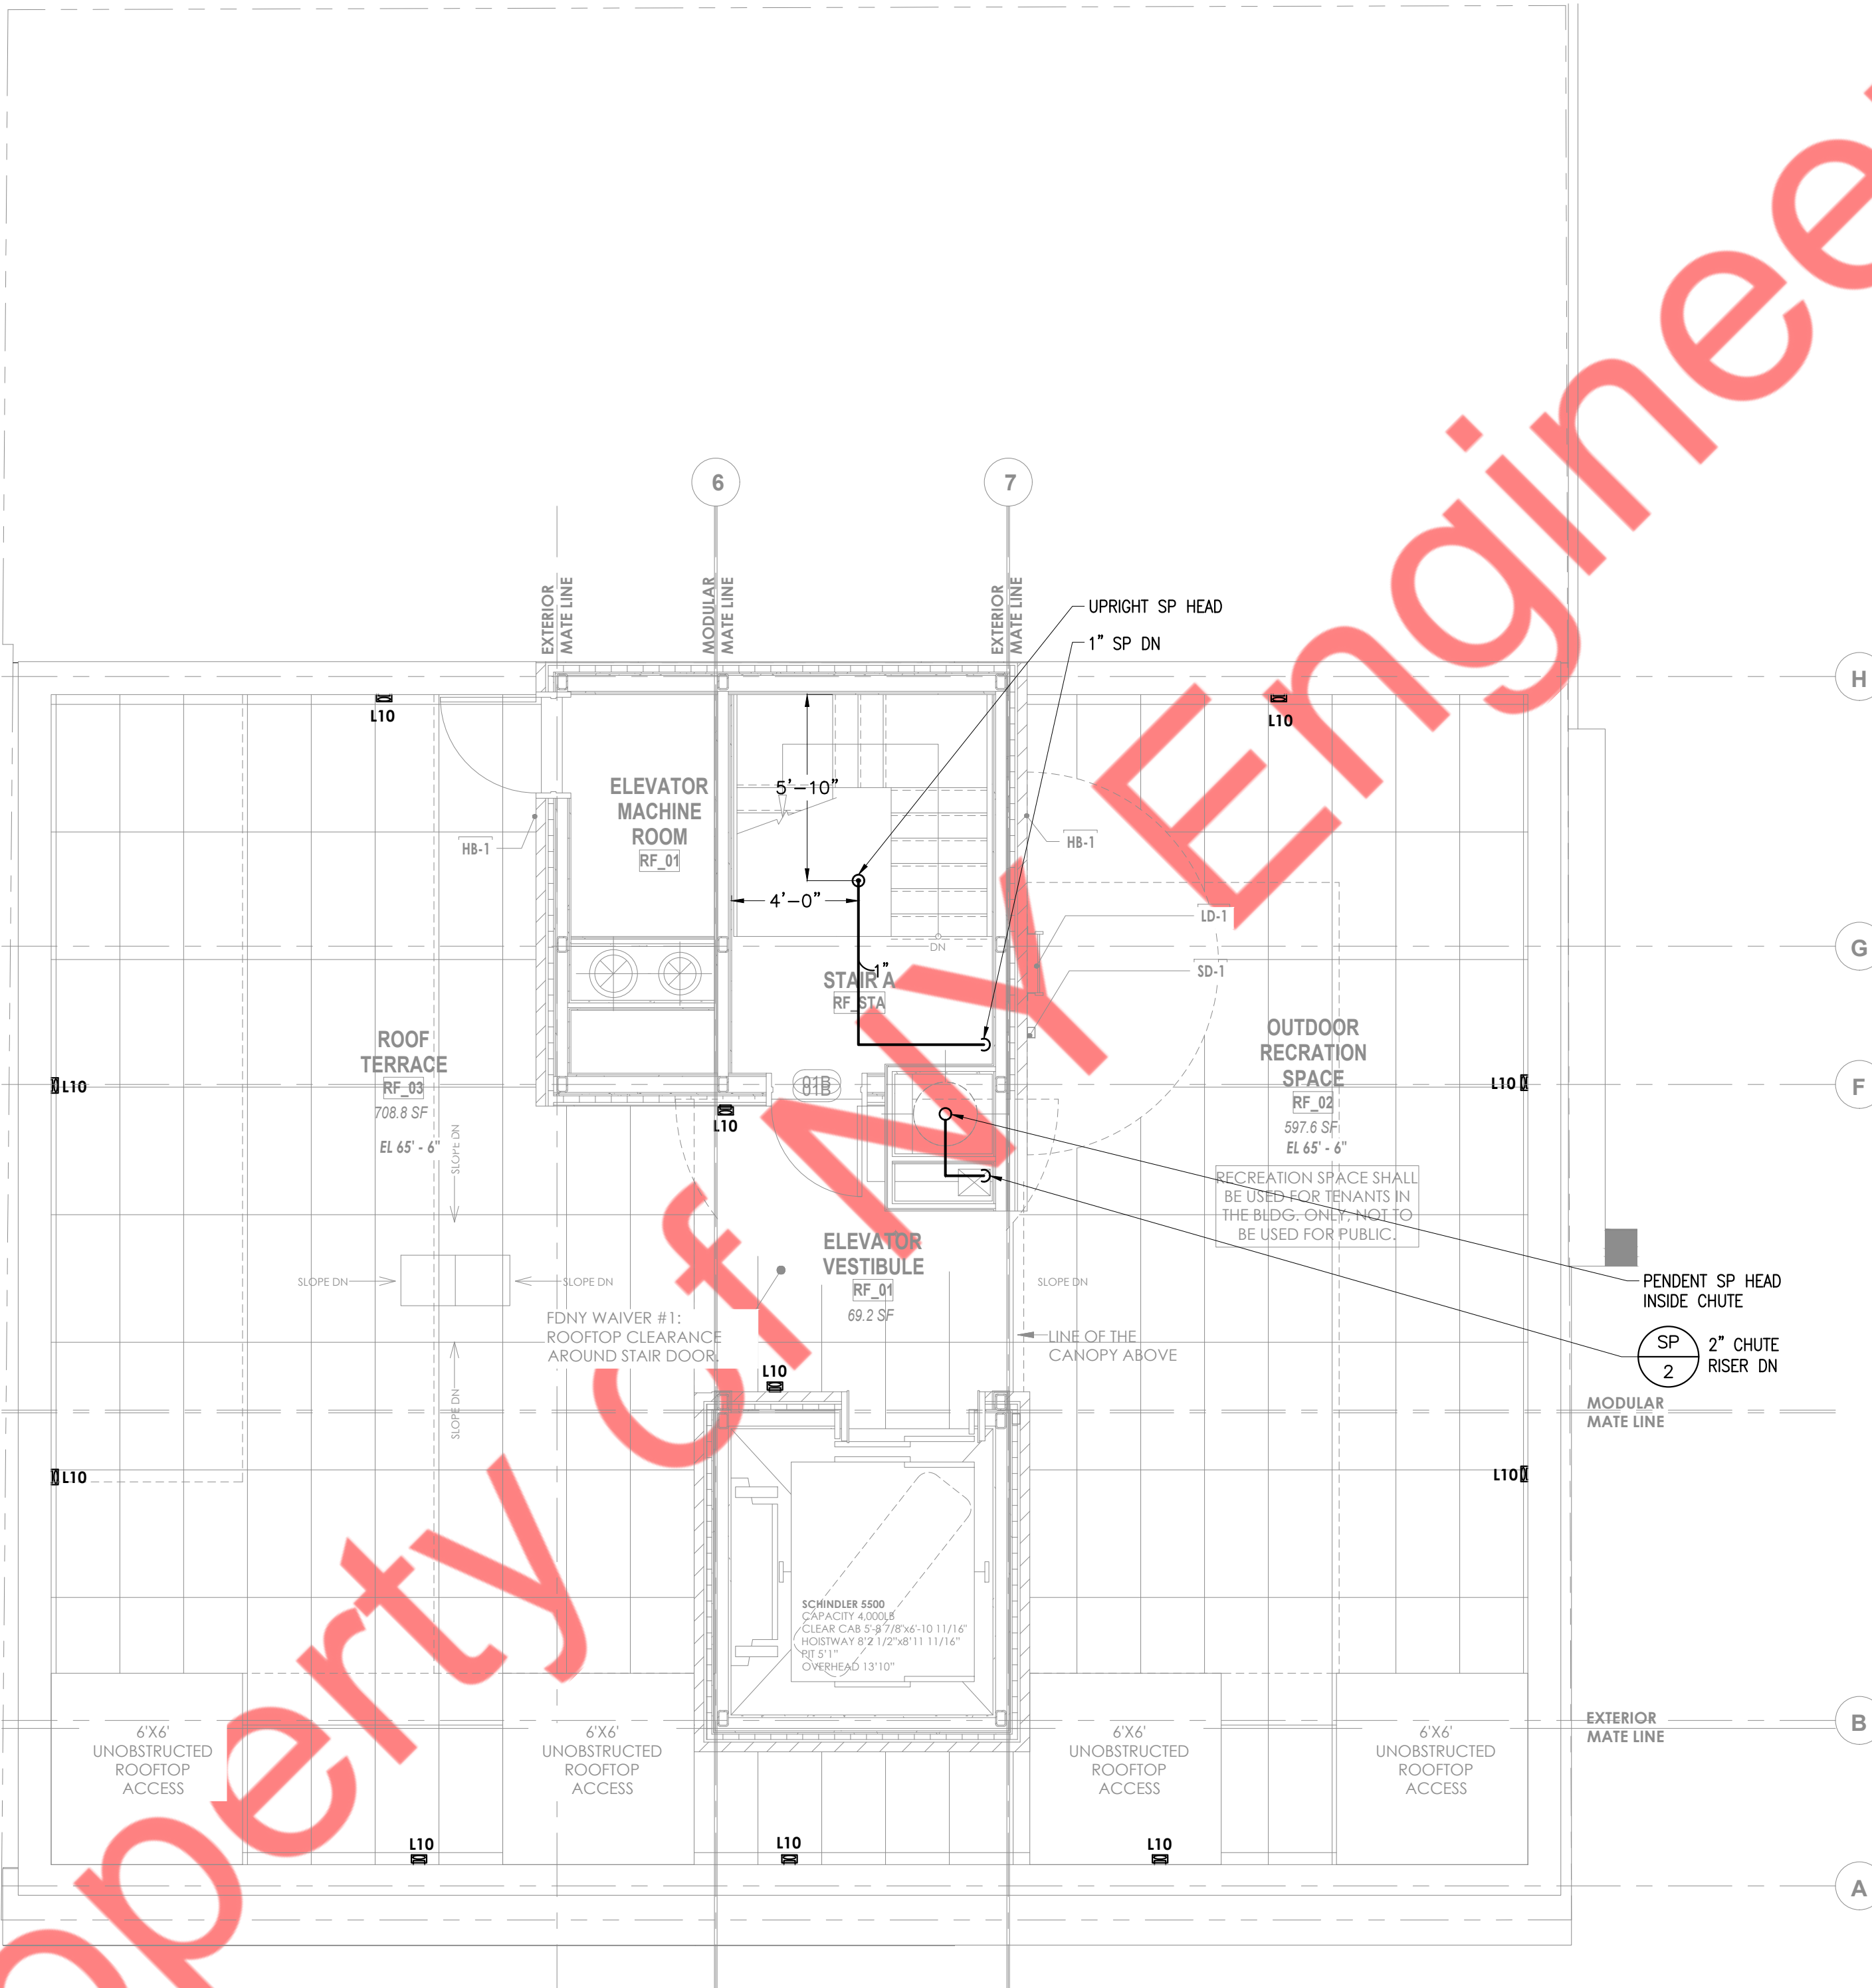

SPRINKLER HEADS COUNT	
SPK. HEAD TYPE	QTY.
UPRIGHT	1

SPRINKLER PLAN - ROOF
1/4" = 1'-0"