


MATCH LINE - REFER PART PLAN 3 ON DRAWING P-102

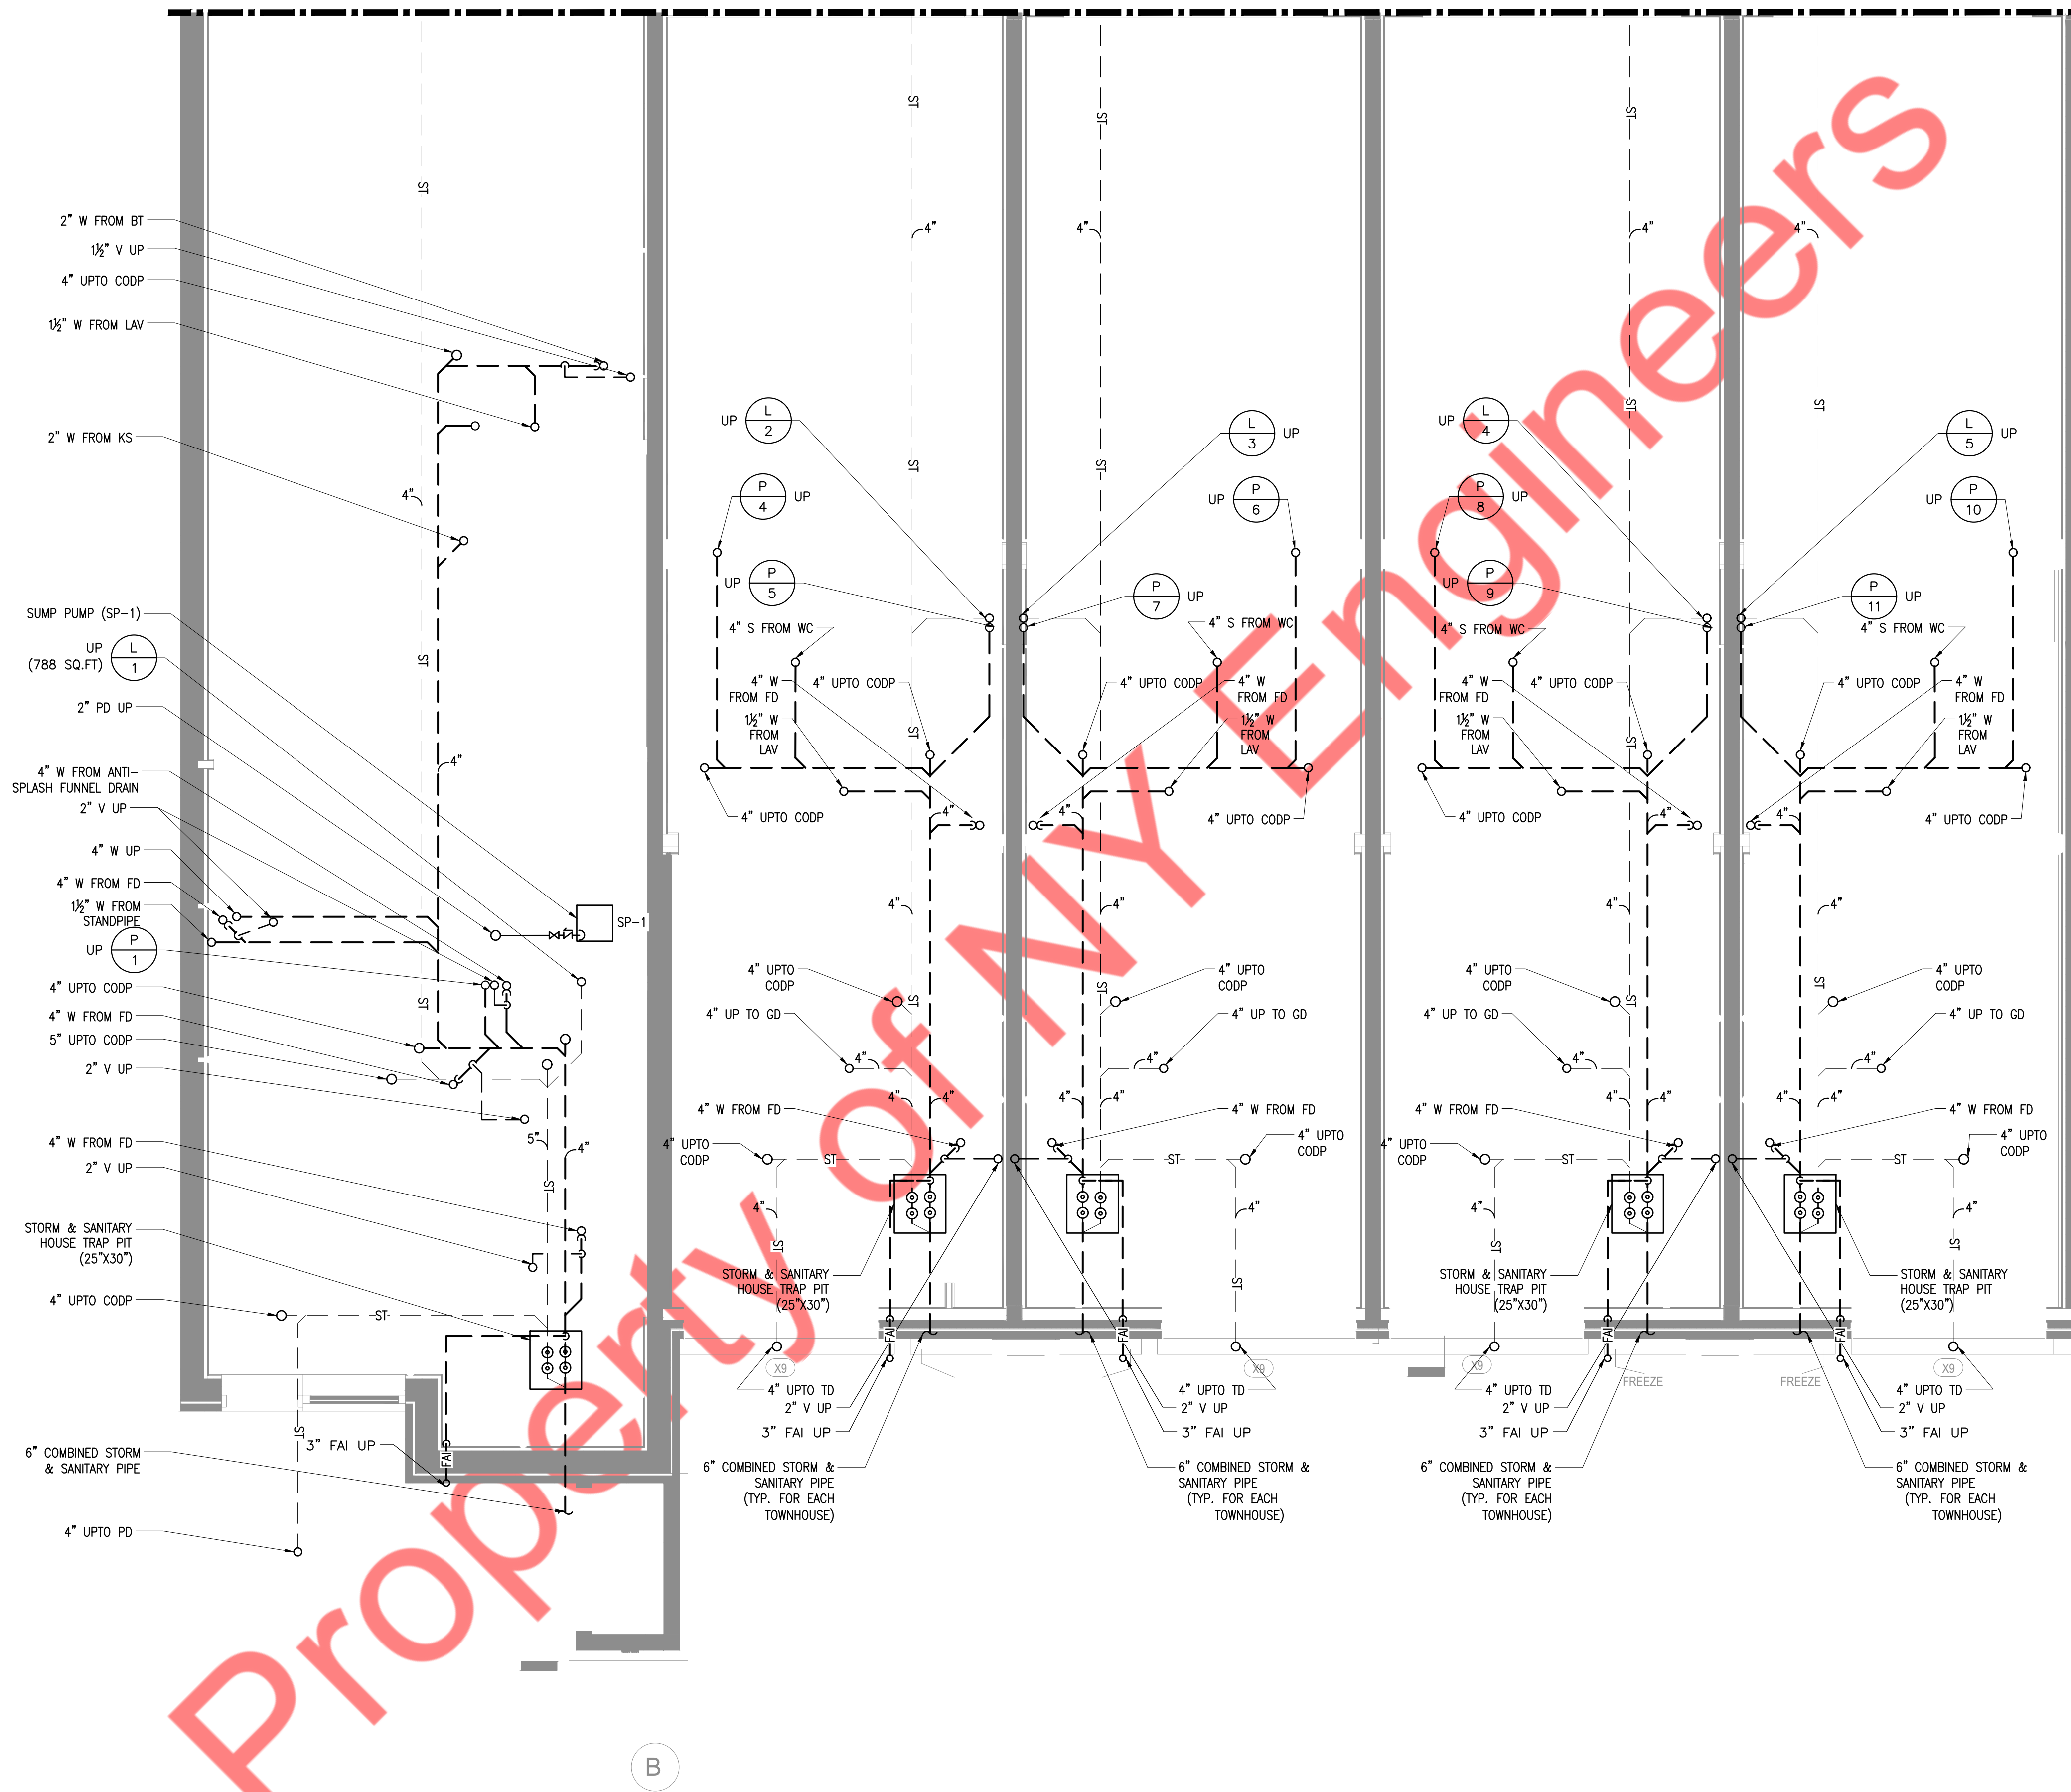

MATCH LINE - REFER PART PLAN 2 ON DRAWING P-102

KEY NOTE:

- 1 CONDENSATE DRAIN FROM MECHANICAL EQUIPMENT TO SPILL INDIRECTLY INTO LAVATORY WASTE PIPE WITH AIR GAP FITTINGS.
- 2 CONDENSATE DRAIN FROM MECHANICAL EQUIPMENT TO SPILL INDIRECTLY INTO LAVATORY WASTE PIPE WITH AIR GAP FITTINGS.

GENERAL NOTE:


- 1. ALL WATER PIPING SHOULD BE PROVIDED WITH INSULATION ACCORDING TO NYC ECC 2016. REFER SECTION B OF POINT 1.06 ON DRAWING P-001.
- 2. PROVIDE ELECTRONIC TRAP PRIMER FOR BOILER ROOM & MECHANICAL ROOM FLOOR DRAIN & FLOW ACTIVATED TRAP PRIMER FOR W/D CLOSET FLOOR DRAIN.
- 3. FOR ALL PIPE SIZES, REFER TO RISER DIAGRAM.

PLUMBING LEGEND FOR MIH BUILDING


- 1 NEW 4" COMBINED FIRE & DOMESTIC WATER SERVICE
- 2 NEW 4" HOUSE GATE VALVE (OS&Y TYPE)
- 3 1/2" MICV WITH NYC APPROVED WATER METER.
- 4 4" DCDA FOR FIRE SERVICE STACKED BELOW 1/2" RPZ INSTALLED ON DOMESTIC WATER SERVICE
- 5 1/2" TEST TEE & 1/2" MOCV
- 6 4" SANITARY & 5" STORM HOUSE TRAP INSTALLED UNDERGROUND PROVIDE METAL COVER FOR ACCESS
- 8 DOMESTIC WATER DUPLEX BOOSTER PUMP (BP-1)

PLUMBING LEGEND FOR TOWNHOUSE

- 11 NEW 2" COMBINED WATER SERVICE WITH HOUSE GATE VALVE
- 12 NEW 1/4" GAS SERVICE WITH HOUSE GATE VALVE
- 13 NEW GAS METER
- 14 2" RESILIENT GATE VALVE STACKED ABOVE 2" NYC APPROVED METER AND 2" DCVA
- 15 1/2" TEST TEE & 1/2" MOCV
- 16 4" SANITARY & 4" STORM HOUSE TRAP INSTALLED UNDERGROUND PROVIDE METAL COVER FOR ACCESS

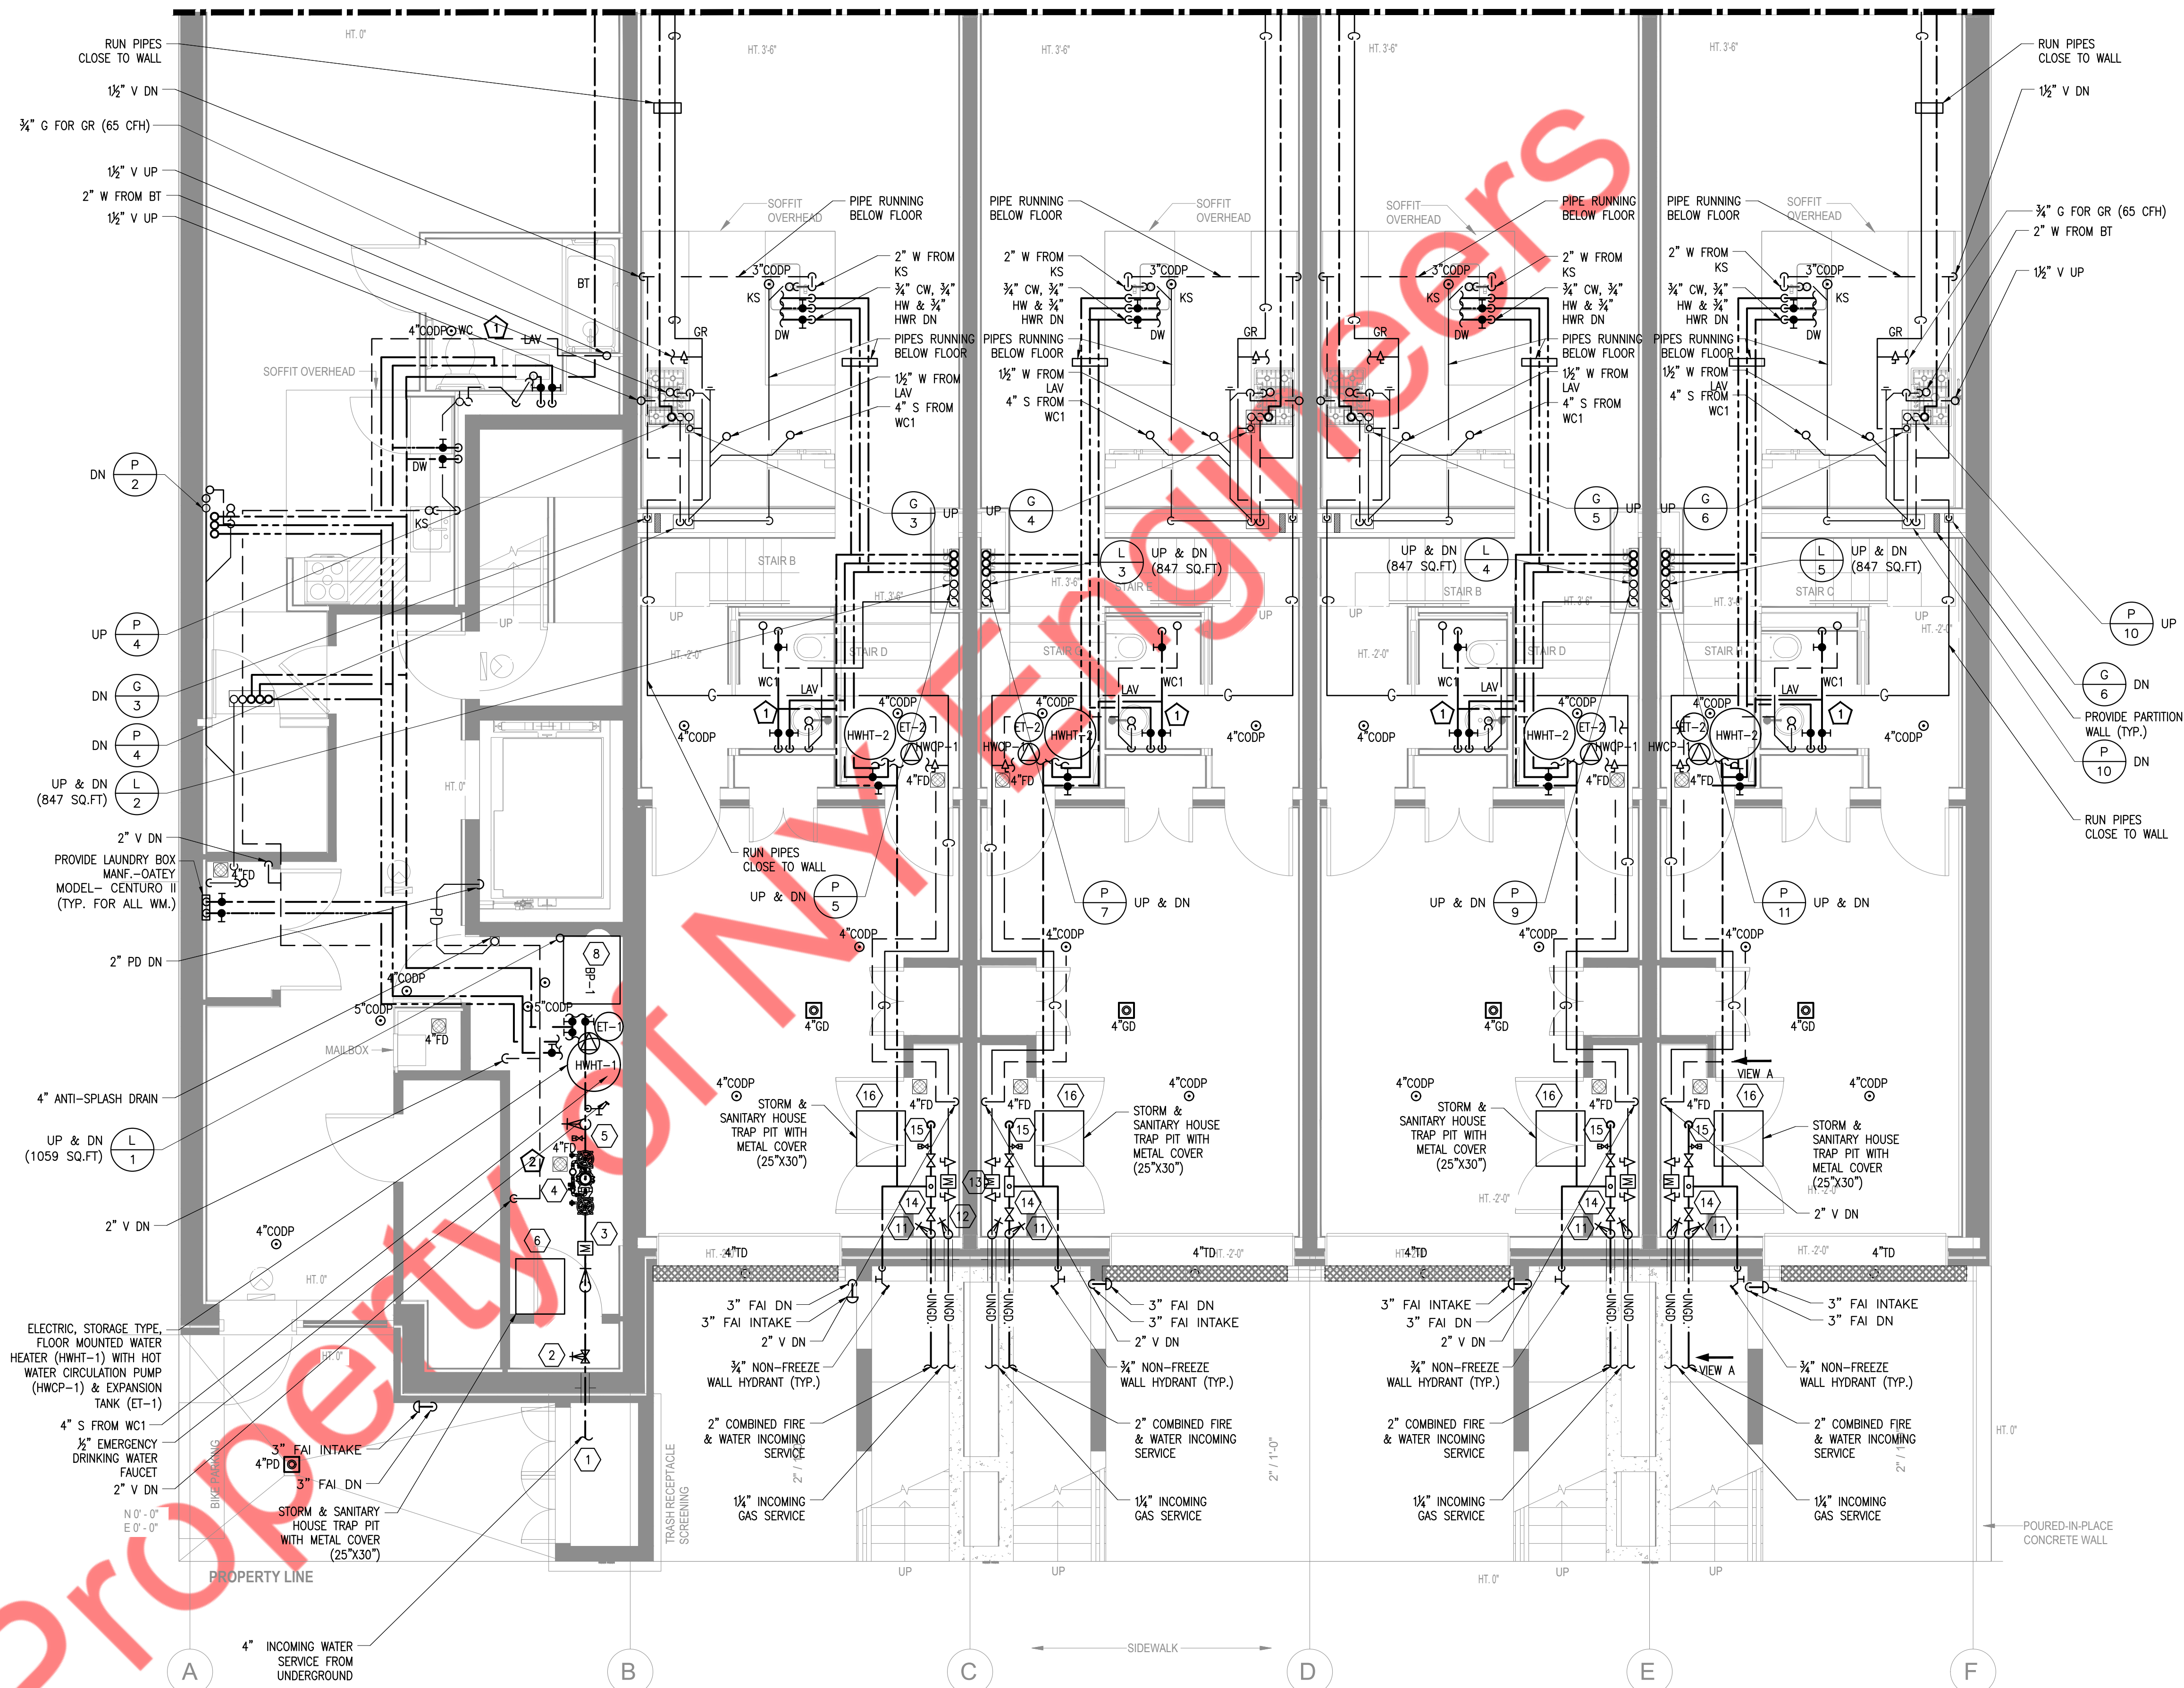

1 GROUND FLOOR PLUMBING PLAN
1/4" = 1'-0"

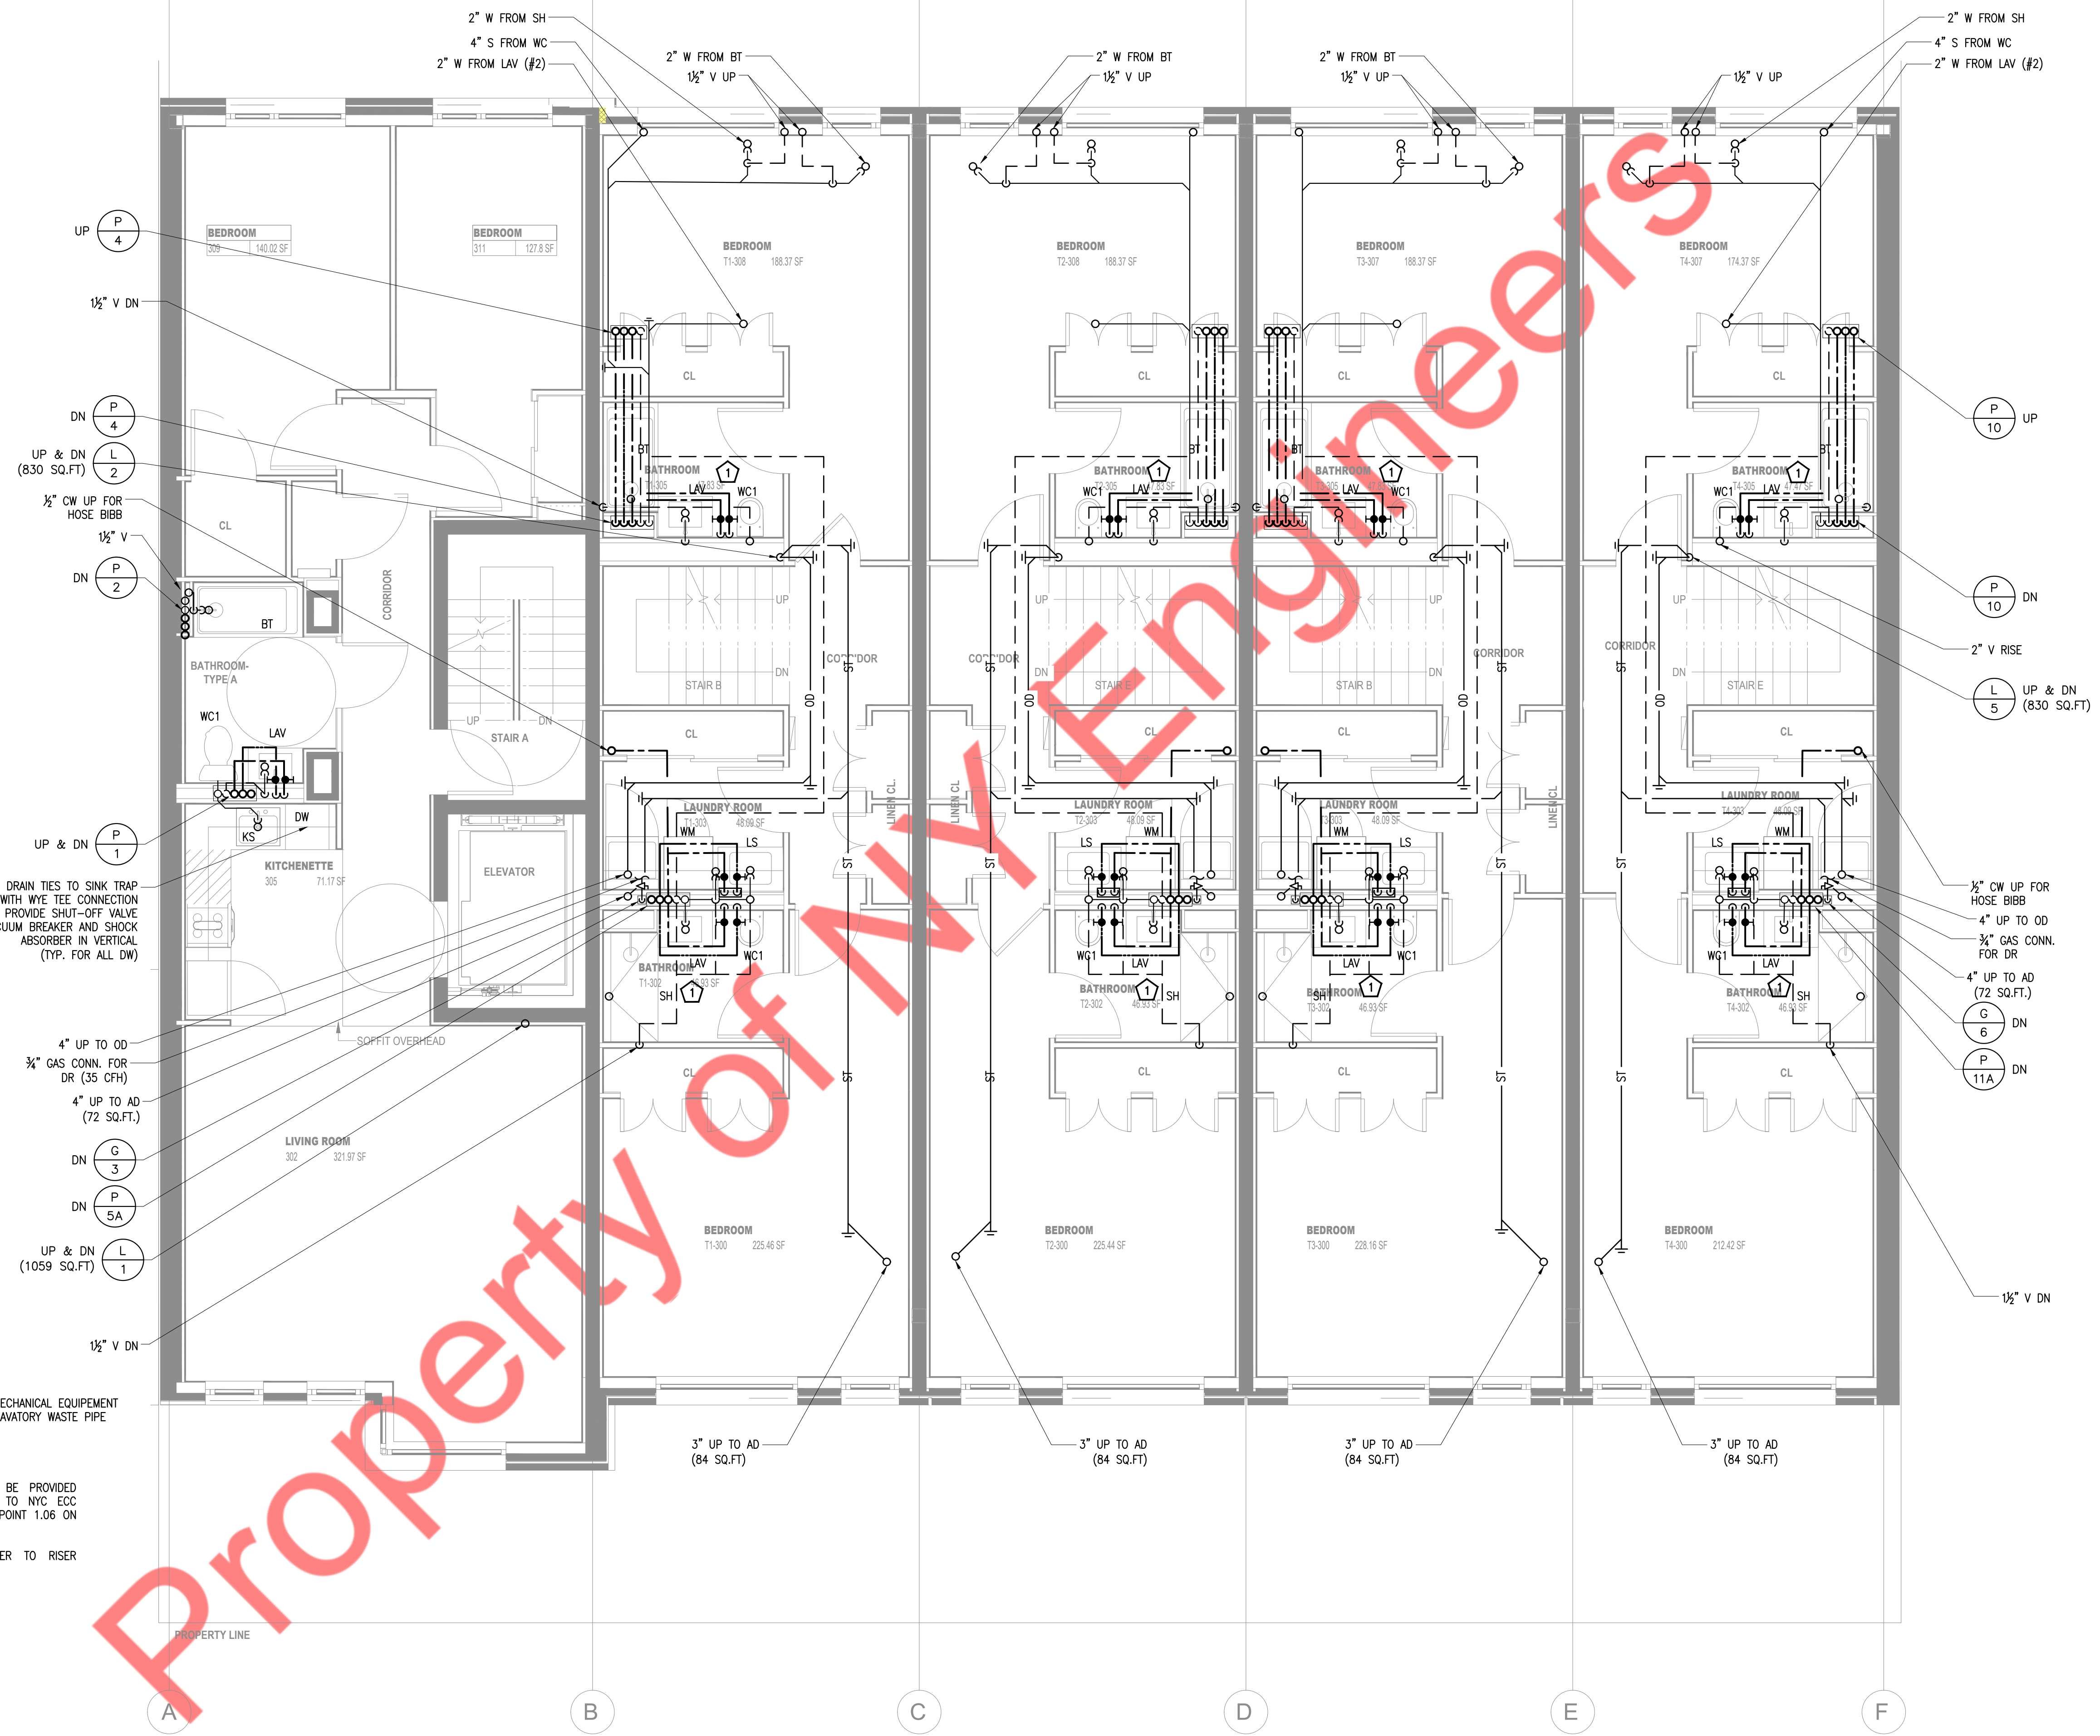


KEY NOTE:

1 CONDENSATE DRAIN FROM MECHANICAL EQUIPMENT TO SPILL INDIRECTLY INTO LAVATORY WASTE PIPE WITH AIR GAP FITTINGS.

GENERAL NOTE:

1. ALL WATER PIPING SHOULD BE PROVIDED WITH INSULATION ACCORDING TO NYC ECC 2016. REFER SECTION B OF POINT 1.06 ON DRAWING P-001.
2. FOR ALL PIPE SIZES, REFER TO RISER DIAGRAM.

1 3RD FLOOR PLUMBING PLAN
1/4" = 1'-0"

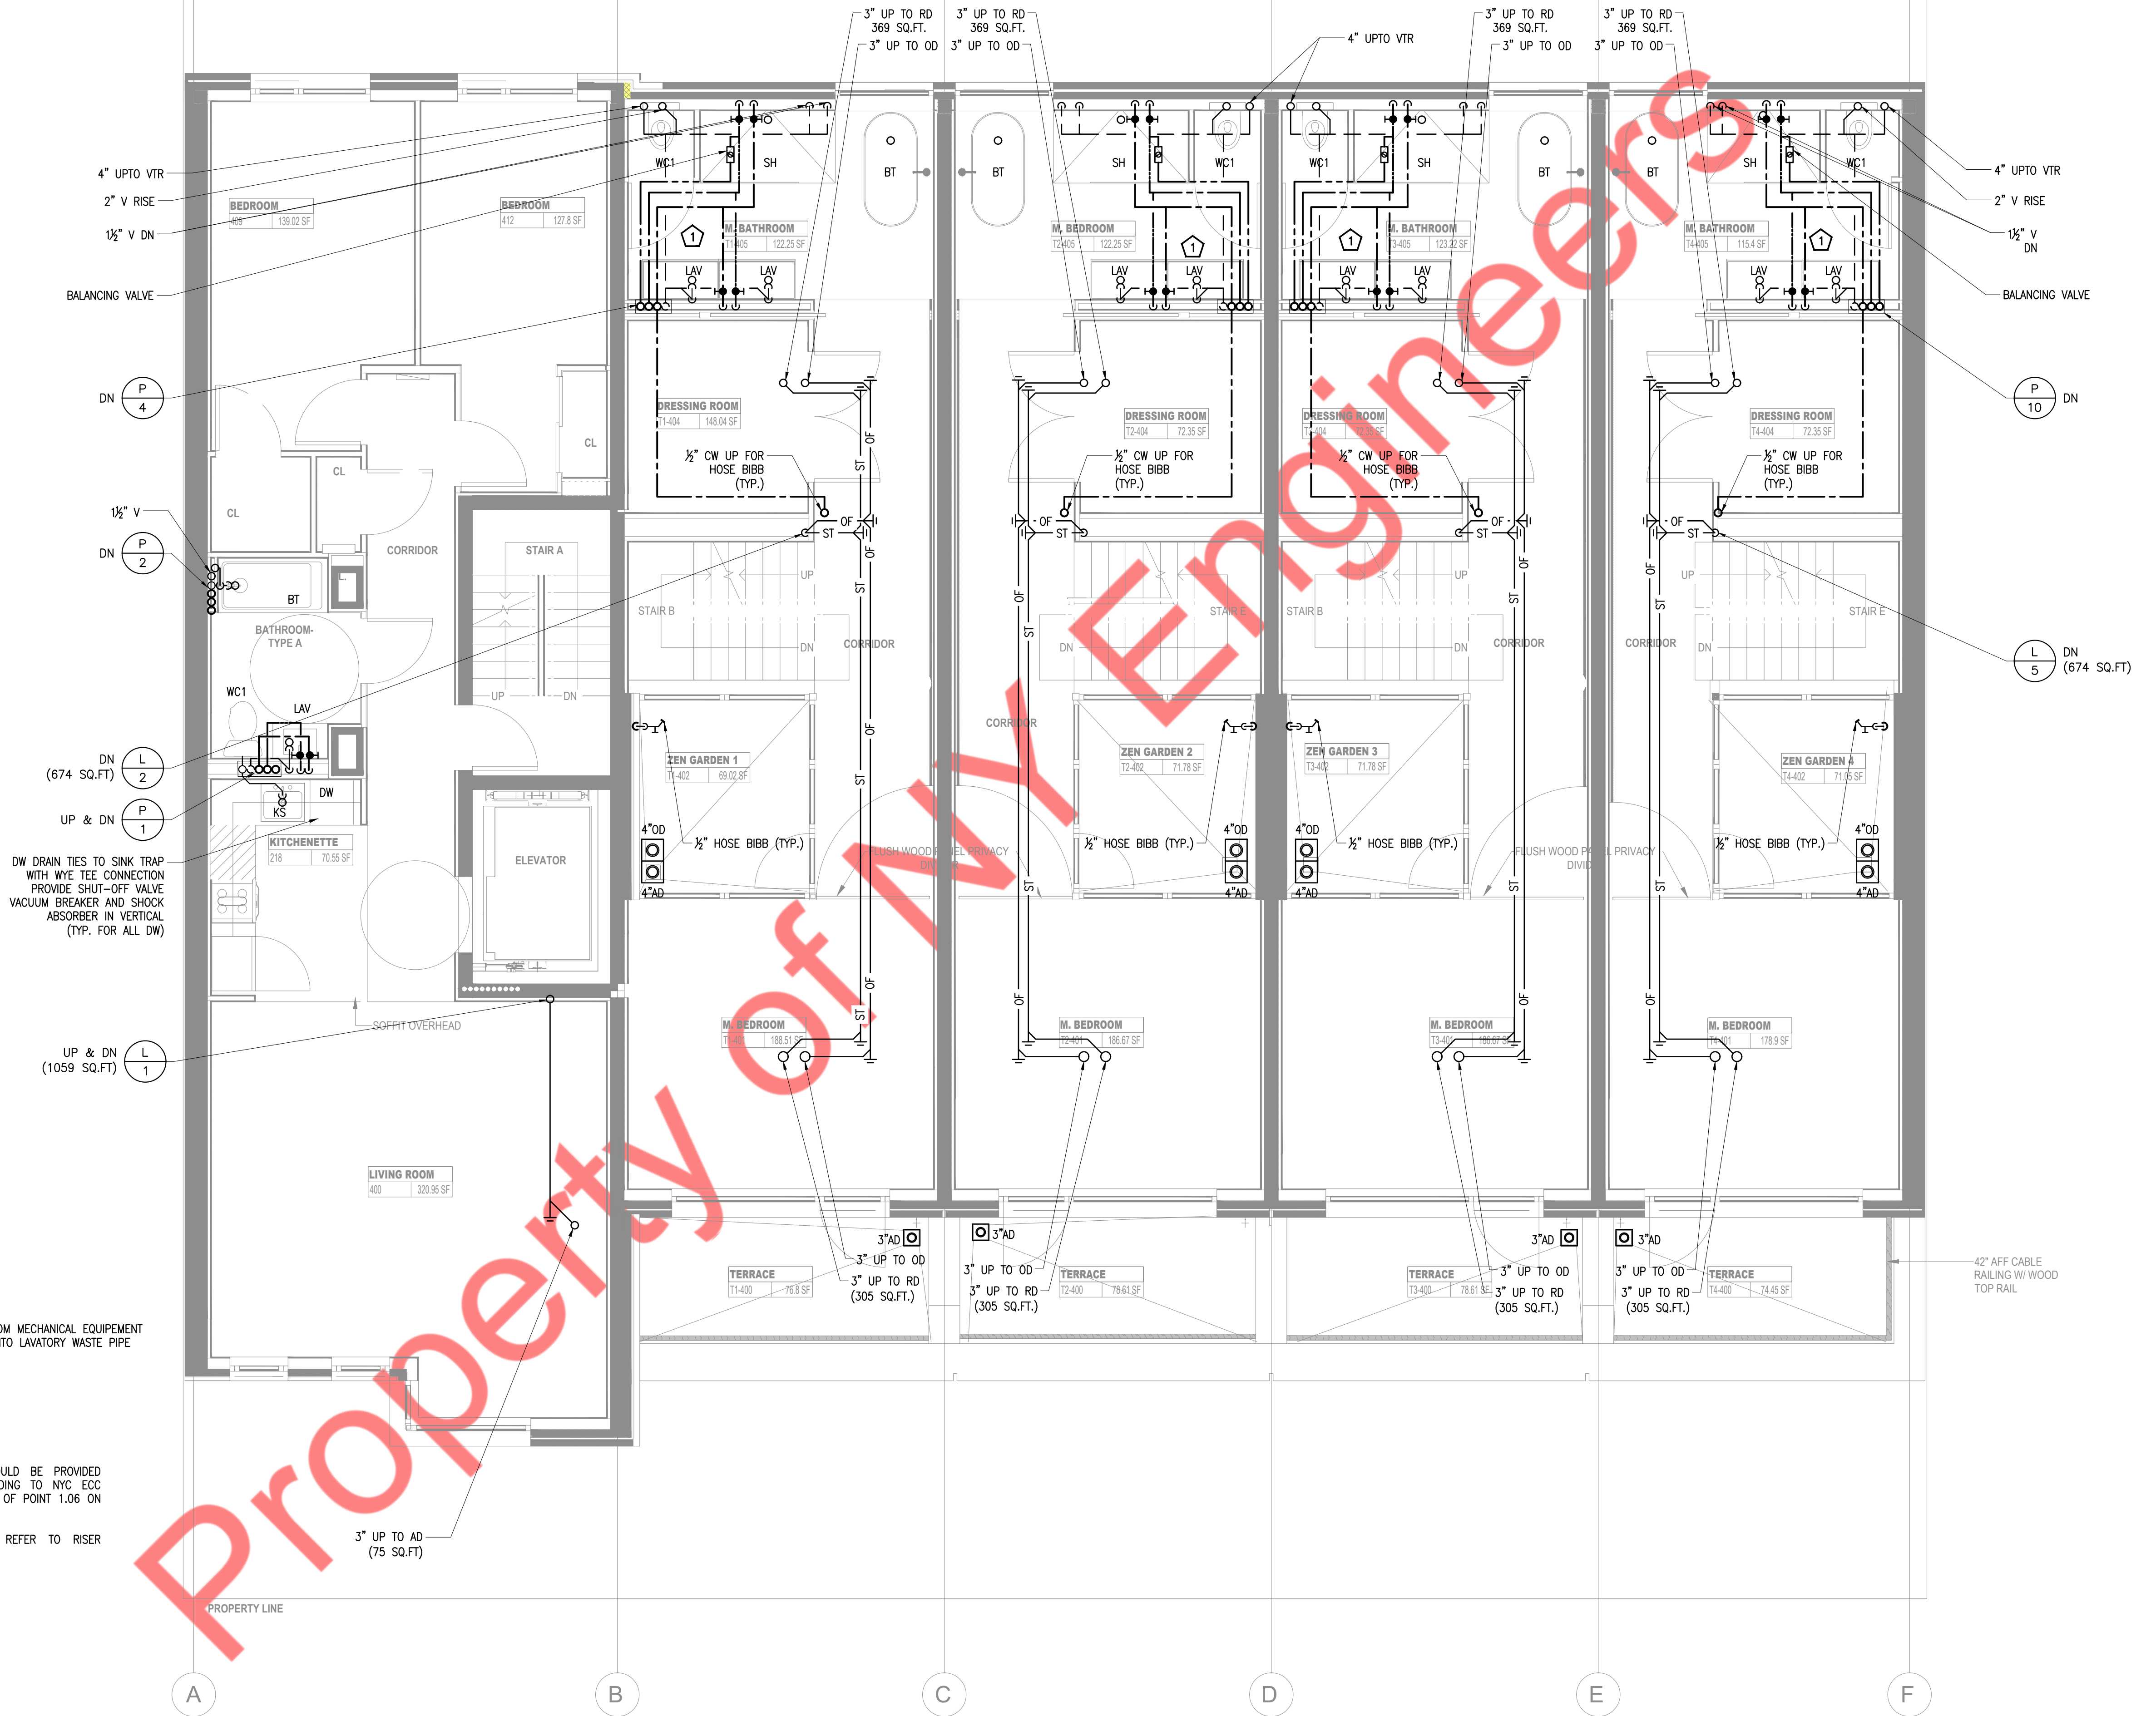


KEY NOTE:

- 1 CONDENSATE DRAIN FROM MECHANICAL EQUIPMENT TO SPILL INDIRECTLY INTO LAVATORY WASTE PIPE WITH AIR GAP FITTINGS.

GENERAL NOTE:

1. ALL WATER PIPING SHOULD BE PROVIDED WITH INSULATION ACCORDING TO NYC ECC 2016. REFER SECTION B OF POINT 1.06 ON DRAWING P-001 .
2. FOR ALL PIPE SIZES, REFER TO RISER DIAGRAM.


1 4TH FLOOR PLUMBING PLAN
1/4" = 1'-0"

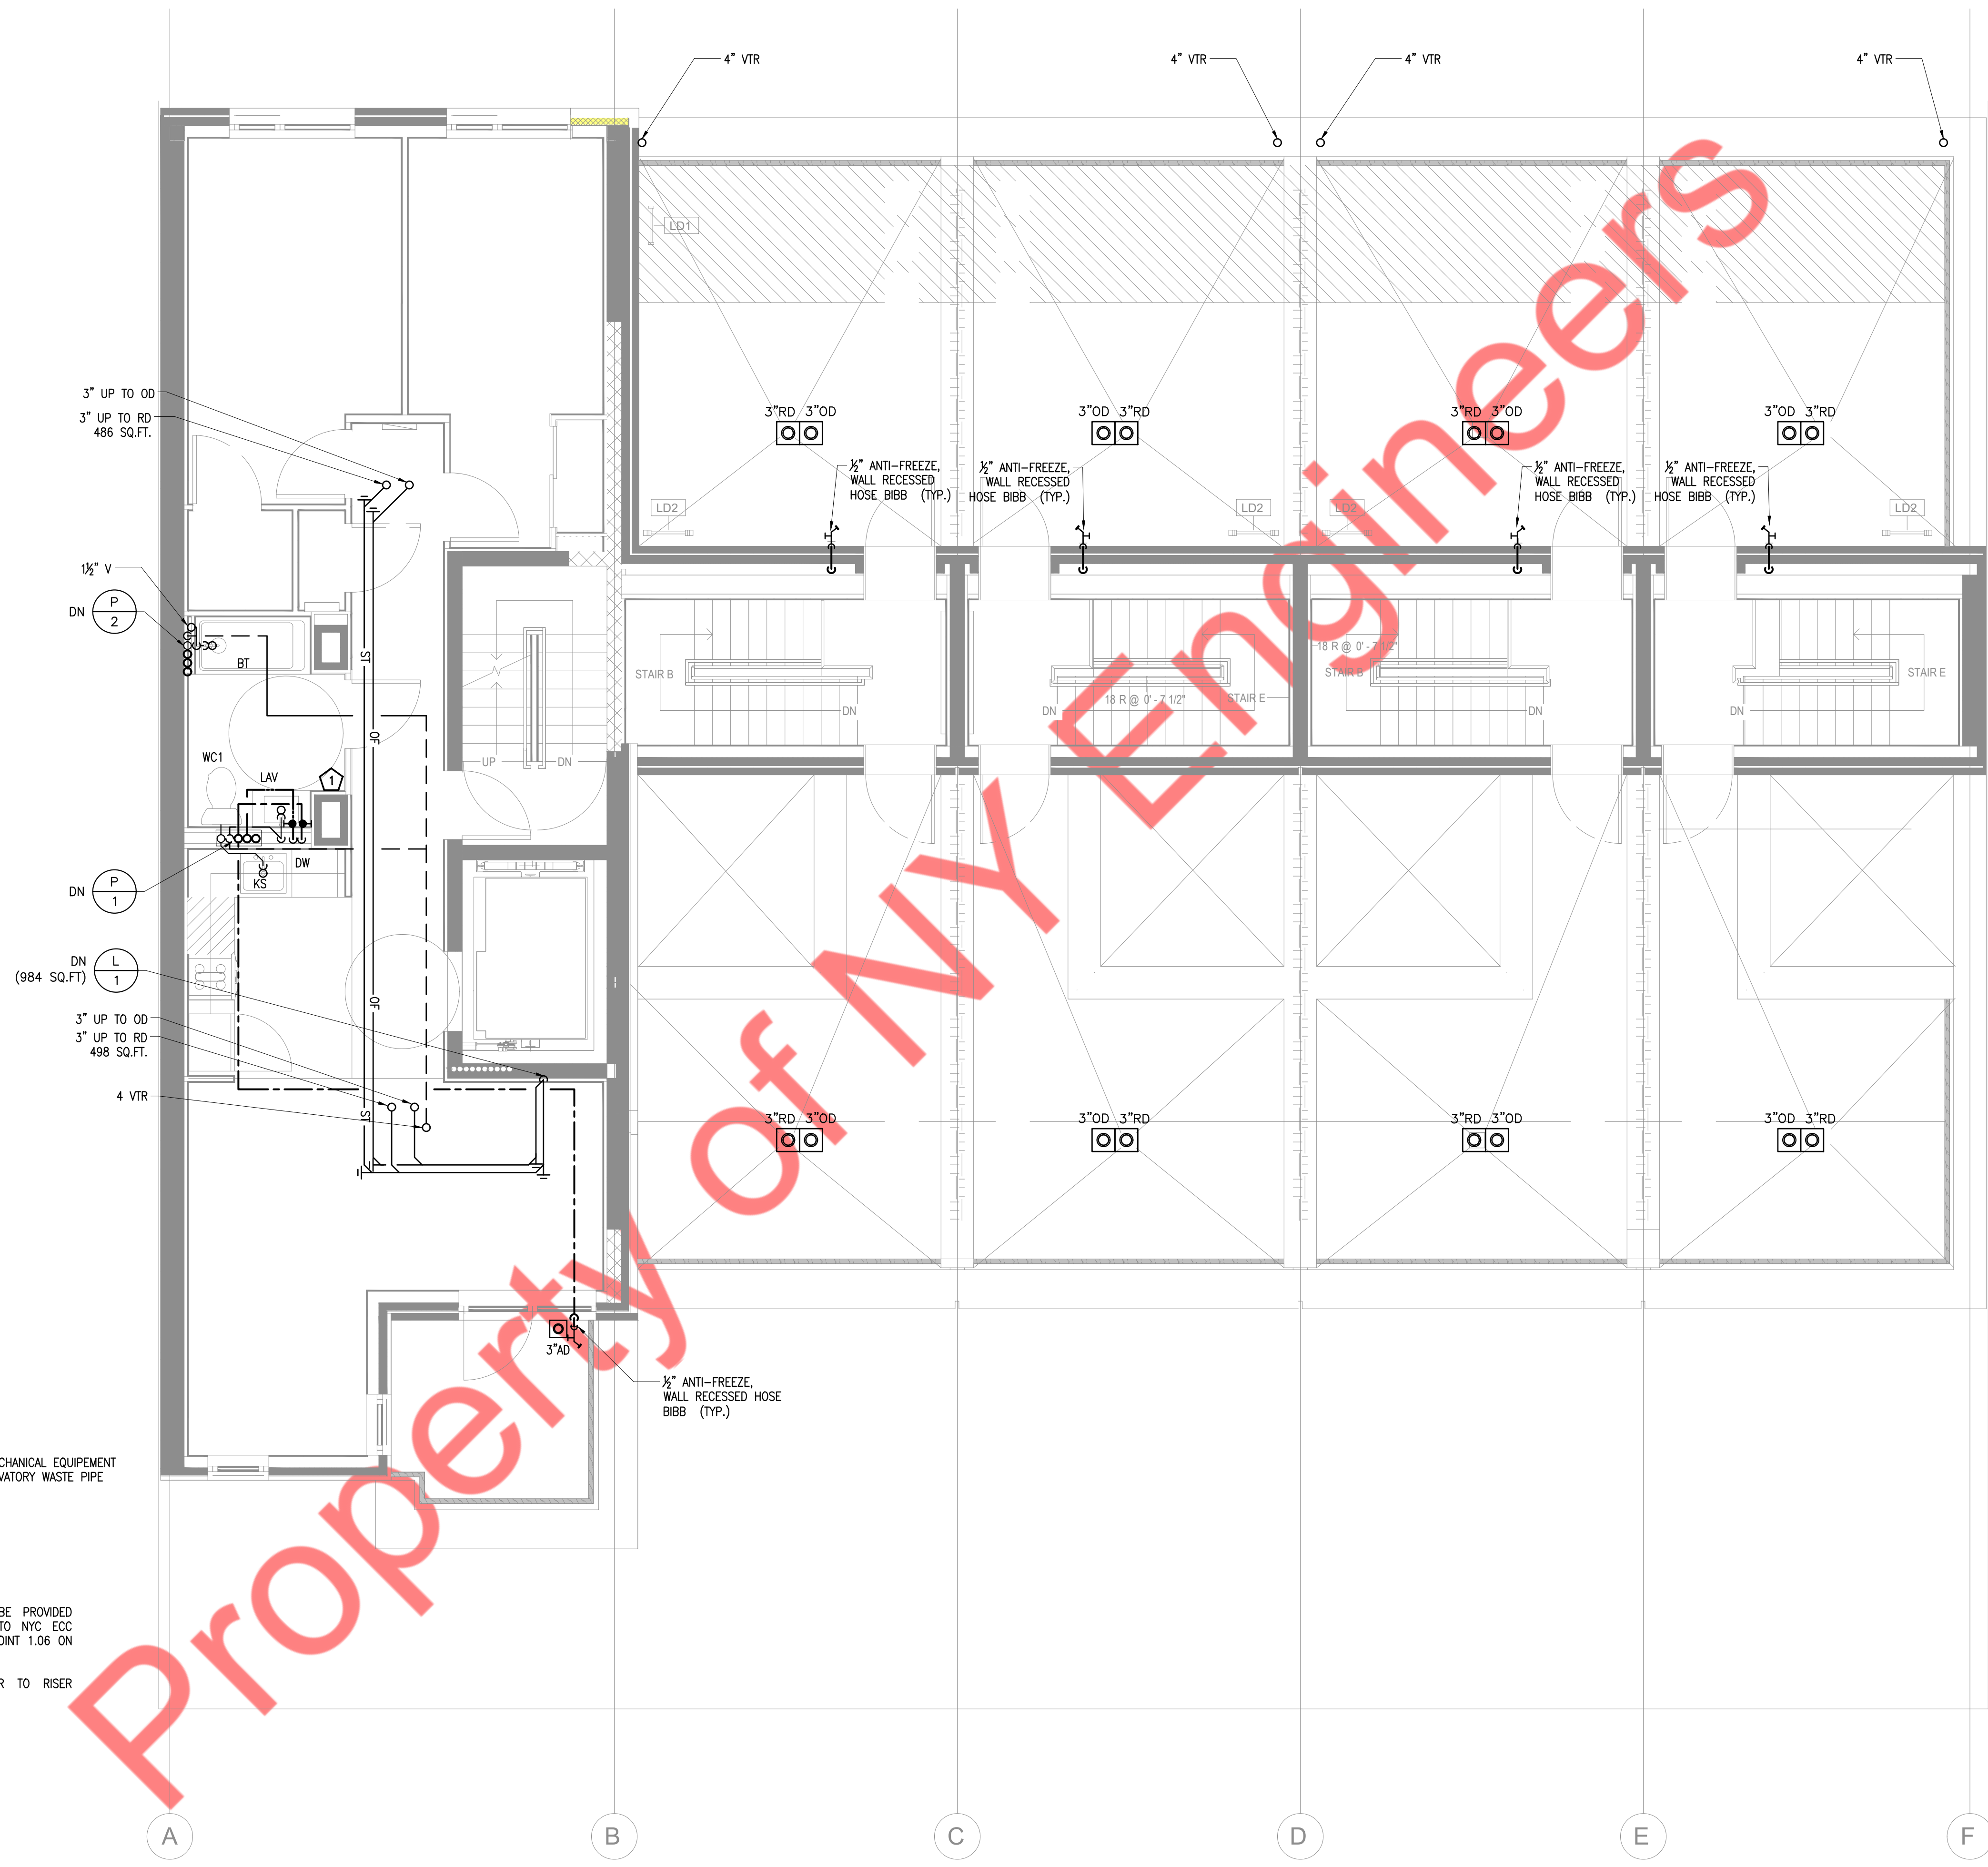


KEY NOTE:
 1 CONDENSATE DRAIN FROM MECHANICAL EQUIPMENT TO SPILL INDIRECTLY INTO LAVATORY WASTE PIPE WITH AIR GAP FITTINGS.

GENERAL NOTE:
 1. ALL WATER PIPING SHOULD BE PROVIDED WITH INSULATION ACCORDING TO NYC ECC 2016. REFER SECTION B OF POINT 1.06 ON DRAWING P-001 .
 2. FOR ALL PIPE SIZES, REFER TO RISER DIAGRAM.

1 5TH FLOOR PLUMBING PLAN
 1/4" = 1'-0"



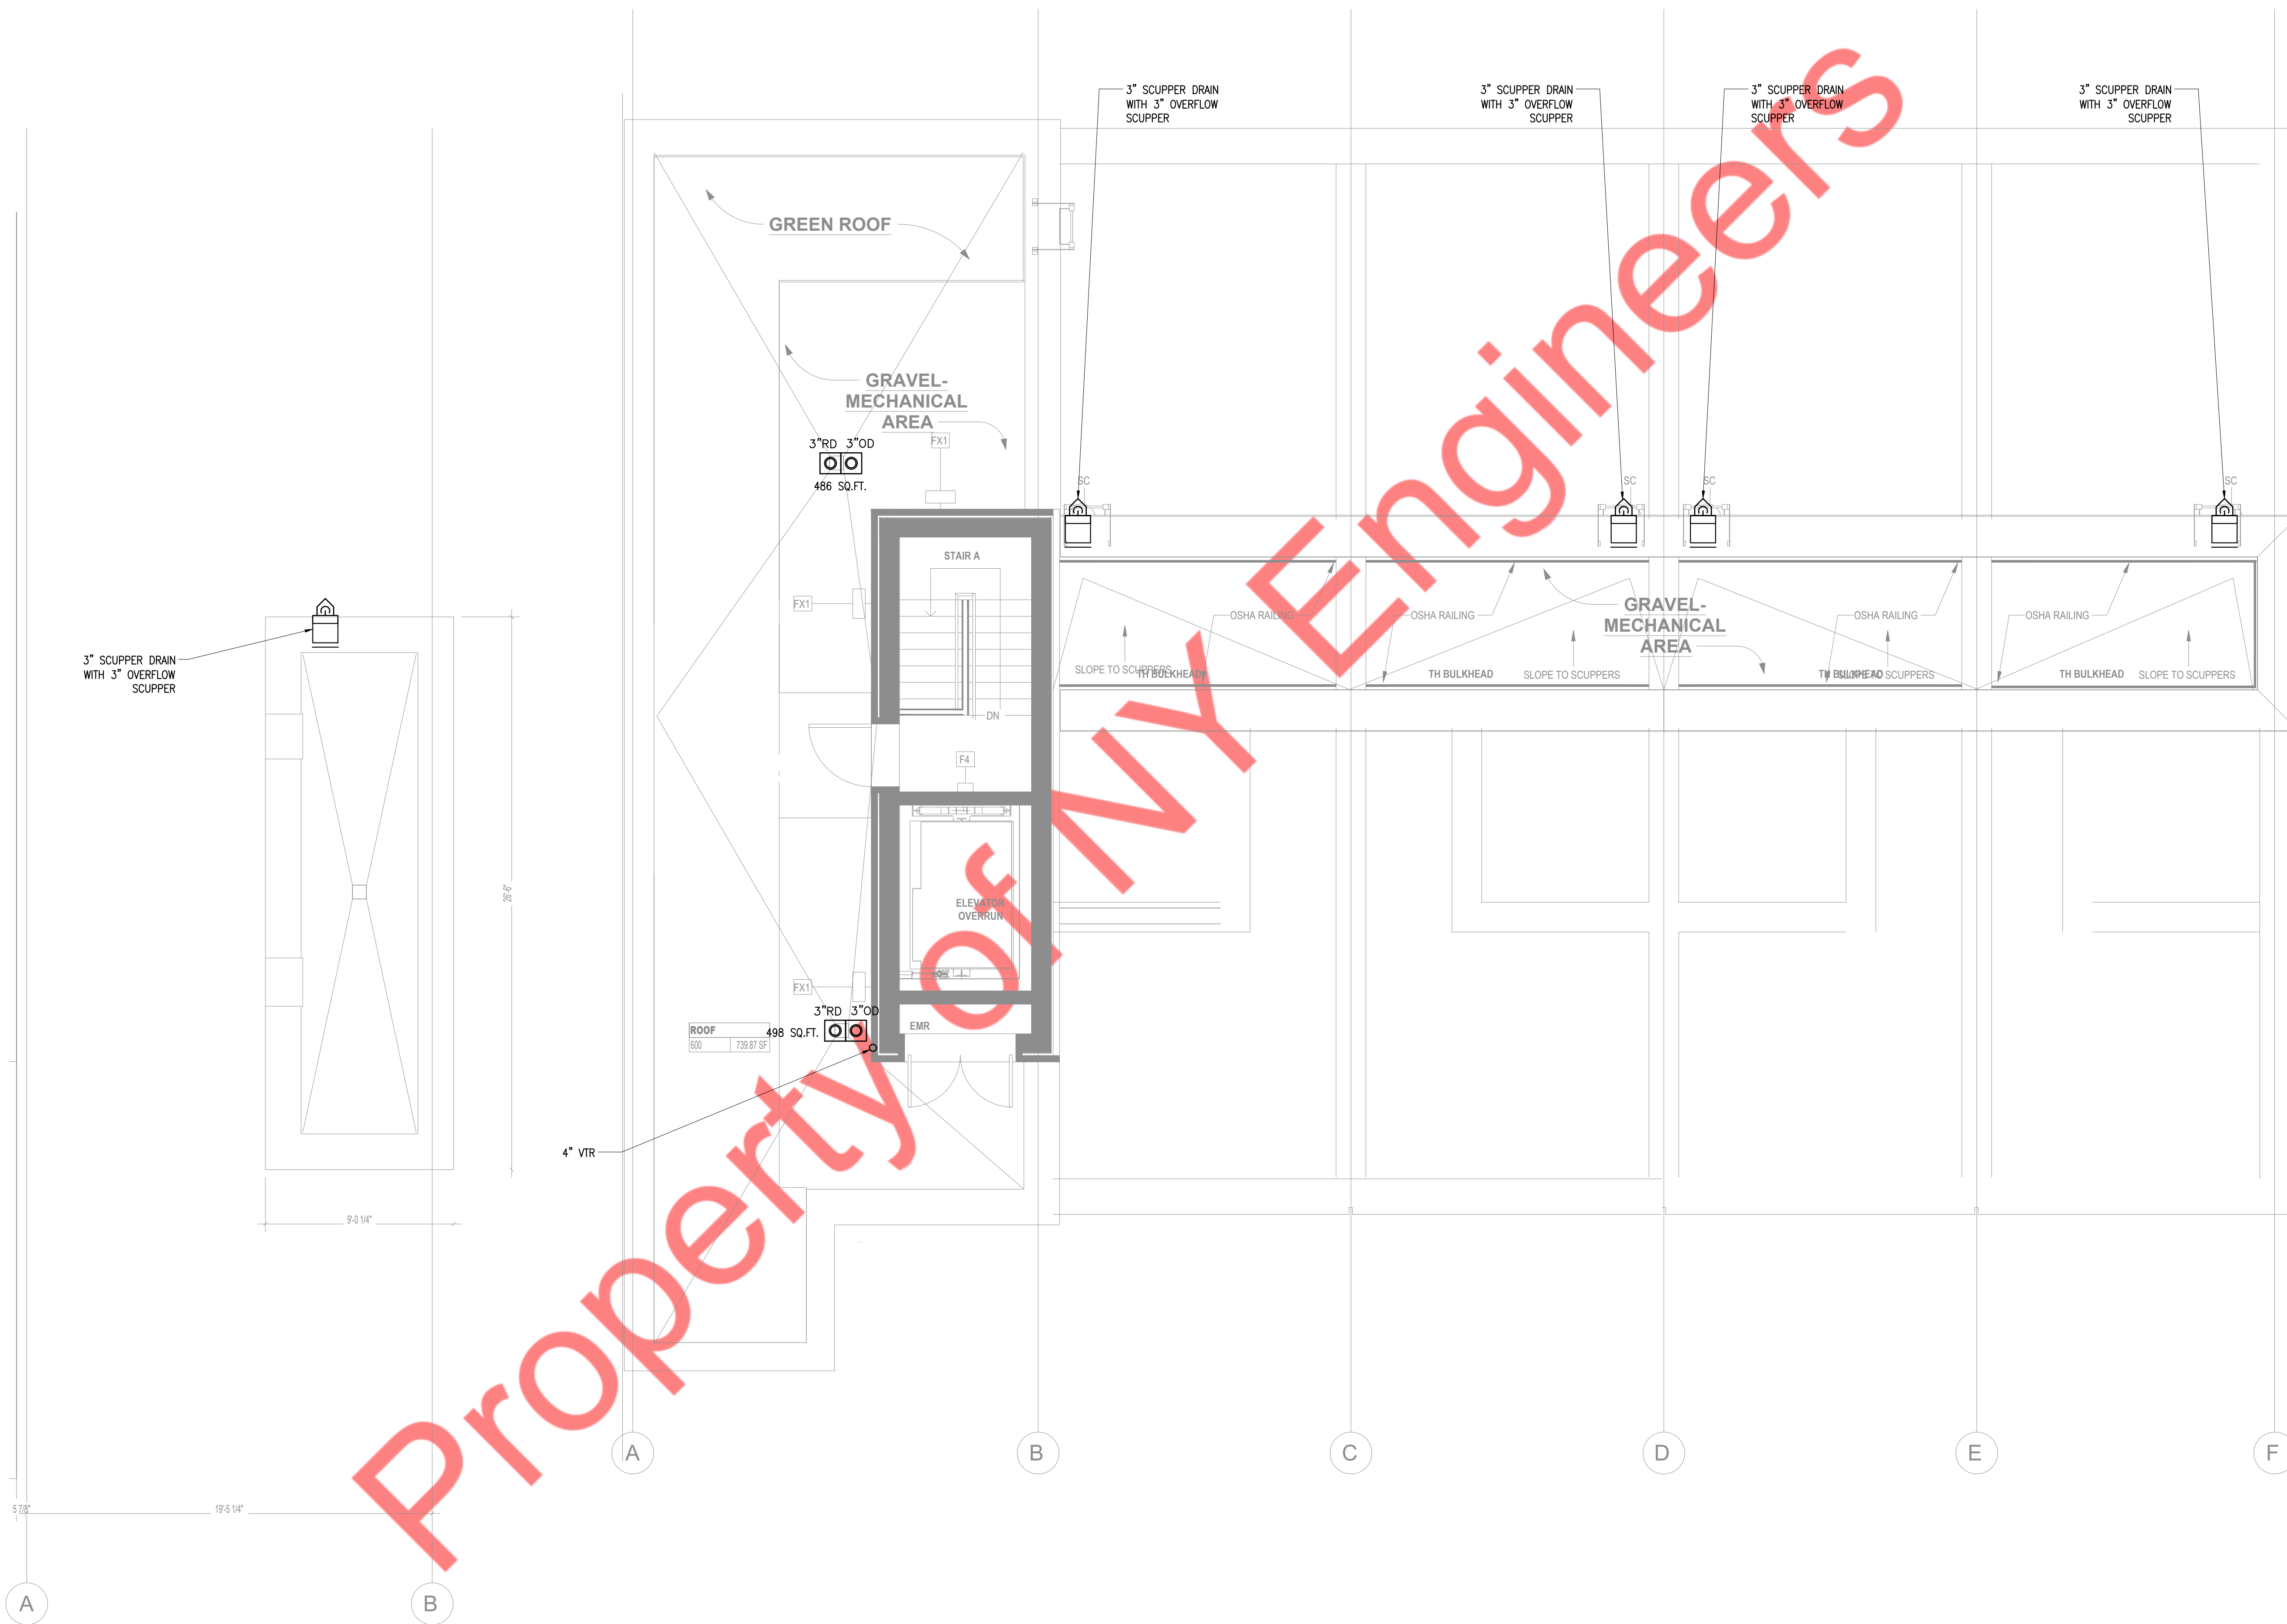

① BULKHEAD PLUMBING PLAN
1/4" = 1'-0"

② ROOF PLUMBING PLAN
1/4" = 1'-0"