


KEYED WORK NOTES:

1. FIRE ALARM FOR RESIDENTIAL AREA IS FILED UNDER SEPARATE DOB APPLICATION #421421429.

DRAWING NOTES:

- REFER TO DWG. FA-001.00 FOR FIRE ALARM SYMBOL LIST, ABBREVIATIONS, FIRE ALARM RISER DIAGRAM AND FA-002.00 FOR FIRE ALARM NOTES.
- FINAL CONDUIT/CABLE ROUTING SHALL BE DETERMINED IN-FIELD, AND PRIOR TO THE COMMENCEMENT OF WORK, COORDINATED WITH OTHER TRADE CONTRACTORS AND THE OWNER.
- ALL STROBES, INCLUDING COMBINATION SPEAKER/STROBES SHALL BE 75cd U.O.N.
- SPEAKER LAYOUT SHALL MEET DESIGN MINIMUM OF 15dBA ABOVE AMBIENT.

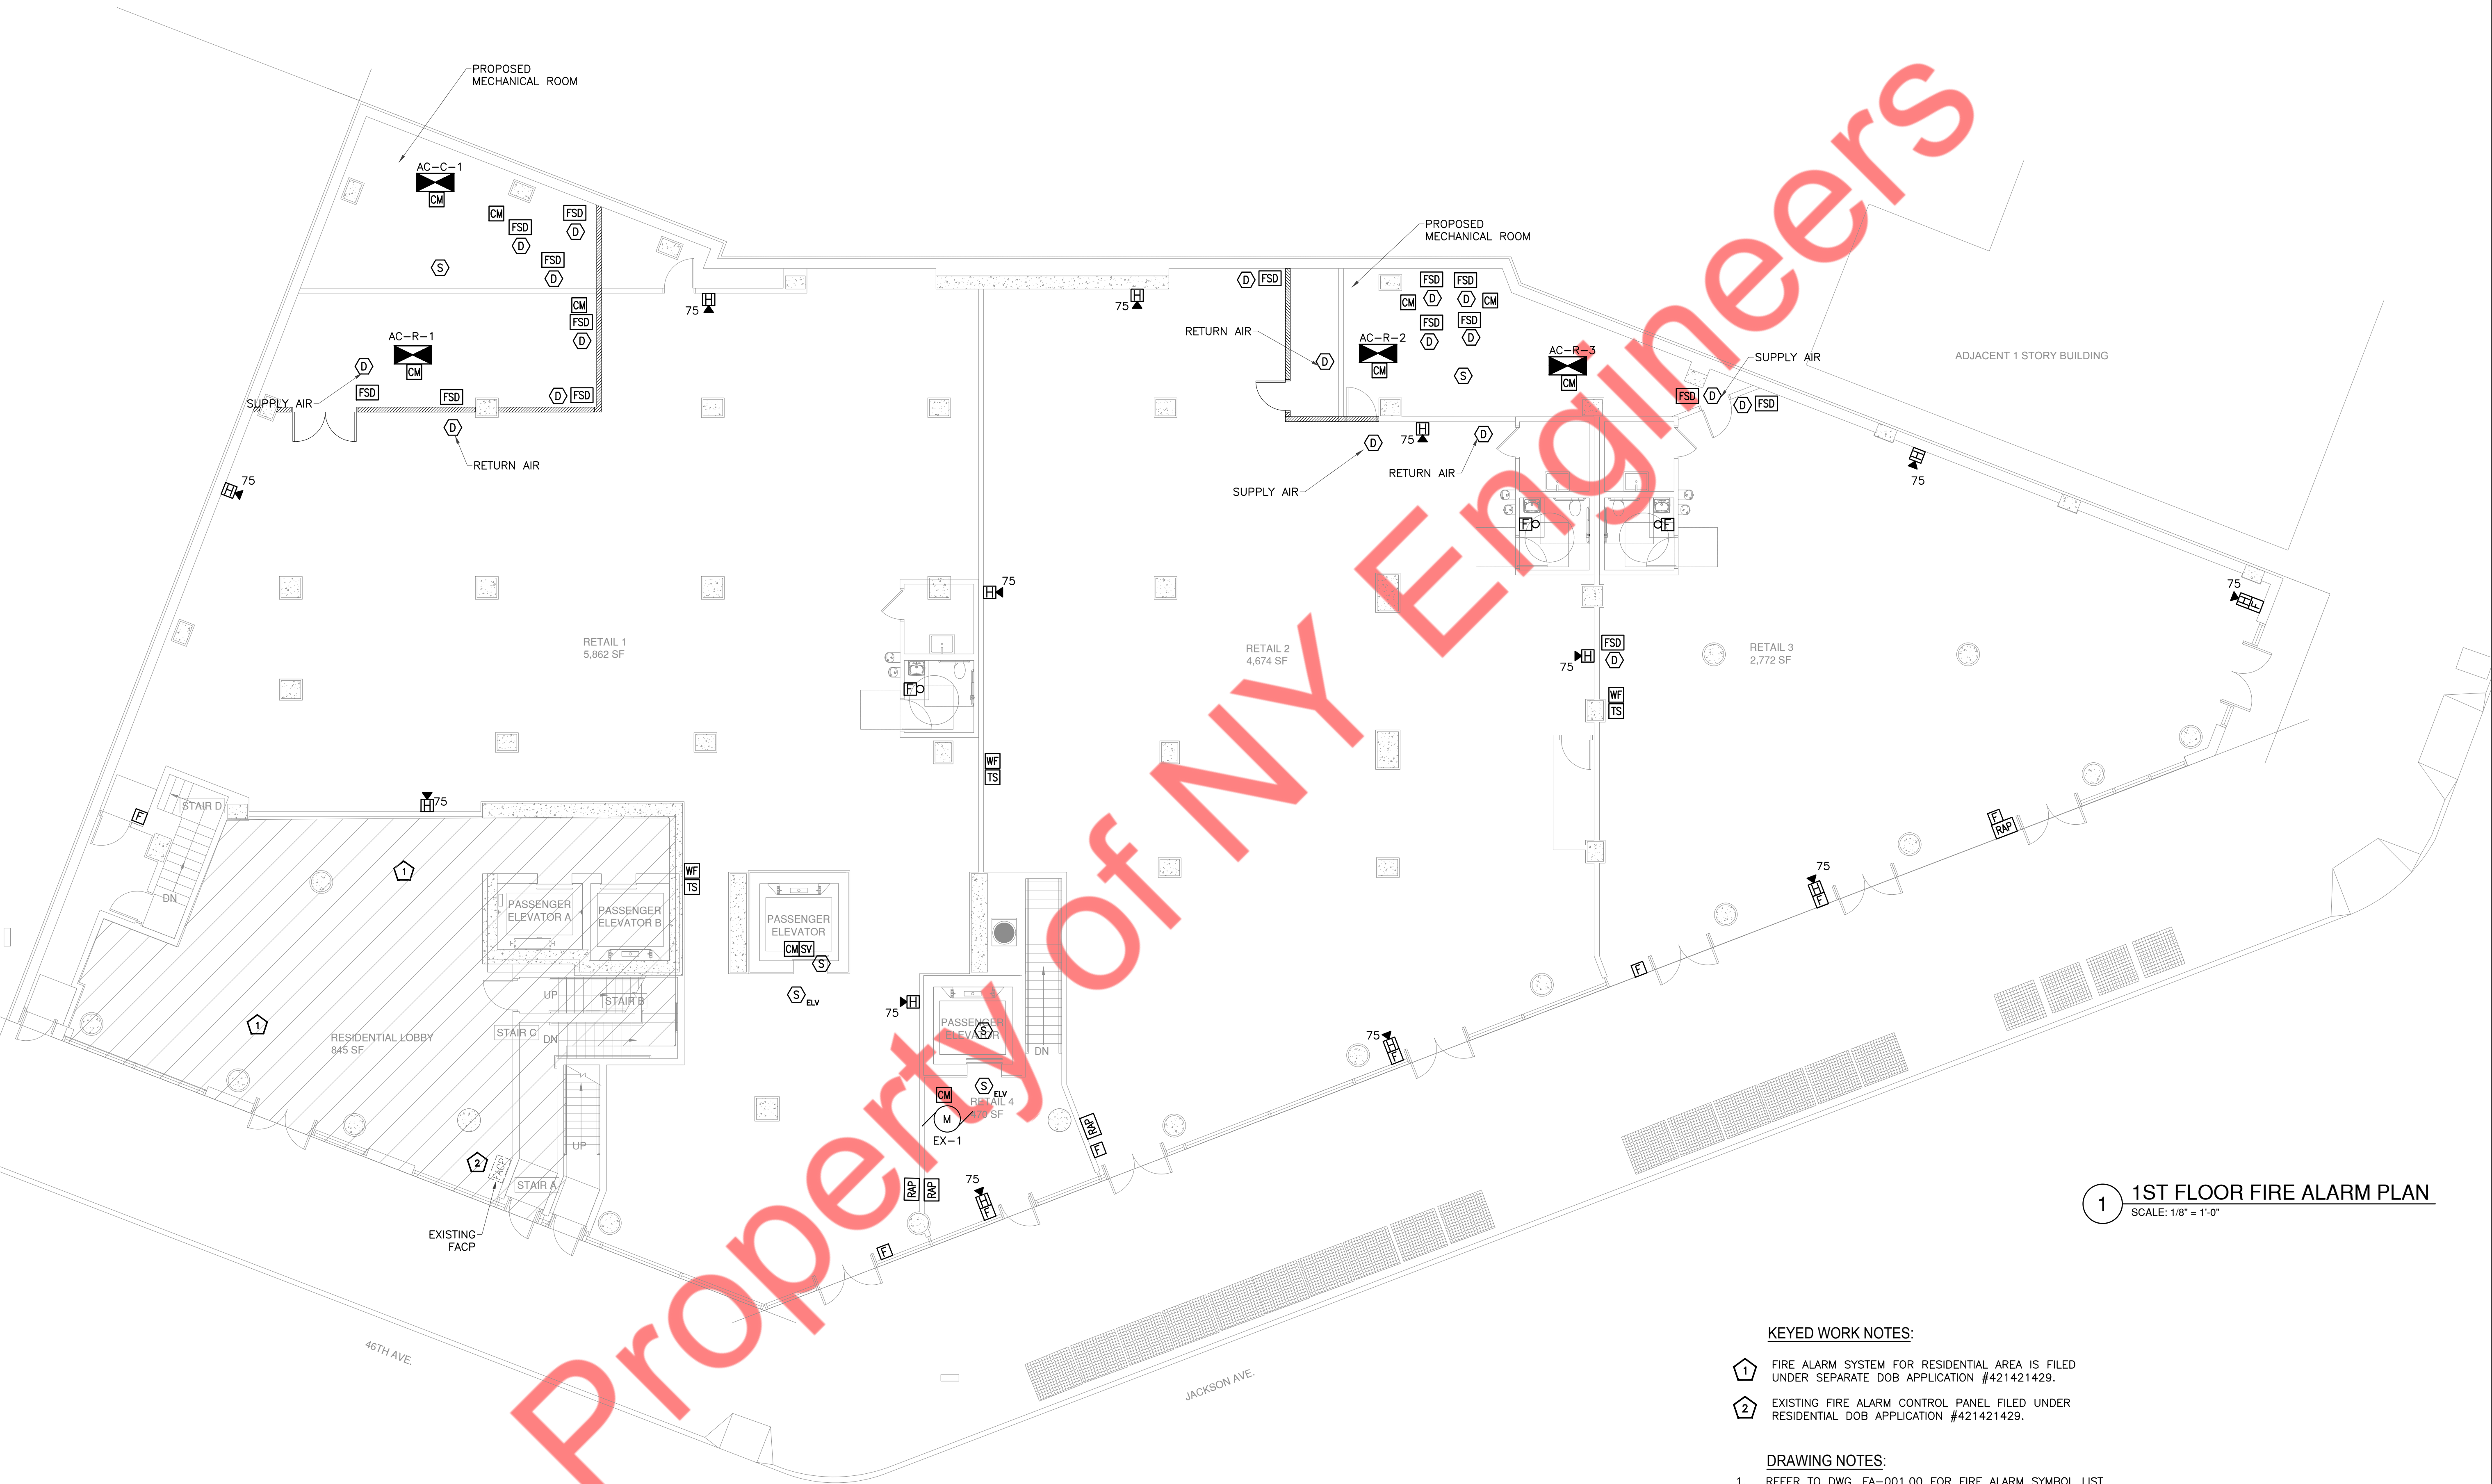

1 1ST FLOOR FIRE ALARM PLAN
SCALE: 1/8" = 1'-0"

KEYED WORK NOTES:

- 1 FIRE ALARM SYSTEM FOR RESIDENTIAL AREA IS FILED UNDER SEPARATE DOB APPLICATION #421421429.
- 2 EXISTING FIRE ALARM CONTROL PANEL FILED UNDER RESIDENTIAL DOB APPLICATION #421421429.

DRAWING NOTES:

1. REFER TO DWG. FA-001.00 FOR FIRE ALARM SYMBOL LIST, ABBREVIATIONS, FIRE ALARM RISER DIAGRAM AND FA-002.00 FOR FIRE ALARM NOTES.
2. FINAL CONDUIT/CABLE ROUTING SHALL BE DETERMINED IN-FIELD, AND PRIOR TO THE COMMENCEMENT OF WORK, COORDINATED WITH OTHER TRADE CONTRACTORS AND THE OWNER.
3. ALL STROBES, INCLUDING COMBINATION SPEAKER/STROBES SHALL BE 75cd U.O.N.
4. SPEAKER LAYOUT SHALL MEET DESIGN MINIMUM OF 15dBA ABOVE AMBIENT.