

**LIGHTING FIXTURE SCHEDULE**

SYMBOL	DESCRIPTION	MANUFACTURER	PRODUCT	REMARK
	EMERGENCY WALL PACK ABOVE SERVICE DOOR	LITHONIA LIGHTING	WST LED P3 30K VW MVOLT BBW	
	EXTERIOR WALL SCONCE	KICHLER	11251BKT30	


NOTE: - E.C. TO VERIFY FINAL SELECTION OF LIGHT FIXTURES WITH ARCHITECT.


KEYED NOTES: -

CONNECT EMERGENCY LIGHT FIXTURE AHEAD OF SWITCH FOR CONTINUOUS OPERATION.

E.C. SHALL COORDINATE EXACT POWER REQUIREMENT FOR ICE MACHINE CONDENSER WITH MANUFACTURER AND PROVIDE BREAKER, BRANCH CIRCUIT AND DISCONNECT ACCORDINGLY.

LEGEND	
SYMBOL	DEFINITION
	PANELBOARD - 208/120V, 3Ø, 4W
	DISCONNECT SWITCH, HEAVY DUTY, 240V: 3P INDICATES NO. OF POLES, 60=SWITCH RATING, 35=FUSE SIZE (NEMA CLASS R) (NF=NON-FUSED), 3R=NEMA 3R ENCLOSURE (NEMA1 ENCLOSURE UNLESS OTHERWISE NOTED)
	BRANCH CIRCUIT HOMERUN TO INDICATED PANEL. 2 #12 & 1 #12 EGC IN 3/4" EMT UNLESS OTHERWISE NOTED OR SHOWN. PROVIDE SEPARATE EGC FOR EACH BRANCH CIRCUIT.
	CONDUIT RUN CONCEALED ABOVE CEILING OR IN WALLS OR RUN EXPOSED ON CEILING AREA WHERE THERE IS NO FINISHED CEILING. (MIN 3/4" EMT)
	RECEPTACLE INTEGRAL TO UNIT
EF	EXHAUST FAN
EGC	EQUIPMENT GROUNDING CONDUCTOR
FLA	FULL LOAD AMPERES
GEC	GROUNDING ELECTRIC CONDUCTOR
MCA	MINIMUM CIRCUIT AMPACITY
MOC	MAXIMUM OVERCURRENT CIRCUIT PROTECTION
PVC	POLYVINYL CHLORIDE CONDUIT
RSC	RIGID STEEL CONDUIT
RTU	ROOFTOP UNIT
V	VOLTS
Sw	MOTOR SWITCH

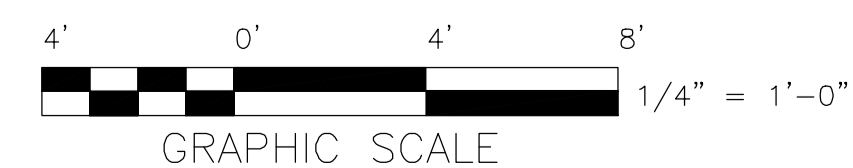

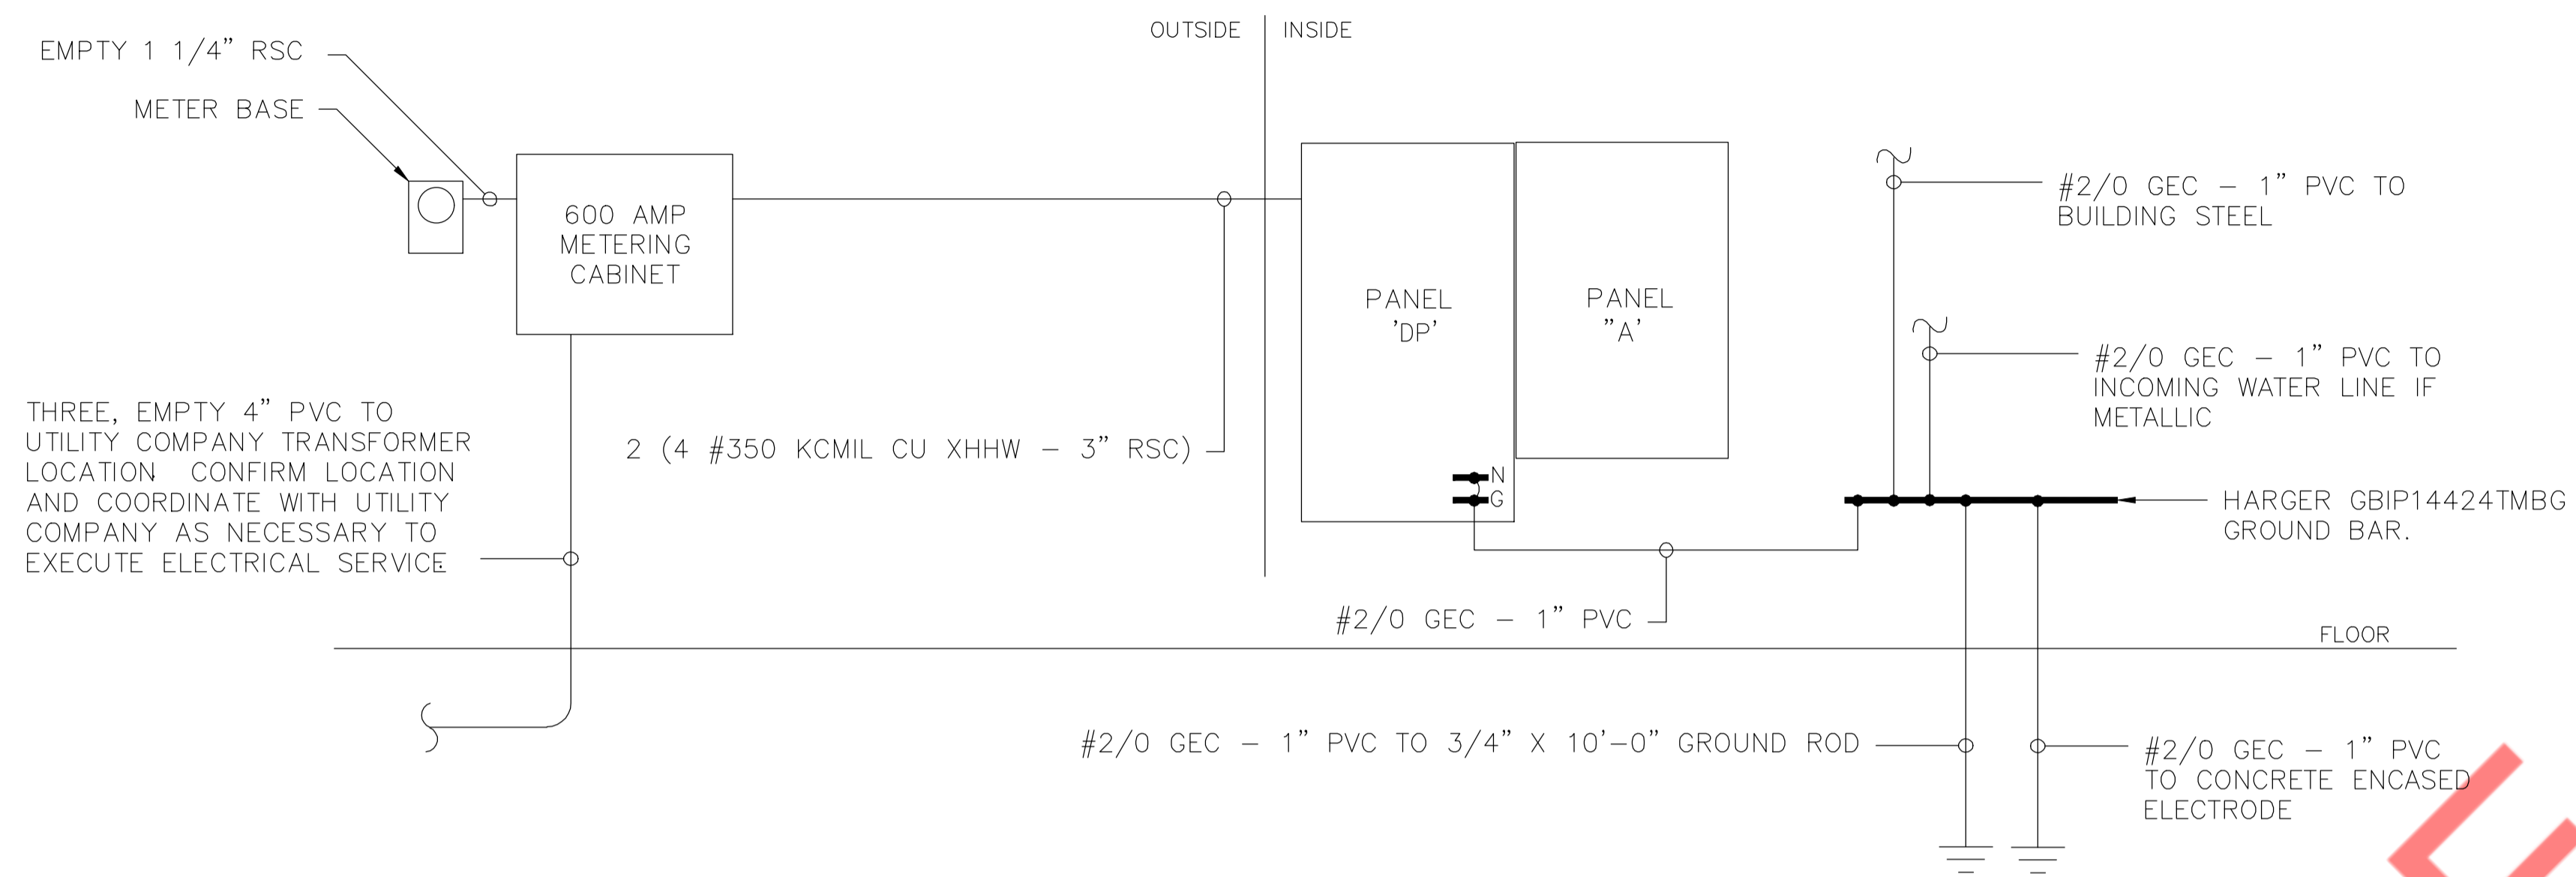

ELECTRICAL SYSTEM RISER DIAGRAM

NOT TO SCALE

Property of NY Engineers